



ZL-RTB-DB09 ZL-RTB-DB25 ZL-RTB-DB15

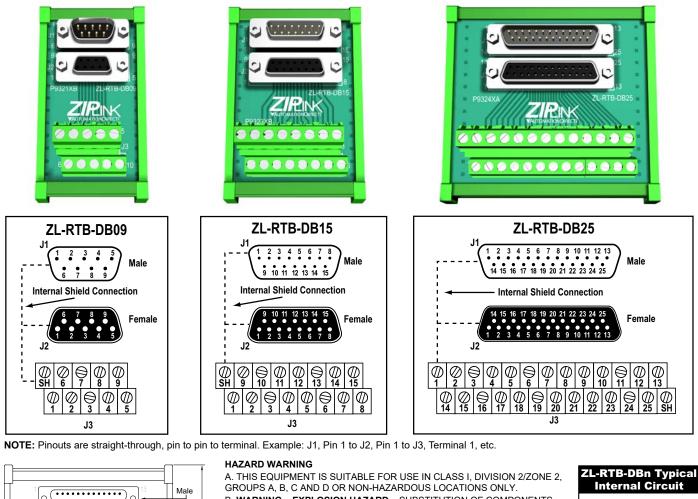





A. THIS EQUIPMENT IS SUITABLE FOR USE IN CLASS I, DIVISION 2/ZONE 2 GROUPS A, B, C AND D OR NON-HAZARDOUS LOCATIONS ONLY.
B. WARNING - EXPLOSION HAZARD - SUBSTITUTION OF COMPONENTS MAY IMPAIR SUITABILITY FOR CLASS I, DIVISION 2/ZONE 2.
C. WARNING - EXPLOSION HAZARD - DO NOT CONNECT OR DISCON-

NECT CONNECTORS OR OPERATE SWITCHES WHILE CIRCUIT IS LIVE UNLESS THE AREA IS KNOWN TO BE NON-HAZARDOUS. D. ALL MODULES USED WITH ACCESSORIES MUST USE R/C (ECBT2) MATING

PLUG FOR ALL APPLICABLE MODELS. ALL MATING PLUGS SHALL HAVE SUIT-ABLE RATINGS FOR DEVICE.

Terminal Block Insertion Point Opening Dimension





NOTE: A 2-meter cable is available for each D-sub module. See the Specifications Chart below.


35mm DIN RAIL
¢
)3" [mm]

Specifications				
	ZL-RTB-DB09	ZL-RTB-DB15	ZL-RTB-DB25	
Description*	9-pin male and female D-subs to terminal blocks		25-pin male and female D-subs to terminal blocks	
Approvals	File # E200031 UL, cUL, Class 1, Division 2, Groups A,B,C,D Hazardous Locations, CE, EN 61131-2:2007			
UL Voltage Rating**	30VDC			
Maximum Current per Circuit	1A			
Number of Circuits	9	15	25	
Wire Range (Rated Cross Section)**	12-24AWG Solid or Stranded Copper Conductor (2.5mm ²)			
Wire Strip Length	0.24-0.27" (6-7mm)			
Screw Torque	4.4 in-lbs (0.5 Nm)			
Surrounding Temperature Range	32 to 140°F (0 to 60°C)			
Terminal Block Contacts	Copper alloy, tin-lead plated			
Dimensions (WxHxD)	1.74" x 3.42" x 2.03" (44.1mm x 86.8mm x 51.6mm)	2.18" x 3.42" x 2.03" (55.4mm x 86.8mm x 51.6mm)	3.50" x 3.42" x 2.03" (88.9mm x 86.8mm x 51.6mm)	
Cable/Wire Clearances	0.5″ (12.7mm)			
Mounting Restrictions	None			
Cables (sold seperately)	ZL-DB9-CBL-2	ZL-DB15-CBL-2	ZL-DB25-CBL-2	

*Connecting cables are for internal wiring only. **Use Class 2 Power Supply. Use conductors rated 60°/75°C.

RJ12 Feedthrough Module Installation Instructions AUTOMATIONDIRECT

ZL-RTB-RJ12

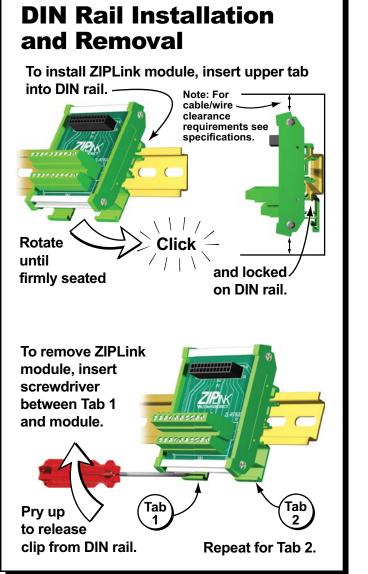

WARNING: To minimize the risk of potential safety problems, you should follow all applicable local and national codes that regulate the installation and operation of your equipment. These codes vary from area to area and it is your responsibility to determine which codes should be followed, and to verify that the equipment, installation, and operation are in compliance with the latest revision of these codes.


Equipment damage or serious injury to personnel can result from the failure to follow all applicable codes and standards. We do not guarantee the products described in this publication are suitable for your particular application, nor do we assume any responsibility for your product design, installation, or operation.

If you have any questions concerning the installation or operation of this equipment, or if you need additional information, please call Technical Support at 770-844-4200.

This publication is based on information that was available at the time it was printed. At AutomationDirect.com® we constantly strive to improve our products and services, so we reserve the right to make changes to the products and/or publications at any time without notice and without any obligation. This publication may also discuss features that may not be available in certain revisions of the product.

3505 Hutchinson Road, Cumming GA 30040 1-800-633-0405 www.automationdirect.com

Copyright 2008, AutomationDirect.com Incorporated/All Rights Reserved Worldwide

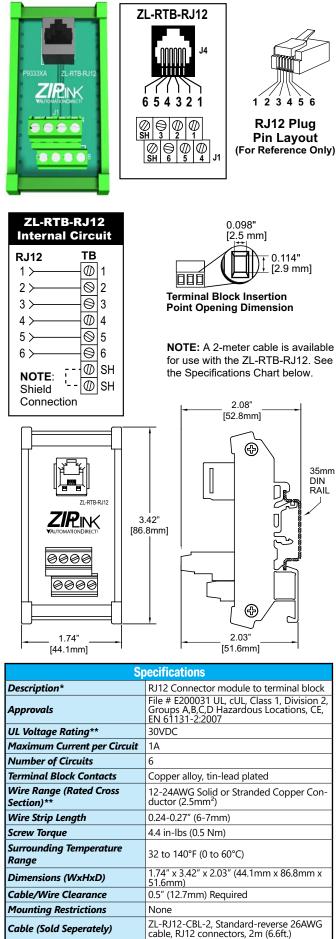

35mm DIN RAIL

*Connecting cables are for internal wiring only. **Use Class 2 Power Supply. Use conductors rated 60°/75°C.

11/20/2024 Document # ZL-RTB-DB09_ZL-RTB-DB15_ZL-RTB-DB25 ZL-RTB-RJ12 Rev3