1-800-633-0405

Eaton Quality at AutomationDirect Prices







Third party Certification and marking

- UL recognized under UL 1077 Category QVNU2, File E177451
- CSA 22.2, No. 235 File 204453
- CE File LVD 2006/95/EC
- IEC 60898
- IEC 60947-2

Full line of field installable accessories

- Auxiliary switch
- Alarm/Auxiliary Switch
- Shunt trip

Trip curves • B [3-5 I_n]

• C [5-10 I_n]

• D [10-20 I_n]

- Padlock provision
- Busbar systems



FAZ Series Supplementary Protectors

FAZ Supplementary Protectors are UL 1077 recognized for applications where branch circuit protection is not required or is already provided. They are thermal magnetic and protect against short circuit (see ratings chart) and overload conditions.

These DIN-rail mounted supplementary protectors come in one, two and three pole configurations and are available in three trip curves.

The B curve magnetic trip point is 3 to 5 times the rated current and is typically used for computers and electronic loads with very low current loads.

The C curve magnetic trip point is 5 to 10 times the rated current and is typically used for small transformers, pilot devices, etc.

The D curve magnetic trip point is 10 to 20 times the rated current and is typically used for transformers or with very high inductive loads.

Shunt trips are available for remotely tripping the protector with an external voltage from a control system or alarm device.

A padlocking feature is also available for preventing unauthorized operation. Maintenance personnel can safely work on protected equipment without electrical safety concerns.



Overview

The Eaton FAZ supplementary protectors are used to provide overcurrent protection where branch protection (for example, UL 489 MCCB) is already provided or not required. The units can be installed as a component within, or as a part of an appliance or a piece of electrical equipment. Supplementary protectors are ideal replacements for fuses that are applied as a supplementary protector, i.e. in addition to branch protection (if required). They are 35mm DIN-rail mountable, utilizing spring clips. These are standard protectors, recognized by UL and CSA under UL 1077 and CSA 22.2. They are CE marked in accordance with Low Voltage Directive (LVD) (73/23/EEC).

Product Specification

The FAZ supplementary protector is a dual-rated product for both AC and DC supplies, in accordance with UL 1077 and CSA 22.2 standards and is marked with CE in accordance with the Low Voltage Directive. With this dual standard product, you can include it in your design, knowing that in most cases wherever your equipment is used, the product will conform to the local UL, CSA or IEC (International) requirements.

The supplementary protector is designed to be applied in conjunction with a branch circuit protector (if branch protection is required) and can be a replacement for similarly applied fuses. Its advantage over fuses is that it is resettable and the device's status is easily and clearly identified by the position of the handle and the flag indicator.

Listings

- UL recognized under UL 1077 Category QVNU2 File E177451
- CSA 22.2, No. 235 File 204453

Applications

FAZ Supplementary protectors are recognized per UL 1077 and certified per CSA C22.2 No. 235 as a Supplementary Protector and can be fully utilized per the NEC and CEC Codes in that capacity. For international purposes, the entire FAZ family is CE marked and in full conformity with the applicable IEC standards for miniature circuit breakers, EN/IEC 60898 and IEC/EN 60947-2.

Outside North America, they can be used in both residential and industrial applications as feeder and branch circuit www.automationdirect.com



In addition, you can select a device that provides maximum reliability and accuracy to fit various applications due to the availability of a wide range of current ratings from 0.5 to 63 amperes in three overcurrent characteristic curves, B, C and D.

Features and Benefits

- Dual rated for AC or DC Applications
- Box terminals accept #18 to #4 wire (1 to 25mm²) for one wire connection or #18 to #8 for two wire connection.
- Thermal magnetic overcurrent protection: three levels, categorized by B, C and D curves in direct relation to continuous rating of the device
- B curve magnetic trip point: 3 to 5 times the rated current, typically used for computers and electronic loads with very low inrush currents (PLC
- CE File LVD 2006/95/EC
- IEC/EN 60898

protective devices. In North America, most European Miniature Circuit Breakers are only UL recognized and CSA certified as "Supplementary Protectors", meaning they <u>cannot</u> be utilized as feeder or branch circuit protective devices per the local electrical codes

(2008 NEC 240.10 and CEC Part 1 C22.1). This commonly restricts their use to applications where "closer" protection is desired than that offered by a branch circuit protection device.

Eaton FAZ Supplementary Protectors are

wiring).

- C curve magnetic trip point: 5 to 10 times the rated current, typically used for small transformers, pilot devices, etc.
- D curve magnetic trip point: 10 to 20 times the rated current, typically used for transformers or devices with very high inductive loads.
- Trip Free Design: Protector cannot be defeated by holding the handle in the "ON" position.
- Module width of only 17.7 mm per pole
- Color coded status indicator window Red = ON or Green = OFF
- P20 finger protection
- 35mm DIN-rail mountable, utilizing spring clip
- Captive screws cannot be lost
- Suitable for reverse feed applications

ideal for providing protection in many applications, including:

- • Control power transformers (D curve)
- • Relays
- • Contactor coils
- • PLC I/O points
- • Lighting circuits
- • Power supplies
- Computers
- Electronic equipment
- Control circuits


Circuit Protection

tCPR-100

[•] IEC/EN 60947-2



Supplementary Protectors Sample Applications

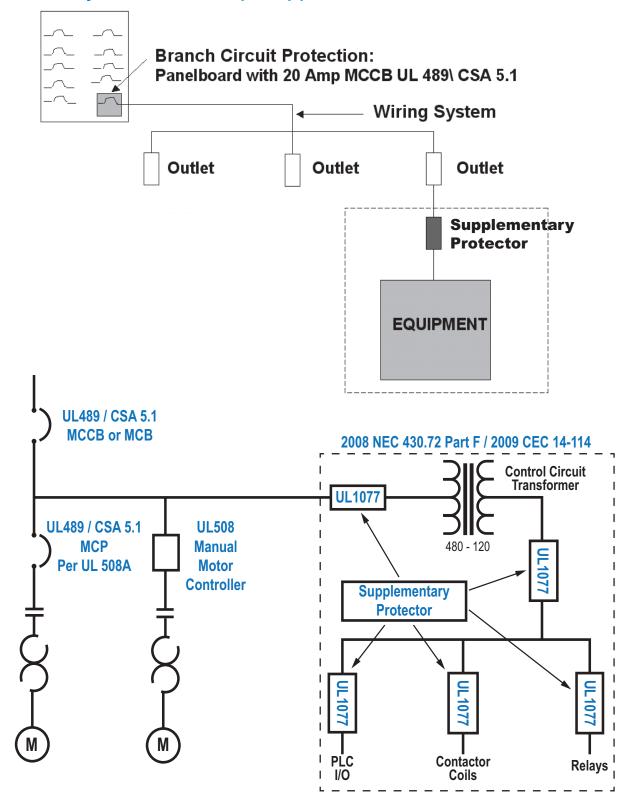

Supplementary protectors are not to be used in feeder circuits or motor circuits. Use them only in applications where branch protection is already provided or is not required.

FAZ Supplementary Protectors Selection Guide



Single-Pole

Note: Eaton product part numbers will contain a [.] instead of [P] and a [/] instead of a [-]. Example: FAZ-C0P5-1-SP =FAZ-C0.5/1-SP

FAZ - Single-Pole Selection Guide						
Ampere Rating	B Curve Part Number	Price	C Curve Part Number	Price	D Curve Part Number	Price
0.5	-	-	FAZ-C0P5-1-SP		FAZ-D0P5-1-SP	
1	FAZ-B1-1-SP		FAZ-C1-1-SP		FAZ-D1-1-SP	
2	FAZ-B2-1-SP		FAZ-C2-1-SP		FAZ-D2-1-SP	
3	<u>FAZ-B3-1-SP</u>		FAZ-C3-1-SP		<u>FAZ-D3-1-SP</u>	
4	FAZ-B4-1-SP		FAZ-C4-1-SP		FAZ-D4-1-SP	
5	FAZ-B5-1-SP		FAZ-C5-1-SP		FAZ-D5-1-SP	
6	FAZ-B6-1-SP		FAZ-C6-1-SP		FAZ-D6-1-SP	
7	FAZ-B7-1-SP		FAZ-C7-1-SP		FAZ-D7-1-SP	
8	FAZ-B8-1-SP		FAZ-C8-1-SP		<u>FAZ-D8-1-SP</u>	\$19.00
10	FAZ-B10-1-SP		FAZ-C10-1-SP	\$19.00	FAZ-D10-1-SP	
13	<u>FAZ-B13-1-SP</u>	\$19.00	<u>FAZ-C13-1-SP</u>	φ19.00	FAZ-D13-1-SP	
15	FAZ-B15-1-SP		FAZ-C15-1-SP		FAZ-D15-1-SP	
16	<u>FAZ-B16-1-SP</u>		<u>FAZ-C16-1-SP</u>		<u>FAZ-D16-1-SP</u>	
20	FAZ-B20-1-SP		FAZ-C20-1-SP		FAZ-D20-1-SP	
25	<u>FAZ-B25-1-SP</u>		<u>FAZ-C25-1-SP</u>		<u>FAZ-D25-1-SP</u>	
30	FAZ-B30-1-SP		FAZ-C30-1-SP		<u>FAZ-D30-1-SP</u>	
32	<u>FAZ-B32-1-SP</u>		<u>FAZ-C32-1-SP</u>		<u>FAZ-D32-1-SP</u>	
40	FAZ-B40-1-SP		FAZ-C40-1-SP		FAZ-D40-1-SP	
50	FAZ-B50-1-SP		FAZ-C50-1-SP		-	-
63	FAZ-B63-1-SP		FAZ-C63-1-SP		-	-



Two-Pole

Note: Eaton parts available for sale to North America locations only.

FAZ - Two-Pole Selection Guide							
Ampere Rating	B Curve Part Number	Price	C Curve Part Number	Price	D Curve Part Number	Price	
0.5	-	-	FAZ-C0P5-2		FAZ-D0P5-2		
1	<u>FAZ-B1-2</u>		<u>FAZ-C1-2</u>		<u>FAZ-D1-2</u>		
2	<u>FAZ-B2-2</u>		<u>FAZ-C2-2</u>		<u>FAZ-D2-2</u>		
3	<u>FAZ-B3-2</u>		<u>FAZ-C3-2</u>		<u>FAZ-D3-2</u>		
4	<u>FAZ-B4-2</u>		<u>FAZ-C4-2</u>		<u>FAZ-D4-2</u>		
5	FAZ-B5-2		FAZ-C5-2		<u>FAZ-D5-2</u>		
6	FAZ-B6-2		FAZ-C6-2		<u>FAZ-D6-2</u>		
7	<u>FAZ-B7-2</u>		FAZ-C7-2		FAZ-D7-2		
8	FAZ-B8-2		FAZ-C8-2	¢00 F0	<u>FAZ-D8-2</u>	\$36.50	
10	FAZ-B10-2		FAZ-C10-2		FAZ-D10-2		
13	FAZ-B13-2	\$36.50	FAZ-C13-2	\$36.50	FAZ-D13-2		
15	FAZ-B15-2		FAZ-C15-2		FAZ-D15-2		
16	FAZ-B16-2		FAZ-C16-2		FAZ-D16-2		
20	FAZ-B20-2		FAZ-C20-2		FAZ-D20-2		
25	FAZ-B25-2		FAZ-C25-2		FAZ-D25-2		
30	FAZ-B30-2		FAZ-C30-2		FAZ-D30-2		
32	FAZ-B32-2	1	FAZ-C32-2		FAZ-D32-2		
40	FAZ-B40-2	1	FAZ-C40-2		FAZ-D40-2		
50	FAZ-B50-2		FAZ-C50-2		-	-	
63	FAZ-B63-2		FAZ-C63-2		-	-	

FAZ Supplementary Protectors Selection Guide

	FAZ - Three-Pole Selection Guide						
Ampere Rating	B Curve Part Number	Price	C Curve Part Number	Price	D Curve Part Number	Price	
0.5	-	-	FAZ-C0P5-3		FAZ-D0P5-3		
1	<u>FAZ-B1-3</u>		FAZ-C1-3		<u>FAZ-D1-3</u>		
2	<u>FAZ-B2-3</u>		FAZ-C2-3		<u>FAZ-D2-3</u>		
3	<u>FAZ-B3-3</u>		FAZ-C3-3		<u>FAZ-D3-3</u>		
4	<u>FAZ-B4-3</u>		FAZ-C4-3		FAZ-D4-3		
5	<u>FAZ-B5-3</u>		FAZ-C5-3		FAZ-D5-3		
6	<u>FAZ-B6-3</u>		FAZ-C6-3		FAZ-D6-3		
7	<u>FAZ-B7-3</u>		FAZ-C7-3		<u>FAZ-D7-3</u>		
8	<u>FAZ-B8-3</u>		FAZ-C8-3		FAZ-D8-3	\$49.50	
10	<u>FAZ-B10-3</u>		FAZ-C10-3	\$49.50	<u>FAZ-D10-3</u>	\$49.00	
13	FAZ-B13-3	\$49.50	FAZ-C13-3	\$49.50	FAZ-D13-3		
15	<u>FAZ-B15-3</u>		FAZ-C15-3		FAZ-D15-3		
16	<u>FAZ-B16-3</u>		FAZ-C16-3		FAZ-D16-3		
20	FAZ-B20-3		FAZ-C20-3		FAZ-D20-3		
25	FAZ-B25-3		FAZ-C25-3		FAZ-D25-3		
30	<u>FAZ-B30-3</u>		FAZ-C30-3		<u>FAZ-D30-3</u>		
32	<u>FAZ-B32-3</u>		FAZ-C32-3		<u>FAZ-D32-3</u>		
40	<u>FAZ-B40-3</u>		FAZ-C40-3		<u>FAZ-D40-3</u>		
50	FAZ-B50-3		FAZ-C50-3		-	-	
63	<u>FAZ-B63-3</u>		FAZ-C63-3		_	-	



Three-Pole

Note: Eaton product part numbers will contain a [.] instead of [P] and a [/] instead of a [-]. Example: FAZ-C0P5-3 = FAZ-C0.5/3 1-800-633-0405

FAT-N FAZ Series Technical Specifications

	UL 1077 Supplementary	Protectors – UL/C	SA			
		B Curve	C Curve	D Curve		
Short Circuit Trip Response		3 - 5 <i>I</i> n	5 - 10 <i>I</i> n	10 - 20 <i>I</i> n		
Current Range		1 - 63 A	0.5 - 63 A	0.5 - 40 A		
	1 pole		277VAC, 48VDC			
Maximum Voltage Ratings UL / CSA	2 pole / 3 pole	480Y / 277VAC*				
	2 poles in series	96VDC Max				
Thermal Tripping	1 pole	1.35 <i>I</i> n @ 40°C				
Characteristics	Multi-pole	1.45 <i>I</i> n @ 40°C				
	1	10kA (5kA for 40 - 63 A)		5kA		
Interrupting	1 pole	10kA @ 48VDC				
Ratings	2 pole	10kA /EkA for	40 62 4)	EL A		
(@ maximum voltage)	3 pole	10kA (5kA for	40 - 03 Aj	5kA		
	2 poles in series	10kA @ 96VDC				
Agency Approvals		File E177451, UL 1077, File 204453 CSA 22.2 No. 235, CE				

Note: To obtain the most current agency approval information, see the Agency Approval Checklist section on the specific part number's web page.

		IEC/EN	60947-2 Miniat	ure Circuit Breake	r			
				B Curve	C Curve	D Curve		
Short Circuit	Trip Response			3 - 5 <i>I</i> n	5 - 10 <i>I</i> n	10 - 20 <i>I</i> n		
Current Rang	le			1 - 63 A	0.5 - 63 A	0.5 - 63 A		
Maximum Vol	Itage	1 pole			240VAC, 48VDC			
Ratings -	-	2 pole / 3 p	ole		240/415 VAC			
IEC/EN 60947	-2	2 poles in a	series		96VDC			
Thermal Tripp		1 pole			> 1 hour @ 1.05 In			
Characteristic	cs	Multi-pole			< 1 hour @ 1.3 <i>I</i> n			
Interrupt Rati	ings (At Max Voltage)				15kA			
Operational S	Switching Capacity				7.5 kA			
Max. Back-up	o Fuse				125A gL/gG			
Rated impuls	e withstand - $U_{ m imp}$				4000VAC			
Rated insulat	ion voltage - $U_{ m i}$				440VAC			
			General Spec	ifications				
Selectivity Cl	ass			3				
Lifespan >10,000 (1 operation = ON/OFF)					N/OFF)			
Operating Temperature				-40 to +167°F (–40 to +	75°C)			
Storage Temp	perature			-40 to +185°F (–40 to +	85°C)			
Shock (IEC68	3-2-22)			10g - 120ms				
Housing Mate	erial			Nylon				
	1 pole			0.28 lb (127g)				
Weight	2 pole			0.54 lb (245g)				
	3 pole			0.84 lb (381g)				
			Mechanical Sp	ecifications				
Terminal Prot	tection			Finger and back-of-hand proo	f to IEC 536			
Mounting Wic	dth Per Pole			17.5 mm				
Mounting				IEC/EN 60715 top-hat rail,	DIN rail			
Degree of Pro	otection			IP20				
Terminals Top	p and Bottom			Twin-purpose termin	als			
Supply Conn	ection			Line or load side				
Mounting Position Without limitation								
			Wire Size and To	orque Setting				
	Ampere Rating		Conductor S	ìize	Tightening	g Torque		
0.5 - 63		1 wire	0.75 to 25mm ²	18 to 4 AWG		(2.4 Nim)		
0.0 - 03		2 wires	0.75 to 10mm ²	18 to 8 AWG	21.2 lb·in (2.4 N·m)			

*A circuit breaker with a 480Y/277 VAC rating can be applied in a solidly grounded circuit where the nominal voltage of any conductor to ground does not exceed the lower value of the circuit breaker's rating (e.g., 277VAC) and the nominal voltage between any two conductors does not exceed its higher value (480VAC). These ratings typically can be found on protective devices such as molded-case circuit breakers and self-protected "Type F" combination motor controllers.

1-800-633-0405 For the lates For the lates For the lates


	Influence of the Ambient Temperature on the Thermal Tripping Behavior																
Rated		Ambient Temperature °C															
Current (Amps)	-40	-30	-20	-10	0	10	20	30	35	40	45	50	55	60	65	70	75
0.50	0.64	0.62	0.60	0.58	0.56	0.54	0.52	0.50	0.49	0.48	0.47	0.46	0.45	0.44	0.43	0.42	0.41
1.00	1.30	1.20	1.20	1.20	1.10	1.10	1.00	1.00	0.99	0.97	0.95	0.93	0.90	0.89	0.87	0.85	0.83
2.00	2.60	2.50	2.40	2.30	2.20	2.20	2.10	2.00	2.00	1.90	1.90	1.90	1.80	1.80	1.70	1.70	1.70
3.00	3.80	3.70	3.60	3.50	3.40	3.30	3.10	3.00	3.00	2.90	2.80	2.80	2.70	2.70	2.60	2.50	2.50
4.00	5.10	5.00	4.80	4.70	4.50	4.30	4.20	4.00	3.90	3.90	3.80	3.70	3.60	3.50	3.50	3.40	3.30
5.00	6.40	6.20	6.00	5.80	5.60	5.40	5.20	5.00	4.90	4.80	4.70	4.60	4.50	4.40	4.30	4.20	4.10
6.00	7.70	7.50	7.20	7.00	6.70	6.50	6.30	6.00	5.90	5.80	5.70	5.60	5.40	5.30	5.20	5.10	5.00
7.00	9.00	8.70	8.40	8.20	7.80	7.60	7.40	7.00	6.90	6.80	6.70	6.50	6.30	6.20	6.10	6.00	5.80
8.00	10.20	9.90	9.60	9.30	9.00	8.70	8.40	8.00	7.90	7.70	7.60	7.40	7.20	7.10	6.90	6.80	6.60
10.00	13.00	12.00	12.00	12.00	11.00	11.00	10.00	10.00	9.90	9.70	9.50	9.30	9.00	8.90	8.70	8.50	8.30
13.00	17.00	16.00	16.00	15.00	15.00	14.00	14.00	13.00	13.00	13.00	12.00	12.00	12.00	12.00	11.00	11.00	11.00
15.00	19.00	19.00	18.00	17.00	17.00	16.00	16.00	15.00	15.00	15.00	14.00	14.00	14.00	13.00	13.00	13.00	12.00
16.00	20.00	20.00	19.00	19.00	18.00	17.00	17.00	16.00	16.00	15.00	15.00	15.00	14.00	14.00	14.00	14.00	13.00
20.00	26.00	25.00	24.00	23.00	22.00	22.00	21.00	20.00	20.00	19.00	19.00	19.00	18.00	18.00	17.00	17.00	17.00
25.00	32.00	31.00	30.00	29.00	28.00	27.00	26.00	25.00	25.00	24.00	24.00	23.00	23.00	22.00	22.00	21.00	21.00
32.00	41.00	40.00	38.00	37.00	36.00	35.00	33.00	32.00	32.00	31.00	30.00	30.00	29.00	28.00	28.00	27.00	26.00
40.00	51.00	50.00	48.00	47.00	45.00	43.00	42.00	40.00	39.00	39.00	38.00	37.00	36.00	35.00	35.00	34.00	33.00
50.00	64.00	62.00	60.00	58.00	56.00	54.00	52.00	50.00	49.00	48.00	47.00	46.00	45.00	44.00	43.00	42.00	41.00
63.00	81.00	78.00	76.00	73.00	71.00	68.00	66.00	63.00	62.00	61.00	60.00	58.00	57.00	56.00	55.00	53.00	52.00

Corrected values of the rated current dependent on the ambient temperature

Influence of the mains system frequency on the tripping behavior IMA of the instantaneous release

Influence of the Mains Frequency							
Mains Frequency f (Hz)	16 2/3	50	60	100	200	300	400
I _{MA} (f) I _{MA} (50Hz) [%]	91	100	101	106	115	134	141

Load Carrying Capacity of Adjoining Supplementary Protectors

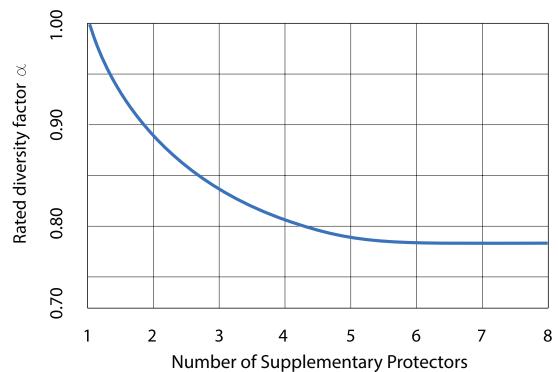

www.automationdirect.com

1-800-633-0405 FAZ Series Technical Data

Characteristic Curves


Let-through energy I²t

Characteristic B and C

• The X axis shows the prospective short-circuit current levels.


• The Y axis indicates the actual let-through values at those prospective fault ratings for each FAZ device plotted.


As can be interpreted from the bend in the plotted curves, each device acts to limit the damaging let-through energy (and current) at those values of short-circuit current.

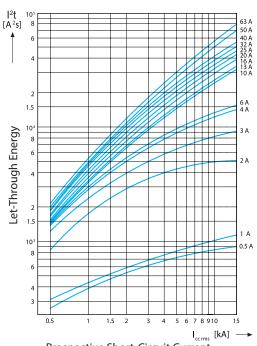


Prospective Short-Circuit Current

Let-through energy I²t Characteristic D

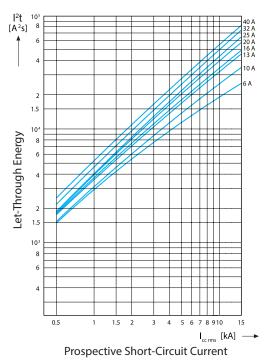

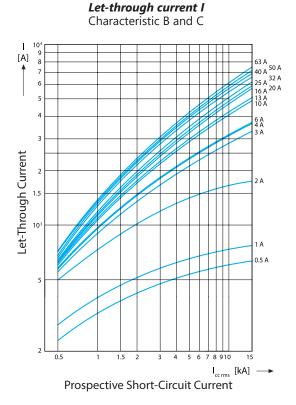


Let-through current I Characteristic D

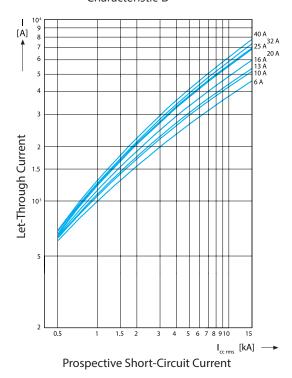

1-800-633-0405 For the lates


Time-current characteristic

Type B, C and D

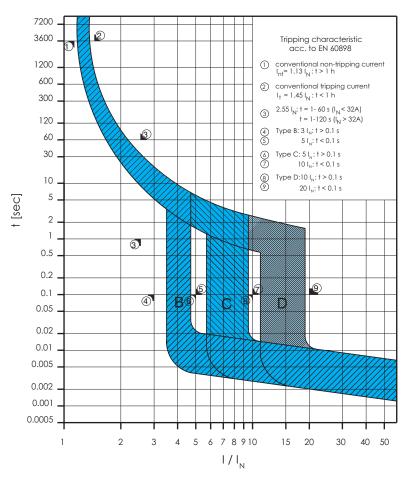

FAZ Supplementary Protector Dimensions

in [mm]

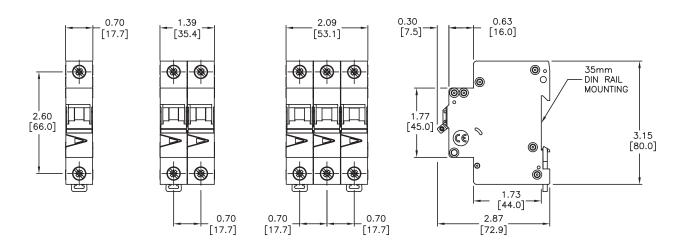

Please see our website www.AutomationDirect.com for complete engineering drawings. Dimensions are approximate. Not for construction purposes.

Field Mountable Accessories

- Auxiliary switch
- Alarm switch
- Shunt trip
- No tools required for mounting










FAZ-XAA-C12-110V FAZ-XAA-C110-415V Shunt Trip


	FAZ Series Auxiliary Contacts and Shunt Trip Release							
Part Number	Description	Contacts	Module Width	Module Weight	Price			
FAZ-XHIN11-SP	1 NO / 1 NC Installs on left side of FAZ or shunt trip Maximum one per FAZ (1077) device Switches when FAZ is tripped electrically or manually	(1) DPST	0.25 in					
FAZ-XAM002	Small selector screw changes mode Two form C (one set changeover) contacts Installs on left side of FAZ or shunt trip Auxilary contacts switch when FAZ is tripped electrically or manually Trip indicating contact switches only when FAZ is tripped electrically	(2) Form C Contacts SPDT	Contacts		\$35.00			
Part Number	Description	Trip Voltage	Module Width	Module Weight	Price			
FAZ-XAA-C110-415V	Allows remote trip of FAZ	110 – 415 VAC 110 – 230 VDC	0.69 in	0.28 lb	¢62.00			
FAZ-XAA-C12-110V	Installs on left side of FAZ	12 – 110 VAC 12 – 60 VDC	[17.5 mm]	[127g]	\$62.00			

	Auxiliary Contacts and Voltage Trips Technical Specifications							
Part Number	Circuit	Electrical Characteristics	Mechanical Characteristics		Size Stranded)	Tightening Torque		
	Diagram			mm²	AWG	N∙m	lb∙in	
FAZ-XHIN11-SP	5 13 21 5 14 22	Rated for general use 2A at 230/240 VAC 0.5 A at 110/120 VDC rated frequency 50/60 Hz	FAZ mounting, IP40 protection, IEC 536 protection against electric shock, lift terminals					
FAZ-XAM002	See FAZ-XAM002 diagrams on dimensions page	1 SPDT auxiliary contact and 1 SPDT alarm contact that can be configured and used as an auxiliary contact, rated for general use, 2A at 230/240 VAC, 0.5 A at 110/120 VDC, rated frequency 50/60 Hz	FAZ mounting, IP40 protection, IEC 536 protection against electric shock, lift terminals	0.5 - 2.5	18 - 14	0.8 - 1.0	7.1 - 9.0	
FAZ-XAA-C110-415V		110 - 415 VAC, 110 - 230 VDC operating range, max inrush current 2.1 A (AC) / 1A (DC), rated frequency 50/60 Hz	IEC/EN 30715 top-hat rail or DIN rail mounting, IP40 protection, IEC 536	1 - 2.5	18 - 12	2.4	21.2	
FAZ-XAA-C12-110V	 	12 - 110 VAC, 12 - 60 VDC operating range, maximum inrush current 15A (AC) / 21A (DC), rated frequency 50/60 Hz	protection against electric shock, twin-purpose terminals	1 - 2.5				

Allowable Combinations of Accessories



FAZ-XHIN11-SP FAZ-XAM002 FAZ Standard Auxilary Supplementary Auxilary Alarm Protector Switch



Auxilary

Auxilary Shunt Supplementary Alarm Trip Protector Switch

Circuit Protection

tCPR-108

FAT-N FAZ Series Accessories

Protective Accessories

-	FAZ Series Protective Accessories						
Part Number	Description	Quantity	Price				
<u>ZIS-SPE-1TE-3</u>	Lockout attachment for Eaton FAZ series supplementary protectors and FAZ mini circuit breakers, suitable to prevent unauthorized activation of a de-energized circuit, accepts lock shackles up to 9/32 in. (7.1 mm) in diameter	3 per pack	\$43.00				
<u>BBIP-5</u>	Busbar protection shroud, covers up to 5 unused terminals (break off unused pieces to size), for use	10 per pack	\$69.00				
<u>BBIP-5-5</u>	with Eaton BBUL series busbar.	5 per pack	\$42.00				






Busbar System Without auxiliary contacts


BBUL Series Busbars for use with FAZ Series Supplementary Protectors Description Rated Operational Current Qty Price BBUL25-1P-1M57-SP Busbar, 1 pole, 57-position, 480VAC \$58.00 1 100A. BBUL25-2P-2M56-SP Busbar, 2 pole, 56-position, 480VAC \$107.00 1 fed from end BBUL25-3P-3M57-SP Busbar, 3 pole, 57-position, 480VAC 1 \$162.00


	Busbar Accessories						
	Description	Qty	Price				
BBUL-EC-1	Ducker and sour farmer with 4 rate Ester DDU series husbar	10	\$15.50				
BBUL-EC-1-2	Busbar end cover for use with 1-pole Eaton BBUL series busbar.	2	\$6.25				
BBUL-EC-3	Duches cover and for yes with 2 note and 2 note Foton DDUIL series hypher	10	\$24.00				
BBUL-EC-3-2	Busbar cover end for use with 2-pole and 3-pole Eaton BBUL series busbar.	2	\$6.25				
BBUL-TEPA-35-1	Busbar terminal lug, connects wiring to busbar system, for use with 1-pole Eaton BBUL	1	\$19.00				
BBUL-TEPA-35-3	series busbar, accepts 10AWG to 1/0 AWG copper wire, 115A, 1000V AC/DC.	3	\$52.00				
BBUL-TEP-35-1	Busbar terminal lug, connects wiring to busbar system, for use with 2-pole and 3-pole		\$19.00				
BBUL-TEP-35-3	Eaton BBUL series busbar, accepts 10AWG to 1/0 AWG copper wire, 115A, 1000V AC/DC.	3	\$52.00				

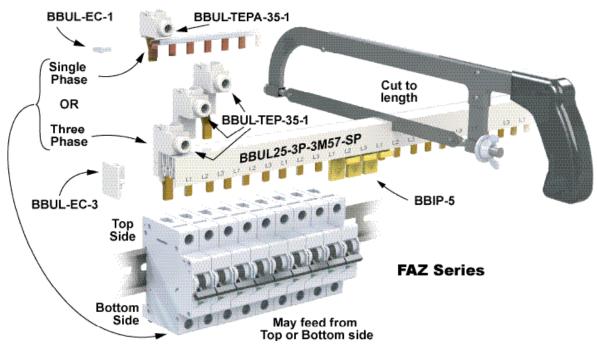



TAT-N FAZ Series Accessories


Accessories Dimensions

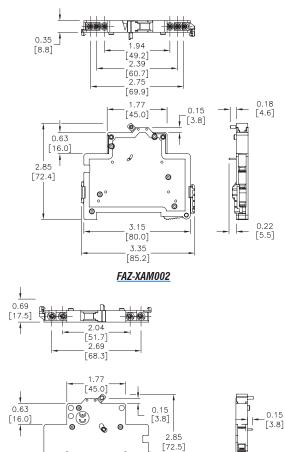

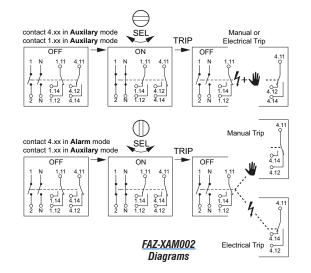







FAZ-XHIN11-SP

FAZ-XAA-C-xxx

FAZ Series Miniature Circuit Breakers Connection Diagrams

ര

0


3 15

[80.0]


3.35 [85.2]

Single Pole






2 4



0.48 [12.2]

Ī.

Busbar Connection Diagrams




Please see our website www.AutomationDirect.com for complete engineering drawings.

FAT-N FAZ Series Accessories

Accessories Dimensions

in [mm]

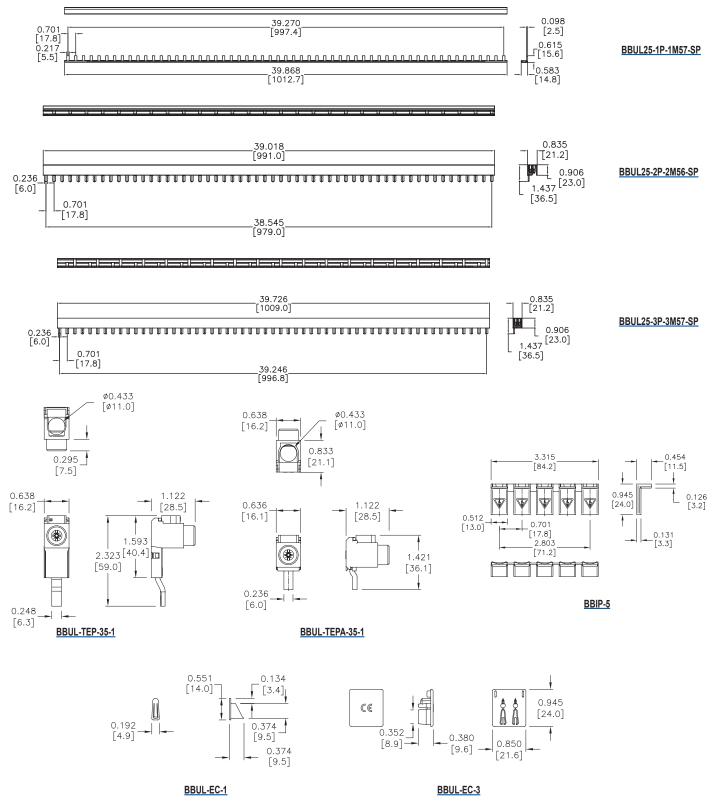

Please see our website <u>www.AutomationDirect.com</u> for complete engineering drawings.

1-800-633-0405 UL 489 or UL 1077? What are your Circuit Protection Requirements?

An understanding of circuit types and circuit protection products is critical to ensure their proper application. See NEC Sections 100, 430 and 409 for definitions.

The proper sizing of an overcurrent protection device is the responsibility of the customer and should be determined using the application standards of the NEC (National Electric Code), CEC (Canadian Electrical Code) or other

applicable standards. Per fine print note of 2008 NEC Section 100 "A current in excess of rating may be accommodated by certain equipment and conductors for a given set of conditions. Therefore, the rules for

overcurrent protection are specific for particular situations."

UL 489

Branch Protection





What You Need to Know and Look For In Specifications Certifications – Standards – Acceptance


UL 489 Branch Protection	UL 1077 Supplementary Protection				
 UL 489 Listed or Recognized CSA C22.2 No. 5 International ratings available depending on breaker type 	• UL Recognized under UL 1077 • CSA 22.2 No. 285 • IEC 60947-2 or IEC 898				
Fun	ction				
 Opens automatically on Overload and Short Circuit when properly applied within its ratings Protects wire and cable against Overload and Short Circuit 	 Opens automatically on Overload and Short Circuit Provides additional equipment protection where branch circuit protection is already provided or not required Not suitable for the protection of branch circuit conductors 				
Applications					
 Branch circuit protection in control panels, panelboards, switchboards and motor control centers Motor overload and motor short circuit protection (UL 489 Recognized motor circuit protectors) for control panels and motor control centers 	 Used within appliances or other electrical equipment such as control circuits, control power transformers, relays, PLC I/O points and lighting circuits Ideal replacement for fuses that are applied as supplementary protection 				
Fea	tures				
 Bolted down or DIN rail mounted External handle mechanisms available Field mounted accessories Stand alone branch circuit protection Various levels of protection (curve type) High voltage and interruption levels (up to 100 kAIC @ 480V) DIN rail mounted DIN rail mounted Field mounted accessories Various levels of protection (curve type) 10 kAIC @ 240 VAC 10 kAIC @ 277 VAC and 5 kAIC @ 480VAC 10 kAIC @ 48VDC 					
kAIC = thousands of A	Amps interrupt capacity				
Summary					

A Supplementary Protector can't be used for Branch Circuit Protection.

Understanding the difference between Branch Circuit Protection and Supplementary Protection helps to ensure their proper use.

Circuit Protection

UL 1077 Supplementary Protectors and UL 489 Circuit Breakers Application Guidelines

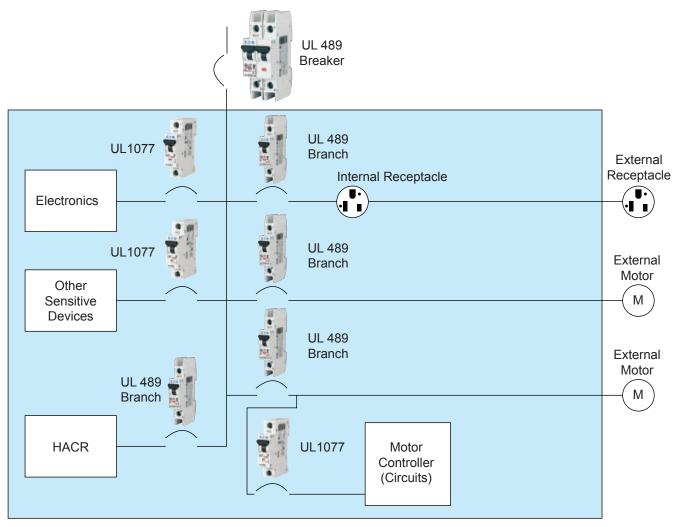

Example of UL 489 and UL 1077 Application

UL489 circuit breakers

Used for branch circuit protection, internal/external receptacles, external motors and HACR equipment (heating, air conditioning and refrigeration).

UL1077 supplementary protectors

Used for overcurrent protection within appliances or electrical equipment, where branch circuit protection is already provided or not required.

Note: UL489 devices can be used in place of UL1077; UL1077 devices cannot be used in place of UL489.