

Enclosure Fan Heaters

Enclosure Heater p/n [130921-16](#)

Applications

The compact high performance fan heater prevents formation of condensation and frost and provides evenly distributed interior air temperatures in enclosures with electronic components. The fan heater includes an integrated electronic thermostat with either an internal or external sensor. External sensors are sold separately in three cable length options. The external sensor can be positioned freely anywhere in the enclosure for precise measurements of temperature and humidity.

Features

- High DC heating performance
- Integrated adjustable thermostat
- Small hysteresis
- Integrated switch module
- Screw or DIN rail mount
- Optical indicator (LED)
- Hot air exhausts upward

Enclosure Heater p/n [130921-17](#)

General Specifications

Heating element	High performance cartridge
Overheat protection	Automatic reset and second-tier one shot fuse to protect against overheating in case of fan failure
Heater body	Extruded aluminum profile
Connection	2-pole Push-In connection clamp stranded wire ¹ AWG 16 [1.5 mm ²] with strain relief; max. AWG 12 [2.5 mm ²]
Axial fan, ball bearing	Service life 50,000 hr at +77°F (+25°C)
Air flow, free flowing	94 cfm (160m ³ /hr)
Housing	Plastic, UL 94V-0, black
Mounting	M5 screws and washers (not included), torque 2 N-m max.
Dimensions	3.9 x 5.7 x 6.5 in [100 x 145 x 166 mm]
Weight	Approx. 2.86 lbs. [1.3 kg]
Operating temperature	-4 to 167°F [-20 to 75°C]
Thermostat setting range	14 to 122°F
Thermostat switching difference	5.4°F at 77°F
Thermostat switching tolerance	1.8°F
Protection type	IP20
Approvals	CE, EAC, UL Recognized File No. E234324

Note: When connecting with stranded wires, wire end ferrules must be used.

Enclosure Fan Heaters

Part Number	Price	Operating Voltage	Heating Capacity	Temperature Sensor	Mounting Style	Drawing Link
030921-16	\$301.00	24 VDC	200W	internal	Foot	PDF
030921-17				external		PDF
030973-16	\$308.00	56 VDC	800W	internal	DIN rail/panel	PDF
130921-16	\$305.00	24 VDC	200W	internal		PDF
130921-17				external		PDF

External Temperature Sensors

Part Number	Price	Cable Length
267071	\$55.00	1m
267072	\$56.00	2m
267126	\$72.00	3m



Sensor p/n [267071](#)

Encloser Fan Heaters



Dimensions



Wiring Diagram

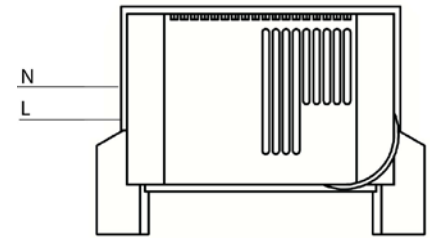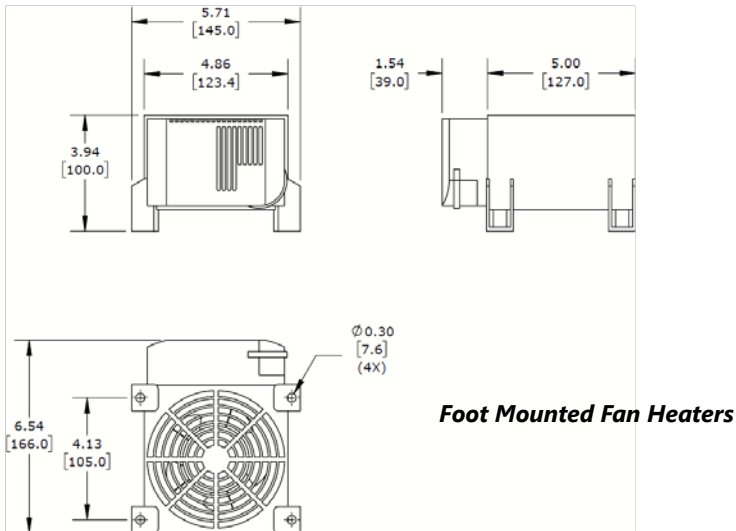

Note: When wiring 230 volt units for North American installations "L" (line) and "N" (neutral) will be used as "L1" (line1) "L2" (line2) respectively with no neutral connection.

Dimensions

Wiring Diagram

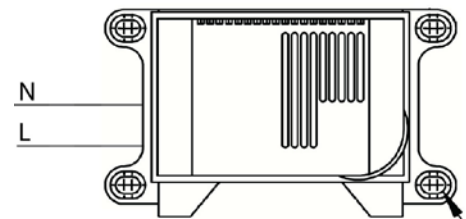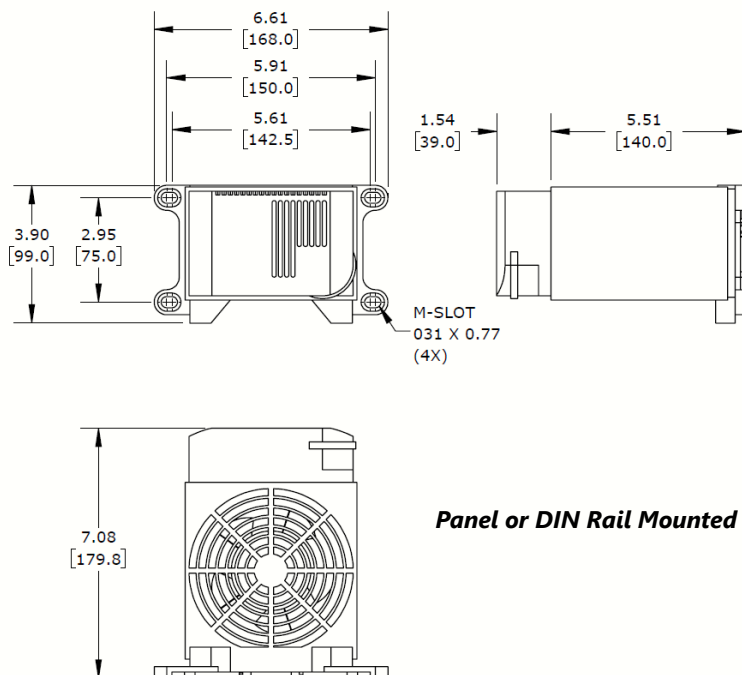

Note: When wiring 230 volt units for North American installations "L" (line) and "N" (neutral) will be used as "L1" (line1) "L2" (line2) respectively with no neutral connection.

Enclosure Heating and Heater Selection

Why Heat an Enclosure?

Today's miniaturization of enclosure components results in high packing densities, which in turn results in higher temperatures within the enclosure. These high temperatures are harmful to electronic components. In response, cooling systems have become standard in many applications. However, just as critical and widely underestimated, are failures caused by the formation of moisture.

Under certain climatic conditions, moisture can build up not only in outdoor or poorly insulated enclosures, but also in highly protected and well-sealed enclosures.

Moisture and Failure

Moisture, especially when combined with aggressive gases and dust, causes atmospheric corrosion and can result in the failure of components such as circuit breakers, busbars, relays, integrated circuit boards and transformers. The greatest danger lies in conditions where electronic equipment is exposed to relatively high air humidity or extreme variations in temperature, such as day-and-night operation or outdoor installation. Failure of components in such cases is usually caused by changing contact resistances, flashovers, creepage currents or reduced insulation properties.

Eliminate Moisture

Moisture and corrosion will remain low if relative air humidity stays below 60%. However, relative humidity above 65% will significantly increase moisture and corrosion problems. This can be prevented by keeping the environment inside an enclosure at a temperature as little as 9°F (5°C) higher than that of the ambient air. Constant temperatures are a necessity to guarantee optimal operating conditions. Continuous temperature changes not only create condensation but they reduce the life expectancy of electronic components significantly. Electronic components can be protected by cooling during the day and heating at night.

Thermal Management

Modern enclosure heaters are designed to protect against condensation. They heat the air inside enclosures, preventing water vapor from condensing on components while providing the greatest possible air circulation and low energy consumption.

Other heating element technology improvements include:

- Longer operating life
- Greater energy efficiencies
- Quick wiring options
- Easier mounting
- Fan heaters should be considered for larger enclosures to ensure that the entire enclosure is heated uniformly

Heater Location

Ideally, most heaters will perform optimally when mounted near the bottom of an enclosure and used in conjunction with a control device, thermostat, and/or hygostat. The control device may be a separate device, or it may be integral to the heater. With the controller located in an area of the cabinet that is representative of the average temperature or humidity requirement, the heater should then be placed in a position near the bottom of the enclosure. If a separate control device is used, the heater should not be located directly beneath the controller to ensure that the controller is not influenced by direct heat from the heater.

Heater Calculation

Follow Steps 1-5 to determine the heating requirement of an enclosure (US units - left column, metric - right)

STEP 1: Determine the Surface Area (A) of your enclosure which is exposed to open air.

Enclosure Dimensions:

height = _____ feet _____ meters

width = _____ feet _____ meters

depth = _____ feet _____ meters

Choose Mounting Option from next page, and calculate the surface area as indicated

A = _____ ft² or _____ m²

STEP 2: Choose the Heat Transmission Coefficient (k) for your enclosure's material of construction.

painted steel = 0.511 W/(ft²K) 5.5 W/(m²K)

stainless steel = 0.344 W/(ft²K) 3.7 W/(m²K)

aluminum = 1.115 W/(ft²K) 12 W/(m²K)

plastic or insulated stainless = 0.325 W/(ft²K) 3.5 W/(m²K)

k = _____ W/(ft²K) or _____ W/(m²K)

STEP 3: Determine the Temperature Differential (ΔT).

A. Desired enclosure interior temp. = ____°F ____°C

B. Lowest ambient (outside) temp. = ____°F ____°C

Subtract B from A = Temp. diff. (ΔT) = ____°F ____°C

For these calculations, ΔT must be in° Kelvin (K). Therefore, divide ΔT (°F) by 1.8. ΔT = _____ K

STEP 4: Determine Heating Power (PV), if any (generated from existing components, i.e. transformer).

PV = _____ W or _____ W

STEP 5: Calculate the Required Heating Power (PH) for your enclosure based on the above values.

If enclosure is located inside:


PH = (A x k x ΔT) - PV = _____ W

If enclosure is located outside:


PH = 2 x (A x k x ΔT) - PV = _____ W

Enclosure Mounting Types and Surface Area Calculations


1. Free-Standing

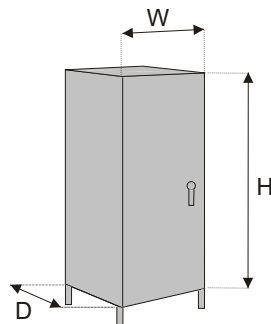

$$\text{Area (A)} = 1.8\text{ft}^2 [0.05\text{m}^2] (H \times W) + 1.8 (H \times D) + 1.8\text{ft}^2 [0.05\text{m}^2] (W \times D)$$

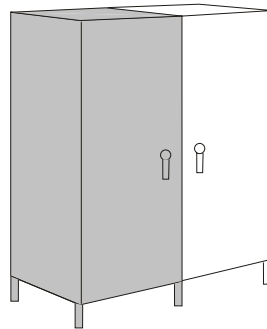


$$\text{Area (A)} = 1.8\text{ft}^2 [0.05\text{m}^2] (H \times W) + 1.4 (H \times D) + 1.8\text{ft}^2 [0.05\text{m}^2] (W \times D)$$

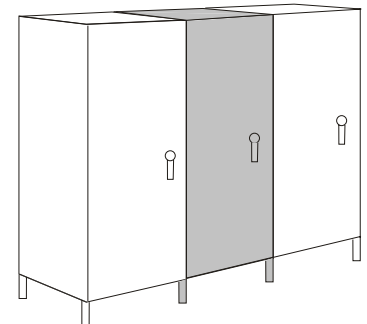


$$\text{Area (A)} = 1.8\text{ft}^2 [0.05\text{m}^2] (H \times W) + (H \times D) + 1.8\text{ft}^2 [0.05\text{m}^2] (W \times D)$$


2. Wall-Mounted

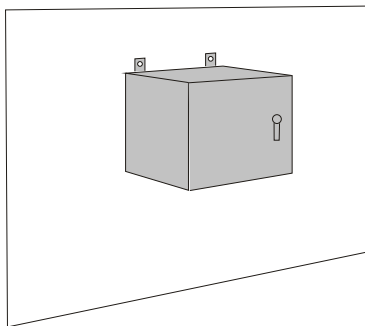

$$\text{Area (A)} = 1.4\text{ft}^2 [0.04\text{m}^2] (H \times W) + 1.8 (H \times D) + 1.8\text{ft}^2 [0.05\text{m}^2] (W \times D)$$

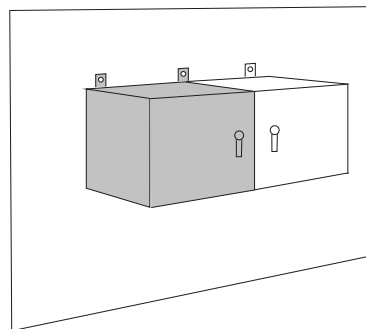


$$\text{Area (A)} = 1.4\text{ft}^2 [0.04\text{m}^2] (H \times W) + 1.4 (H \times D) + 1.8\text{ft}^2 [0.05\text{m}^2] (W \times D)$$

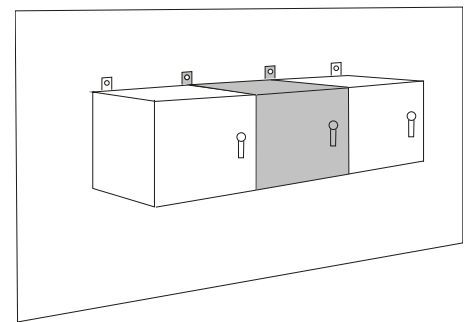


$$\text{Area (A)} = 1.4\text{ft}^2 [0.04\text{m}^2] (H \times W) + (H \times D) + 1.8\text{ft}^2 [0.05\text{m}^2] (W \times D)$$


3. Ground

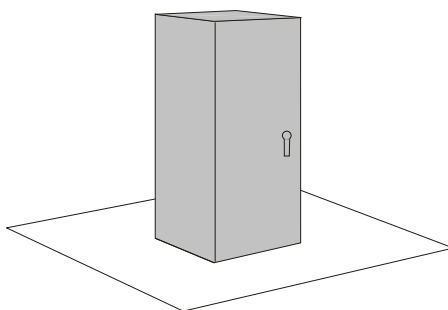

$$\text{Area (A)} = 1.8\text{ft}^2 [0.05\text{m}^2] (H \times W) + 1.8 (H \times D) + 1.4\text{ft}^2 [0.04\text{m}^2] (W \times D)$$

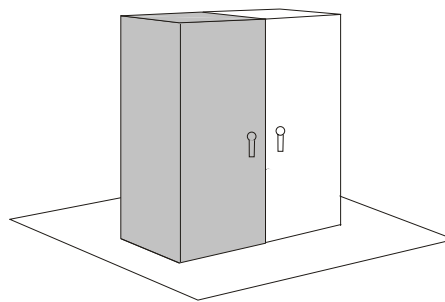


$$\text{Area (A)} = 1.8\text{ft}^2 [0.05\text{m}^2] (H \times W) + 1.4 (H \times D) + 1.4\text{ft}^2 [0.04\text{m}^2] (W \times D)$$

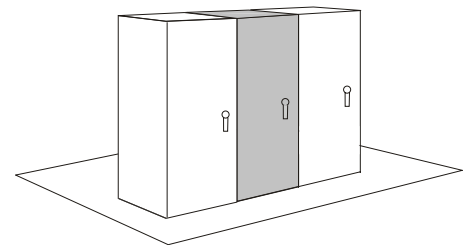


$$\text{Area (A)} = 1.8\text{ft}^2 [0.05\text{m}^2] (H \times W) + (H \times D) + 1.4\text{ft}^2 [0.04\text{m}^2] (W \times D)$$


4. Ground and Wall

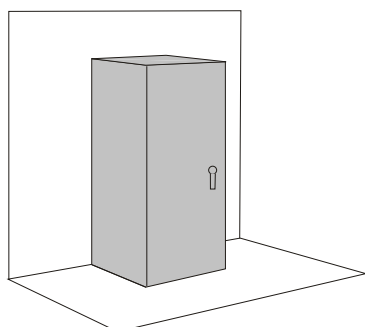

$$\text{Area (A)} = 1.4\text{ft}^2 [0.04\text{m}^2] (H \times W) + 1.8 (H \times D) + 1.4\text{ft}^2 [0.04\text{m}^2] (W \times D)$$

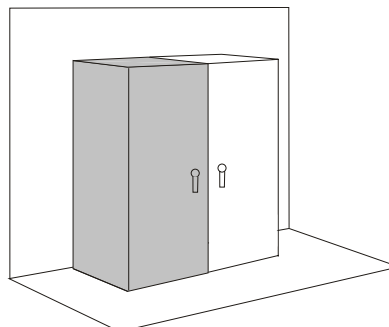

$$\text{Area (A)} = 1.4\text{ft}^2 [0.04\text{m}^2] (H \times W) + 1.4 (H \times D) + 1.4\text{ft}^2 [0.04\text{m}^2] (W \times D)$$

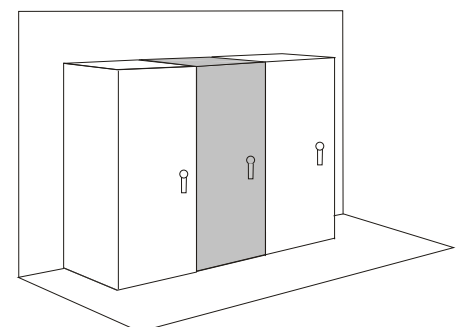

$$\text{Area (A)} = 1.4\text{ft}^2 [0.04\text{m}^2] (H \times W) + (H \times D) + 1.4\text{ft}^2 [0.04\text{m}^2] (W \times D)$$