



# PLC I/O Modules to ZIPLink Connector Modules – DL05/06



**Note:** In each table below select the length of cable as follows: (Blank) = 0.5 m, -1 = 1.0 m, -2 = 2.0 m.

DL05/06 PLC Input Module ZIPLink Selector				
PLC	ZIPLink			
Input Module	# of Terms	Component	Module Part No.	Cable Part No.
<a href="#">D0-10ND3</a>	13	Feedthrough	<a href="#">ZL-RTB20 (-1)</a>	<a href="#">ZL-D0-CBL13</a>
<a href="#">D0-10ND3F</a>				
<a href="#">D0-16ND3 †</a>	24	Feedthrough		<a href="#">ZL-D0-CBL24-L</a>
		Sensor	<a href="#">ZL-LTB16-24-1</a>	<a href="#">ZL-D0-CBL24-1L</a> <a href="#">ZL-D0-CBL24-2L</a>
<a href="#">F0-08NA-1</a>	10	Not supported by the ZIPLink wiring system.		

† Select the cable length: L = 0.5m, 1L = 1.0m, or 2L = 2.0m.

DL05/06 PLC Combo In/Out Module ZIPLink Selector				
PLC	ZIPLink			
Combo Module	# of Terms	Component	Module Part No.	Cable Part No.
<a href="#">D0-07CDR</a>	10	Not supported by the ZIPLink wiring system.		
<a href="#">D0-08CDD1</a>	13	Feedthrough	<a href="#">ZL-RTB20 (-1)</a>	<a href="#">ZL-D0-CBL13</a>

DL05/06 PLC Analog Module ZIPLink Selector				
PLC	ZIPLink			
Analog Module	# of Terms	Component	Module	Cable
<a href="#">F0-04AD-1</a>	8	These modules are not supported by the ZIPLink wiring system.		
<a href="#">F0-04AD-2</a>				
<a href="#">F0-08ADH-1</a>	13	Feedthrough	<a href="#">ZL-RTB20 (-1)</a>	<a href="#">ZL-D0-CBL13</a>
<a href="#">F0-08ADH-2</a>				
<a href="#">F0-04DAH-1</a>				
<a href="#">F0-08DAH-1</a>				
<a href="#">F0-04DAH-2</a>				
<a href="#">F0-08DAH-2</a>				
<a href="#">F0-2AD2DA-2</a>	8	These modules are not supported by the ZIPLink wiring system.		
<a href="#">F0-4AD2DA-1</a>				
<a href="#">F0-4AD2DA-2</a>				
<a href="#">F0-04RTD</a>	Matched Only	These modules are not supported by the ZIPLink wiring system.		
<a href="#">F0-04THM</a>				



**Note:** ZIPLink Connector Module specifications follow the Compatibility Matrix tables. ZIPLink Cables specifications are at the end of this ZIPLink section.

DL05/06 PLC Output Module ZIPLink Selector				
PLC	ZIPLink			
Output Module	# of Terms	Component	Module Part No.	Cable Part No.
<a href="#">D0-10TD1</a>	13	Feedthrough	<a href="#">ZL-RTB20 (-1)</a>	<a href="#">ZL-D0-CBL13</a>
<a href="#">D0-16TD1</a>	24	Feedthrough	<a href="#">ZL-RTB20 (-1)</a>	
		Fuse	<a href="#">ZL-RFU20 2</a>	<a href="#">ZL-D0-CBL24</a>
		Relay (sinking)	<a href="#">ZL-RRL16-24-1</a>	<a href="#">ZL-D0-CBL24-1</a>
			<a href="#">ZL-RRL16W-24-1</a> <a href="#">ZL-RRL16F-24-1</a>	<a href="#">ZL-D0-CBL24-2</a>
<a href="#">D0-10TD2</a>	13	Feedthrough	<a href="#">ZL-RTB20 (-1)</a>	<a href="#">ZL-D0-CBL13</a>
<a href="#">D0-16TD2</a>	24	Feedthrough	<a href="#">ZL-RTB20 (-1)</a>	
		Fuse	<a href="#">ZL-RFU20 2</a>	<a href="#">ZL-D0-CBL24</a>
		Relay (sourcing)	<a href="#">ZL-RRL16-24-2</a>	<a href="#">ZL-D0-CBL24-1</a>
			<a href="#">ZL-RRL16W-24-2</a> <a href="#">ZL-RRL16F-24-2</a>	<a href="#">ZL-D0-CBL24-2</a>
<a href="#">D0-08TR</a>	10	Not supported by the ZIPLink wiring system.		
<a href="#">F0-04TRS<sup>1</sup></a>	13	Feedthrough	<a href="#">ZL-RTB20 (-1)</a>	<a href="#">ZL-D0-CBL13</a>

DL05/06 PLC Fixed I/O ZIPLink Selector				
PLC	ZIPLink			
	# of Terms	Component	Module Part No.	Cable Part No.
<a href="#">DL05</a>	18	Not supported by the ZIPLink wiring system.		
<a href="#">DL06 **</a>	20 (Input side only)	Feedthrough	<a href="#">ZL-RTB20 (-1)</a>	<a href="#">ZL-D06X-CBL20</a>
	20 (Output side only)			<a href="#">ZL-D06Y-CBL20</a>

**All Tables Notes:**

\* Select the cable length by replacing the \* with: Blank = 0.5 m, -1 = 1.0 m, or -2 = 2.0 m.

\*\* Input side only connects X0 through X17. X20 thru X23 will have to be hand wired if used. Output side the power and auxiliary power terminals will have to be hand wired.

<sup>1</sup> Caution: The F0-04TRS relay outputs are derated not to exceed 2A per point when used with the ZIPLink wiring system.

<sup>2</sup> Note: Fuses (5 x 20 mm) are not included. See Edison Electronic Fuse section for (5 x 20 mm) fuse. S500 and GMA electronic circuit protection for fast-acting maximum protection. S506 and GMC electronic circuit protection for time-delay performance. Ideal for inductive circuits.

To ensure proper operation, do not exceed the voltage and current rating of ZIPLink module. [ZL-RFU20](#) = 2A per circuit; [ZL-RFU40](#) = 400mA per circuit.



# **ZIPLINK** Wiring Solutions

## Wiring Solutions using the ZIPLink Wiring System

**ZIPLinks** eliminate the normally tedious process of wiring between devices by utilizing pre-wired cables and DIN rail mount connector modules. It's as simple as plugging in a cable connector at either end or terminating wires at only one end. Pre-wired cables keep installation clean and efficient, using half the space at a fraction of the cost of standard terminal blocks. There are several wiring solutions available when using the **ZIPLink** System ranging from PLC I/O-to-**ZIPLink** Connector

Modules that are ready for field termination, options for connecting to third party devices, GS, DuraPulse and SureServo Drives, as well as special relay, transorb and communications modules. Pre-printed I/O-specific adhesive label strips for quick marking of **ZIPLink** modules are provided with **ZIPLink** cables. See the following solutions to help determine the best **ZIPLink** system for your application.

### **Solution 1: Do-more, DirectLOGIC, CLICK and Productivity Series I/O Modules to ZIPLink Connector Modules**

When looking for quick and easy I/O-to-field termination, a **ZIPLink** connector module used in conjunction with a prewired **ZIPLink** cable, consisting of an I/O terminal block at one end and a multi-pin connector at the other end, is the best solution.



Using the PLC I/O Modules to **ZIPLink** Connector Modules selector tables located in this section,

1. Locate your I/O module/PLC
2. Select a **ZIPLink** Module
3. Select a corresponding **ZIPLink** Cable.

### **Solution 2: Do-more, DirectLOGIC, CLICK and Productivity Series I/O Modules to 3rd Party Devices**

When wanting to connect I/O to another device within proximity of the I/O modules, no extra terminal blocks are necessary when using the **ZIPLink** Pigtail Cables. **ZIPLink** Pigtail Cables are prewired to an I/O terminal block with color-coded pigtail with soldered-tip wires on the other end.



Using the I/O Modules to 3rd Party Devices selector tables located in this section,

1. Locate your PLC I/O module
2. Select a **ZIPLink** Pigtail Cable that is compatible with your 3rd party device.

### **Solution 3: GS Series and DuraPulse Drives Communication Cables**

Need to communicate via Modbus RTU to a drive or a network of drives?

**ZIPLink** cables are available in a wide range of configurations for connecting to PLCs and SureServo, SureStep, Stellar Soft Starter and AC drives. Add a **ZIPLink** communications module to quickly and easily set up a multi-device network.

Using the Drives Communication selector tables located in this section,

1. Locate your Drive and type of communications
2. Select a **ZIPLink** cable and other associated hardware.



# ZIPLINK<sup>®</sup> Wiring Solutions

AUTOMATIONDIRECT<sup>®</sup>

## Solution 4: Serial Communications Cables

ZIPLink offers communications cables for use with DirectLOGIC, CLICK, and Productivity CPUs, that can also be used with other communications devices. Connections include a 6-pin RJ12 or 9-pin, 15-pin and 25-pin D-sub connectors which can be used in conjunction with the RJ12 or D-Sub feedthrough modules.

Using the Serial Communications Cables selector table located in this section,

1. Locate your connector type
2. Select a cable.



## Solution 5: Specialty ZIPLink Modules

For additional application solutions, ZIPLink modules are available in a variety of configurations including stand-alone relays, 24VDC and 120VAC transorb modules, D-sub, RJ12 and RJ45 feedthrough modules, communication port adapter and distribution modules, and SureServo 50-pin I/O interface connection.

Using the ZIPLink Specialty Modules selector table located in this section,

1. Locate the type of application
2. Select a ZIPLink module.



## Solution 6: ZIPLink Connector Modules to 3rd Party Devices

If you need a way to connect your device to terminal blocks without all that wiring time, then our pigtail cables with color coded soldered tip wires are a good solution. Used in conjunction with any compatible ZIPLink Connector Modules, a pigtail cable keeps wiring clean and easy and reduces troubleshooting time.

Using the Universal Connector Modules and Pigtail Cables table located in this section,

1. Select module type
2. Select the number of pins
3. Select cable.






# PLC I/O to 3rd Party Devices

PLC I/O to 3rd Party Devices ZIPLink Cable Selector				
PLC		ZIPLink		
PLC Family	# of Terms	Number of Wires	Pigtail Cable Part No. †	Length
<b>BRX MPUs</b>	15	18	<a href="#">ZL-BX-CBL15-1P</a> or -2P	"-1P" = 1 meter, "-2P" = 2 meters
	20	24	<a href="#">ZL-BX-CBL20-1P</a> or -2P	
<b>BRX Expansion Modules</b>	10	24	<a href="#">ZL-BXEM-CBL10-1P</a> or -2P	
	15	18	<a href="#">ZL-BXEM-CBL15-1P</a> or -2P	
	20	24	<a href="#">ZL-BXEM-CBL20-1P</a> or -2P	
<b>CLICK I/O Modules</b>	11	11	<a href="#">ZL-C0-CBL11-1P</a>	
	20	20	<a href="#">ZL-C0-CBL20-1P</a>	
<b>DL05 PLC Fixed I/O</b>	22	22	<a href="#">ZL-D05-CBL22-1P</a>	
<b>DL06 PLC Fixed I/O</b>	24	24	<a href="#">ZL-D06-CBL24-1P</a>	
<b>DL05 &amp; DL06 I/O Modules</b>	8	8	<a href="#">ZL-D0-CBL8-1P</a>	
	10	10	<a href="#">ZL-D0-CBL10-1P</a>	
	13	13	<a href="#">ZL-D0-CBL13-1P</a>	
	24	24	<a href="#">ZL-D0-CBL24-1P</a> or -2P	
<b>DL205 I/O Modules †</b>	10	10	<a href="#">ZL-D0-CBL10-1P</a> or -2P	
	19	19	<a href="#">ZL-D2-CBL19-1P</a> or -2P	
	40	40	<a href="#">ZL-D24-CBL40-1P</a> or -2P	
			<a href="#">ZL-D24-CBL40-1XP</a> or -2XP	
<b>DL405 I/O Modules †</b>	40	40	<a href="#">ZL-D24-CBL40-1XP</a> or -2XP	
			<a href="#">ZL-D24-CBL40-1P</a> or -2P	
<b>Productivity®1000 I/O Modules</b>	10	20	<a href="#">ZL-P1-CBL10-1P</a> or -2P	
	18	20	<a href="#">ZL-P1-CBL18-1P</a> or -2P	
<b>Productivity®2000 I/O Modules</b>	20	20	<a href="#">ZL-P2-CBL18-1P</a> or -2P	
	24	24	<a href="#">ZL-P2-CBL24-1P</a> or -2P	
	40	40	<a href="#">ZL-P3-CBL40-1P</a> or -2P	
<b>Productivity3000® I/O Modules</b>	20	20	<a href="#">ZL-P3-CBL20-1P</a> or -2P	
	40	40	<a href="#">ZL-P3-CBL40-1P</a> or -2P	

† X = 45° cable connector, all other cables have 180° cable connector

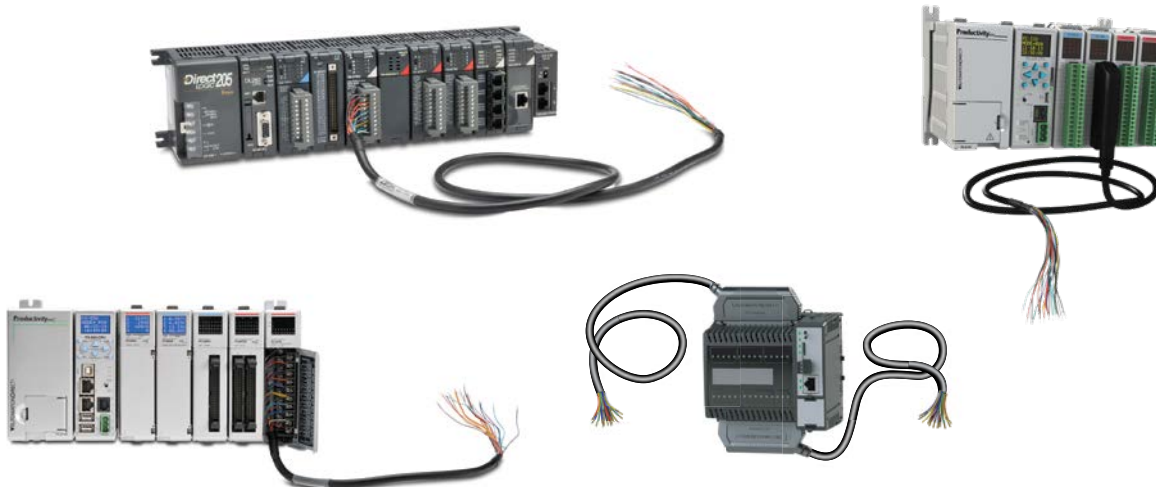



# Motor Controller Communication

Drive / Motor Controller (GS/DuraPulse/SureServo/SureStep/Stellar) ZIPLink Selector									
Drive / Motor Controller		Communications			ZIPLink Cable				
Controller	Comm Port Type	Network/Protocol	Connects to	Comm Port Type	Cable (2 meter length)	Cable Connectors	Other Hardware Required		
<b>GS1</b>	RJ12	RS-485 Modbus RTU	BRX MPUs	RS-485, 3-Pin	<a href="#">ZL-RJ12-CBL-2P</a>	RJ12 to pigtail	N/A		
			<a href="#">P2-550</a>						
			<a href="#">P3-530</a>						
			<a href="#">P3-550</a>						
			<a href="#">P3-550E</a>						
			<a href="#">P2-SCM</a>	RS-485, 4-Pin					
			<a href="#">P3-SCM</a>						
			DL06 PLCs	Port 2 (HD15)				<a href="#">GS-485HD15-CBL-2</a>	RJ12 to HD15
			D2-262 CPU	RJ12				<a href="#">GS-EDRV-CBL-2</a>	RJ12 to RJ12
			<a href="#">GS-EDRV100</a>	RJ12				<a href="#">GS-485RJ12-CBL-2</a>	
ZL-CDM-RJ12Xxx *	RJ12	<a href="#">GS-ISOCON-CBL-2</a>	RJ12 to 5-pin plug						
<a href="#">FA-ISOCON</a>	5-pin Connector	<a href="#">GS-ISOCON-CBL-2</a>							
<b>GS2</b>	RJ12	RS-232 Modbus RTU	BRX MPUs	RS-232/485, 3-Pin	<a href="#">ZL-RJ12-CBL-2P</a>	RJ12 to pigtail	N/A		
			<a href="#">P2-550</a>	RS-485, 4-Pin					
			<a href="#">P3-530</a>						
			<a href="#">P3-550</a>						
			<a href="#">P3-550E</a>						
			<a href="#">P2-SCM</a>	Ports 1, 2 & 3					
			<a href="#">P3-SCM</a>	Ports 1 to 4					
			CLICK PLCs	Port 2 (RJ12)				<a href="#">GS-RJ12-CBL-2</a>	RJ12 to RJ12
			DL05 PLCs						
			DL06 PLCs	Port 2 (HD15)					
		D2-262 CPU							
		D4-454 CPU	Port 3 (25-pin)	<a href="#">FA-CABKIT</a>					
		RS-485 Modbus RTU	BRX MPUs	RS-232/485, 3-Pin	<a href="#">ZL-RJ12-CBL-2P</a>	RJ12 to pigtail	N/A		
			<a href="#">P2-550</a>	RS-485, 3-Pin					
			<a href="#">P3-530</a>						
			<a href="#">P3-550</a>						
			<a href="#">P3-550E</a>						
			<a href="#">P2-SCM</a>	RS-485, 4-Pin					
			<a href="#">P3-SCM</a>						
			DL06 PLCs	Port 2 (HD15)				<a href="#">GS-485HD15-CBL-2</a>	RJ12 to HD15
D2-262 CPU									
<a href="#">GS-EDRV100</a>	RJ12		<a href="#">GS-EDRV-CBL-2</a>	RJ12 to RJ12					
ZL-CDM-RJ12Xxx *	RJ12	<a href="#">GS-485RJ12-CBL-2</a>							
<a href="#">FA-ISOCON</a>	5-pin Connector	<a href="#">GS-ISOCON-CBL-2</a>	RJ12 to 5-pin plug						
<b>Stellar (Soft Starter) SR44 Series</b>	RJ45 **	RS-485 Modbus RTU	DL06 PLCs	Port 2 (HD15)	<a href="#">SR44-485HD15-CBL-2</a>	RJ45 to HD15	<a href="#">SR44-RS485</a>		
			D2-262 CPU						
			ZL-CDM-RJ12Xxx *	RJ12				<a href="#">SR44-485RJ45-CBL-2</a>	RJ45 to RJ12

\* When using the ZL-CDM-RJ12Xxx ZIPLink Communication Distribution Module, replace the lowercase xx with the number of RJ12 ports, i.e. 4 for four ports or 10 for ten ports. (ex: ZL-CDM-RJ12X4 or ZL-CDM-RJ12X10)  
 \*\* The [SR44-RS485](#) Communications Adapter must be installed for RS-485 communications with the Stellar soft starters.



# Motor Controller Communication

Drive / Motor Controller (GS/DuraPulse/SureServo/SureStep/Stellar) ZIPLink Selector								
Drive / Motor Controller		Communications			ZIPLink Cable			
Controller	Comm Port Type	Network/Protocol	Connects to	Comm Port Type	Cable (2 meter length)	Cable Connectors	Other Hardware Required	
<b>DuraPulse (GS3)</b>	RJ12	RS-485 Modbus RTU	BRX MPUs	RS-485, 3-Pin	<a href="#">ZL-RJ12-CBL-2P</a>	RJ12 to pigtail	N/A	
			<a href="#">P2-550</a>	RS-485, 3-Pin				
			<a href="#">P3-530</a>					
			<a href="#">P3-550</a>					
			<a href="#">P3-550E</a>	RS-485, 4-Pin				
			<a href="#">P2-SCM</a>					
			<a href="#">P3-SCM</a>	Port 2 (HD15)	<a href="#">GS-485HD15-CBL-2</a>	RJ12 to HD15		
			DL06 PLCs		RJ12	<a href="#">GS-EDRV-CBL-2</a>		RJ12 to RJ12
			D2-262 CPU	<a href="#">GS-485RJ12-CBL-2</a>				
			GS-EDRV100	5-pin Connector	<a href="#">GS-ISOCON-CBL-2</a>	RJ12 to 5-pin plug		
ZL-CDM-RJ12Xxx *								
<b>SureServo</b>	IEEE1394 (CN3)	RS-232 Modbus RTU	CLICK PLCs	Port 2 (RJ12)	<a href="#">SVC-232RJ12-CBL-2</a>	6-pin IEEE to RJ12	N/A	
			DL05 PLCs	Port 2 (HD15)				
			DL06 PLCs					
			D2-262 CPU					
			<a href="#">P2-550</a>		RS232	<a href="#">SVC-232RJ12-CBL-2</a>	6-pin IEEE to RJ12	N/A
			<a href="#">P3-530</a>					
			<a href="#">P3-550</a>					
			<a href="#">P3-550E</a>					
		<a href="#">P2-SCM</a>	Ports 1, 2 & 3					
		<a href="#">P3-SCM</a>						
		DL06 PLCs	Port 2 (HD15)	<a href="#">SVC-485HD15-CBL-2</a>	6-pin IEEE to HD15			
		D2-262 CPU		RJ12	<a href="#">SVC-485RJ12-CBL-2</a>	6-pin IEEE to RJ12		
		ZL-CDM-RJ12Xxx *	<a href="#">SVC-485CFG-CBL-2</a>		6-pin IEEE to RJ45			
		USB-485M	RJ45					
<b>SureStep</b>	RJ12	RS-232 ASCII	BRX MPUs	3-Pin	<a href="#">ZL-RJ12-CBL-2P</a>	RJ12 to pigtail	N/A	
			<a href="#">P2-550</a>	RS-485, 3-Pin				
			<a href="#">P3-530</a>					
			<a href="#">P3-550</a>					
			<a href="#">P3-550E</a>	RS-485, 4-Pin				
			<a href="#">P2-SCM</a>					
			<a href="#">P3-SCM</a>	Port 2 (HD15)	<a href="#">STP-232HD15-CBL-2</a>	HD15-pin to RJ12		
			DL06 PLCs		RJ12	<a href="#">STP-232RJ12-CBL-2</a>		RJ12 to RJ12
			D2-262 CPU (Port2)					
			DL05 PLCs					
CLICK PLCs								

\* When using the ZL-CDM-RJ12Xxx ZIPLink Communication Distribution Module, replace the lowercase xx with the number of RJ12 ports, i.e. 4 for four ports or 10 for ten ports. (ex: ZL-CDM-RJ12X4or ZL-CDM-RJ12X10)  
 \*\* The SR44-RS485 Communications Adapter must be installed for RS-485 communications with the Stellar soft starters.

# ZIPLINK<sup>®</sup> Serial Communication

AUTOMATIONDIRECT<sup>®</sup>


<b>ZIPLink Serial Communication Cable Selector</b>					
<b>PLC</b>			<b>ZIPLink</b>		
<b>PLCs and Comm Modules</b>	<b>Port No.</b>	<b>Comm Port Type</b>	<b>Cable Connector Type</b>	<b>Cable Part No. (2 meter length)</b>	<b>D-Sub and RJ12 Feedthrough Module Part No. (optional)</b>
<b>BRX MPUs</b>	RS232	POM (RJ12)	6-pin RJ12 to RJ12 Crossover	<a href="#">ZL-RJ12-CBL-2</a>	<a href="#">ZL-RTB-RJ12</a>
<b>CLICK (Basic, Standard and Analog)</b>	1	RJ12			
	2				
<b>CLICK Ethernet (Basic, Standard)</b>	2				
<b>DL05</b>	1				
	2				
<b>DL06</b>	1				
<b>D0-DCM</b>	1				
<b>D2-262</b>	1				
<b>D2-DCM</b>	1		25-pin D-sub, Female	25-pin Male D-sub to Female D-sub	<a href="#">ZL-DB25-CBL-2</a>
<b>D3-DCM</b>	1	25-pin D-sub, Female	25-pin Male D-sub to Female D-sub	<a href="#">ZL-DB25-CBL-2</a>	<a href="#">ZL-RTB-DB25</a>
<b>D4-454</b>	0	15-pin D-sub, Female	15-pin Male D-sub to Female D-sub	<a href="#">ZL-DB15-CBL-2</a>	<a href="#">ZL-RTB-DB15</a>
	1 & 3	25-pin D-sub, Female	25-pin Male D-sub to Female D-sub	<a href="#">ZL-DB25-CBL-2</a>	<a href="#">ZL-RTB-DB25</a>
	2	RJ12	6-pin RJ12 to RJ12 Crossover	<a href="#">ZL-RJ12-CBL-2</a>	<a href="#">ZL-RTB-RJ12</a>
<b>D4-DCM</b>	1	25-pin D-sub, Female	25-pin Male D-sub to Female D-sub	<a href="#">ZL-DB25-CBL-2</a>	<a href="#">ZL-RTB-DB25</a>
<b>P1-540</b>	RS232	RJ12	6-pin RJ12 to RJ12 Crossover	<a href="#">ZL-RJ12-CBL-2</a>	<a href="#">ZL-RTB-RJ12</a>
<b>P2-550</b>					
<b>P3-530</b>					
<b>P3-550</b>					



# Specialty Modules

ZIPLink Specialty Modules Selector			
ZIPLink			
Module	Type	Module Part No.	Cable Part No. (optional)
<b>24VDC Stand-Alone Relay</b>	Single-Socket Relay	<a href="#">ZL-RLS1-24</a>	N/A
	Four Socket-Relay	<a href="#">ZL-RLS4-24</a>	
<b>120VAC Stand-Alone Relay</b>	Single-Socket Relay	<a href="#">ZL-RLS1-120</a>	
	Four-Socket Relay	<a href="#">ZL-RLS4-120</a>	
<b>250V AC/DC Max.</b>	16-point, Fused Block	<a href="#">ZL-FUSE-16</a>	
<b>24VDC Transorb</b>	8-Channel	<a href="#">ZL-TSD8-24</a>	
<b>120VAC Transorb</b>	8-Channel	<a href="#">ZL-TSD8-120</a>	
<b>240V AC/DC Max.</b>	40-Point Power/Common	<a href="#">ZL-RTB-COM</a>	
<b>D-Sub Feedthrough</b>	9-pin Male & Female D-Subs to Terminal Blocks	<a href="#">ZL-RTB-DB09</a>	<a href="#">ZL-DB9-CBL-2</a>
	15-pin Male & Female D-Subs to Terminal Blocks	<a href="#">ZL-RTB-DB15</a>	<a href="#">ZL-DB15-CBL-2</a>
	25-pin Male & Female D-Subs to Terminal Blocks	<a href="#">ZL-RTB-DB25</a>	<a href="#">ZL-DB25-CBL-2</a>
<b>RJ12 Feedthrough</b>	6-pin RJ12 to Terminal Block	<a href="#">ZL-RTB-RJ12</a>	<a href="#">ZL-RJ12-CBL-2</a>
<b>RJ45 Feedthrough</b>	8-pin RJ45 to Terminal Block	<a href="#">ZL-RTB-RJ45</a>	N/A
<b>Comm Port Adapters</b>	15-pin HD D-Sub to Terminal Block	<a href="#">ZL-CMA15</a>	
	15-pin HD D-Sub to Terminal Block with LED Indicators	<a href="#">ZL-CMA15L</a>	
<b>Comm Distribution</b>	4-Port RJ12 to Terminal Block	<a href="#">ZL-CDM-RJ12X4</a>	
	10-Port RJ12 to Terminal Block	<a href="#">ZL-CDM-RJ12X10</a>	
<b>Feedthrough Module (SureServo I/O)</b>	50-pin to Terminal Blocks	<a href="#">ZL-RTB50</a>	<a href="#">ZL-SVC-50CBL *</a>

\* Select the cable length by replacing the \* with: Blank = 0.5m, -1 = 1.0m, or -2 = 2.0m

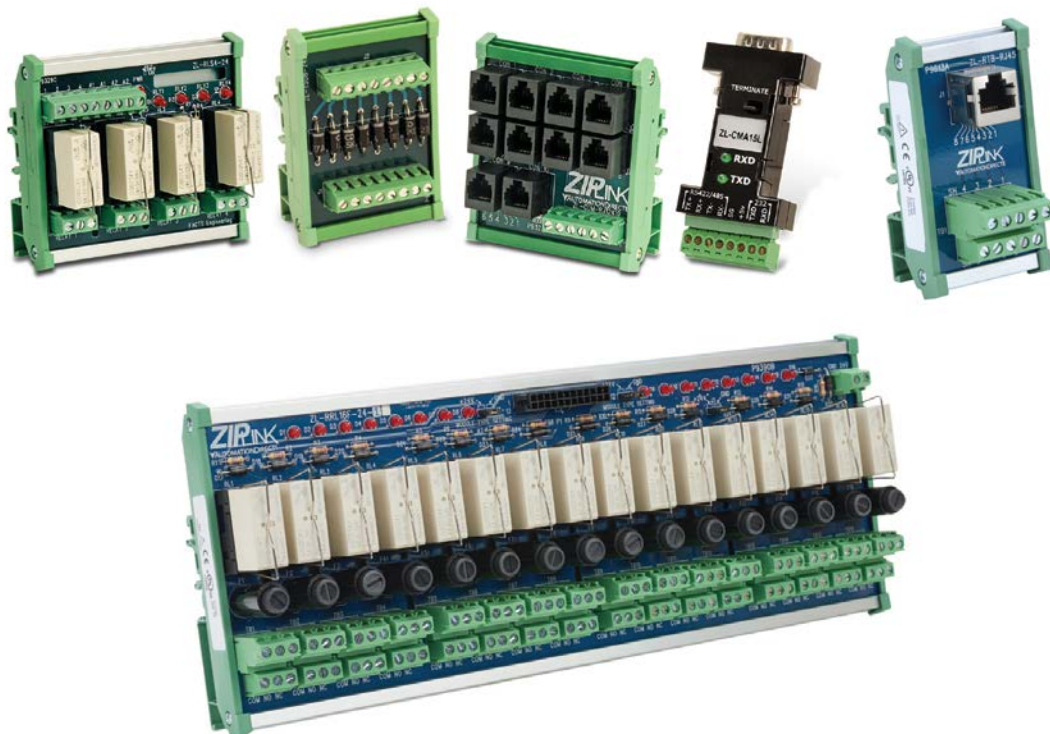





# Connector Modules to 3rd Party Devices

ZIPLink Connector Modules to 3rd Party Devices Selector			
ZIPLink			
Module	Type	Module Part No.	Pigtail Cable Part No. (optional)
<b>Feedthrough Connector</b>	24-pin to Terminal Blocks	<a href="#">ZL-RTB20</a> <a href="#">ZL-RTB20-1</a>	<a href="#">ZL-CBL24-1P</a> <a href="#">ZL-CBL24-2P</a>
	40-pin to Terminal Blocks	<a href="#">ZL-RTB40</a> <a href="#">ZL-RTB40-1</a>	<a href="#">ZL-CBL40-1P</a> <a href="#">ZL-CBL40-2P</a>
	50-pin to Terminal Blocks	<a href="#">ZL-RTB50</a>	<a href="#">ZL-CBL50-1P</a> <a href="#">ZL-CBL50-2P</a>
<b>Fuse</b>	16-Fuse, 24-pin	<a href="#">ZL-RFU20</a>	<a href="#">ZL-CBL24-1P</a> <a href="#">ZL-CBL24-2P</a>
	32-Fuse, 40-pin	<a href="#">ZL-RFU40</a>	<a href="#">ZL-CBL40-1P</a> <a href="#">ZL-CBL40-2P</a>
<b>24VDC Powered Relay</b>	16-Relay, Sinking, 24-pin	<a href="#">ZL-RRL16-24-1</a> <a href="#">ZL-RRL16F-24-1</a> <a href="#">ZL-RRL16W-24-1</a>	<a href="#">ZL-CBL24-1P</a> <a href="#">ZL-CBL24-2P</a>
	16-Relay, Sourcing, 24-pin	<a href="#">ZL-RRL16-24-2</a> <a href="#">ZL-RRL16F-24-2</a> <a href="#">ZL-RRL16W-24-2</a>	<a href="#">ZL-CBL24-1P</a> <a href="#">ZL-CBL24-2P</a>
<b>Sensor Input</b>	16-Point with LEDs	<a href="#">ZL-LTB16-24-1</a>	<a href="#">ZL-CBL24-1P</a> <a href="#">ZL-CBL24-2P</a>
	32-Point with LEDs	<a href="#">ZL-LTB32-24-1</a>	<a href="#">ZL-CBL40-1P</a> <a href="#">ZL-CBL40-2P</a>
<b>D-Sub Feedthrough</b>	9-pin D-Sub to Terminal Block	<a href="#">ZL-RTB-DB09</a>	<a href="#">ZL-DB9F-CBL-2P</a>
			<a href="#">ZL-DB9F-CBL-5P</a>

