Modbus RTU Slave

T1K-MODBUS \$375.00



The Terminator I/O Modbus network interface module allows you to connect I/O as a slave station on a Modbus RTU network. The T1K-MODBUS can communicate with any Modbus RTU network master using high-level Modbus commands.

DirectLogic Modbus communications


Some of our DirectLogic PLCs can be used as Modbus masters, directly through a communication port on the CPU. (Consult the PLC section of this catalog for more information.)

Network configuration options

You can configure a simple point-to-point network or create a multidrop network using the RS-232, RS-422/485 HD-15 Modbus port. The T1K-MODBUS has two rotary switches that can be set to designate the module's slave address. Set the rotary switches to give each slave a unique address in a range from 1-F7 hex (1-247 decimal). The T1K-MODBUS also has an auxiliary RJ12 RS-232 serial port that can be used to configure the Modbus port with the T1K-MODBUS Setup Tool.

Asynchronous communications

In most applications, the Modbus master polls the slaves individually (T1K-MODBUS) to read/write each slave's I/O. The communication between the Modbus master and slave will often be asynchronous to the master CPU scan. For this reason, applications should be limited to those that do not require the I/O points to update every master CPU scan.

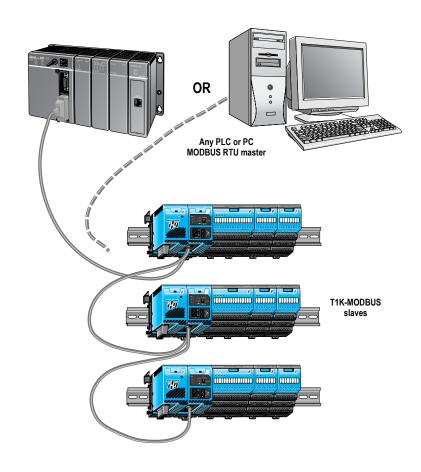

Specifications				
Modbus	Cable Lengths and Baud Rates	RS-232	15m (50ft.): 300, 600, 1200, 2400, 4800, 9600; 19.2 K, 38.4 K baud	
Port		RS-422/485	1000m (3300ft): 300, 600, 1200, 2400, 4800, 9600; 19.2 K, 38.4 K baud	
Max. I/O Points per Controller		troller	Discrete: inputs: 1024, outputs: 1024; Analog: inputs: 64 channels, outputs: 64 channels	
Recommended Cable			Belden 9729 or equivalent (RS-422)	
Terminal Type			15-pin female high-density (VGA style) D-sub connector	
RJ12 Serial Port			RS-232; 9600/19200 baud; supports K-Sequence and ASCII (Use to configure Modbus port using T1K-MODBUS setup tool)	
Base Power Requirement		nt	250mA @ 5VDC	

Dimensions and Installation

It is important to understand the installation requirements for your Terminator I/O system. This will ensure that the Terminator I/O products work within their environmental and electrical limits


Plan for safety

This catalog should never be used as a replacement for the technical data sheet that comes with the products or the ITK-INST-M Installation and I/O Manual (available online at


www.automationdirect.com.) The technical data sheet contains information that must be followed. The system installation should comply with all appropriate electrical codes and standards.

Unit dimensions and mounting orientation

Use the following diagrams to decide if the Terminator I/O system can be installed in your application. Terminator I/O units should be mounted horizontally. To ensure proper airflow for cooling purposes, units should not be mounted upside-down. It is important to check the Terminator I/O dimensions against the conditions required for your application. For example, it is recommended to leave 2" depth for ease of access and cable clearance. However, your distance may be greater or less. Also, check the installation guidelines for the recommended cabinet clearances.

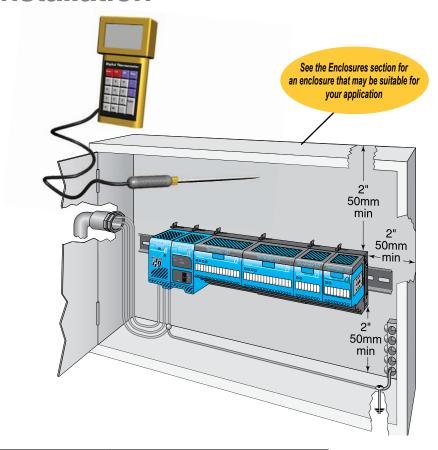

Terminator I/O Environmental Specifications				
Ambient Operating Temperature	32°F to 131°F (0°C to 55°C)			
Storage Temperature	-4°F to 158°F (-20°C to 70°C)			
Ambient Humidity	5% to 95% (Non-condensing)			
Atmosphere	No corrosive gases. The level of environmental pollution = 2 (UL 840)			
Vibration Resistance	MIL STD 810C, Method 514.2			
Shock Resistance	MIL STD 810C, Method 516.2			
Voltage Withstand (Dielectric)	1500VAC, 1 minute			
Insulation Resistance	500 VDC, 10 Mq			
Noise Immunity	NEMA ICS3-304 Impulse noise 1µs, 1000V FCC class A RFI (144MHz, 430MHz 10W, 10cm)			
Agency Approvals UL, CE, FCC class A, NEC Class 1 Division 2				

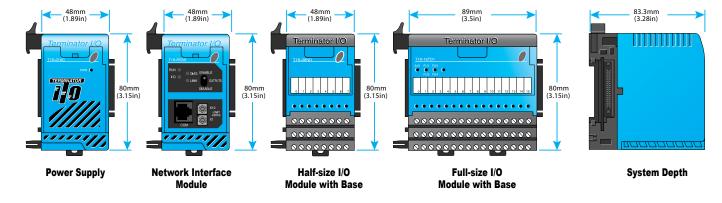


I/O Module Installation

I/O module installation

Terminator I/O modules feature separate terminal bases for easy installation.

To install I/O modules:

- 1. Slide the module into its terminal base (until it clicks into position)
- Hook upper DIN rail tabs over the top of DIN rail, and press the assembly firmly onto the DIN rail.
- 3. Slide the module along the DIN rail until it engages with the adjacent module.



<u>DN-ASB1</u> angled mounting bracket







Great for mounting in upper locations



Great for mounting in lower locations


Optional angled support bracket raises and tilts the mounting rail for easier access and wiring. Use with 35mm DIN rail. See the Connection Systems in this catalog for details.



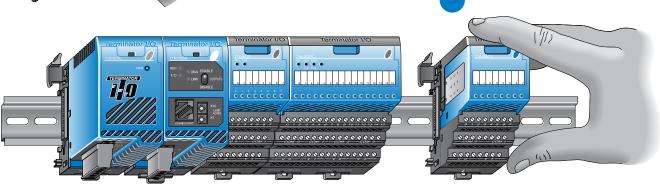


Removing I/O modules is a snap

Grip the locking handle, as shown, and pull gently to eject the I/O module from its base. The module will slide out for easy replacement. This procedure does not apply to network interface modules or power supplies, which have integral bases.



under power, but exercise caution while doing so. Do not touch the terminals with your hands or any conductive material. Always remove power when possible.

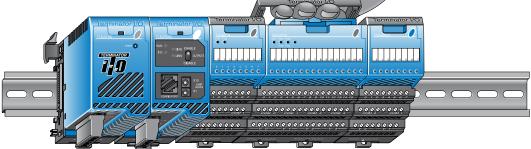

Power Supplies and Power Requirements

Power supplies

The Terminator I/O product line offers two power supply options: AC or DC. The power supplies are always positioned to the left of the modules to which they supply power. Consult the system configuration examples and the power budgeting example for more information on positioning power supplies.





Power supply specifications

	er Supply ifications	T1K- 01AC \$176.00	T1K- 01DC \$208.00	
Input Voltage Range		110/220 VAC	12/24 VDC	
Input Fre	quency	50/60 Hz	N/A	
Maximur	n Power	50VA	30W	
Max. Inru	ısh Current	20A	10A	
Insulatio	n Resistance	> 10Mq @ 500 VDC		
Voltage	Withstand	1 min. @ 1500VAC between primary, secondary and field ground		
5VDC PWR	Voltage	5.25 VDC	5.25 VDC	
	Current Rating	2000 mA max (see current option note below)	2000mA max	
	Ripple	5% max.	5% max.	
	Voltage	24VDC	N/A	
24VDC PWR	Current Rating	300mA max. (see current option note below)	N/A	
	Ripple	10% max.	N/A	
Fuse	1 (prima	ary), not replaceable		
Replace Terminal (Phoenix		MVSTBW 2.5/4-ST- 5.08 BK	MVSTBW 2.5/6-ST- 5.08 BK	

Power requirements

Module	5VDC	24VDC	Module	5VDC	24VDC	Module	5VDC	24VDC
Interface Modules			DC Output Modules			Analog Input Modules		
<u>T1H-</u>	300	0	T1H-08TDS	200	0	T1F-08AD-1	75	50*
EBC100	300	U	T1K-08TD1	100	200*	T1F-08AD-2	75	50*
T1K- DEVNETS	250	45	T1K-16TD1	200	400*	T1F-16AD-1	75	50*
			T1K-	200	0	T1F-16AD-2	75	50*
T1K- MODBUS	300	0	<u>08TD2-1</u>	200	U	T1F-16RTD	150	0
DC Input Modules		<u>T1K-</u> 16TD2-1	200	0	<u>T1F-</u> 16TMST	150	0	
T1K-08ND3	35	0	AC Output Modules			T1F-14THM	60	70*
T1K-16ND3	70	0	T1K-08TA	250	0		1	1.0
AC Input Modulos			T1K-16TA	450	0	Analog Output Modules		
T1K-08NA-1	35	0	T1K-08TAS	300	0	T1F-08DA-1	75	150*
T1K-16NA-1	70	0	Relay Output Modules		T1F-08DA-2	75	150*	
	·				0	T1F-16DA-1	75	150*
					-	T1F-16DA-2	75	150*
	<u>T1K-16TR</u> 700 0			-	Combination Analog			
			T1K-08TRS 400 0 Specialty Modules			Modules		
						<u>T1F-</u>	75	60*
			<u>T1H-CTRIO</u> 400 0		0	8AD4DA-1		
* Use either internal or external source for 24VDC					nal source	<u>T1F-</u> 8AD4DA-2	75	70*
				* Use either intern	al or extern	al source		

Calculating the power budget


To calculate the power budget, read the available power (current rating) from the Power Supply Specifications table and subtract the power consumed by each module to the right of the power supply. Do not include modules to the right of an additional power supply.

Adding additional power supplies

Each power supply furnishes power only to the network interface and I/O modules to its right. Inserting a second power supply closes the power loop for the power supply to the left, while also powering the modules to its right. Perform a power budget calculation for each power supply in the system.

Power Budget Example					
Module	5VDC	24VDC			
T1K-01AC	+2000mA	+300mA			
T1H-EBC100	-300mA	-0mA			
T1K-16ND3	-70mA	-0mA			
T1K-16TD2	-200mA	-0mA			
T1F-08AD-1	-75mA	-50mA			
Remaining	+1355mA	+250mA			

for 24VDC

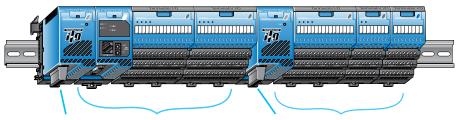

This power supply powers the network interface module and the next two I/O modules

This power supply powers these three I/O modules

Note: 500mA @ 24VDC can be achieved by lowering the

5VDC from 2000mA to 1500mA


Expansion I/O Configurations

Expansion cables

<u>T1K-10CBL</u> \$132.00 <u>T1K-10CBL-1</u>* \$170.00

Right side to left side expansion cable

The <u>T1K-10CBL</u>-1) connects the right side of an I/O base to the left side of the next I/O base. A maximum of two T1K-10CBL(-1) cables can be used per expansion system.






*Note: The (-1) versions of the expansion cables pass 24VDC through on an isolated wire. (All cables pass the 5VDC base power.) Any local expansion DC input module configured for "internal power" (current sourcing) must either have a power supply preceding it on the same base or, have a (-1) version cable pass 24VDC from a power supply on the preceding base.

Using two T1K-10CBL expansion cables

In the system below, power supplies can be used anywhere.

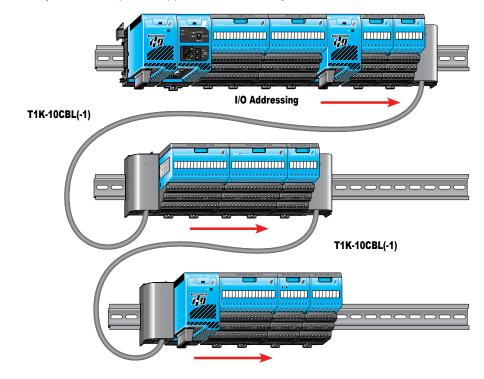

Field Device Wiring and Power Options

Terminal base specifications


Terminator I/O terminal bases are available in screw clamp and spring clamp versions for both half-size and full-size modules. Hot stamp silk screen labeling is used for numbering I/O points, commons, and all power terminals.

Terminal Base Specifications				
Terminal Type	Screw type	Spring clamp		
Recommended Torque	1.77–3.54 lb·in (0.2–0.4 N·m)	N/A		
Wire Gauge	Solid: 25–12 AWG Stranded: 26–12 AWG	Solid: 25–14 AWG Stranded: 26–14 AWG		

Field device wiring options

Power your DC input devices from the integrated 24VDC power supply bus. T1K-08ND3 and T1K-16ND3 DC input modules include jumpers for selecting the internal 24VDC power supply available for 2- and 3-wire field devices. Clearly labeled triple stack terminals make it easy to wire 2- and 3-wire devices ensuring clean wiring with only one wire per termination.

External user supplied 24VDC power, or auxiliary 24VDC terminals from <u>T1K-01AC</u>, can be easily applied directly to one end of the terminal rows and jumpered across each base in the system.

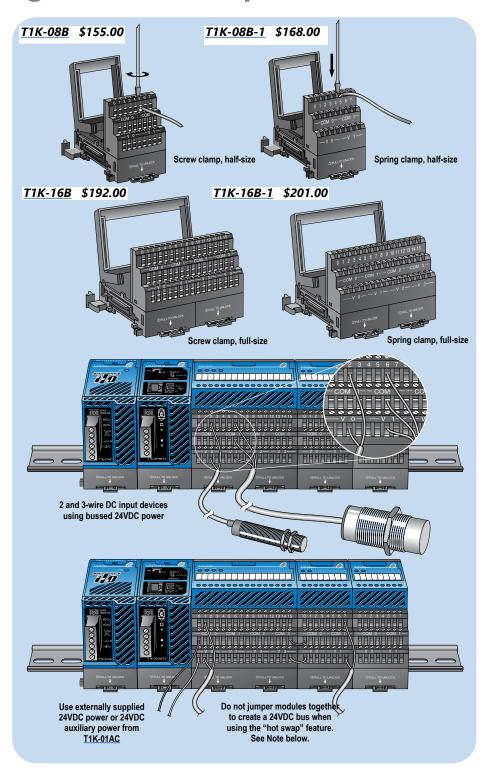

Hot-swap feature

The hot-swap feature allows Terminator I/O modules to be replaced while system power is on. Be careful not to touch the terminals with your hands or other conductive material to avoid the risk of personal injury or equipment damage. Always remove power if it is equally convenient to do so.

Note: Before hot-swapping analog or

DC output modules in a Terminator I/O system, make sure that each of the analog and DC output module's 24VDC and 0 VDC base terminals are wired directly to the external power supply individually. If the external 24VDC and 0 VDC is jumpered from base to base in a daisy chain fashion, and an analog or DC output

module is removed from its base, the risk of disconnecting the external 24VDC and 0 VDC to the subsequent I/O modules exists.