


XBF-AH04A Analog Combo Module

Part Number	Price	Classification	Description	# of Channels	Drawing
XBF-AH04A	\$216.00	Voltage/Current Input/Output	LS Electric XGB analog combo module, Input: 2-channel, current/voltage, 0-20 mA and 4-20 mA, 0-5 VDC, 1-5 VDC and 0-10 VDC, Output: 2-channel, current/voltage, 0-20 mA and 4-20 mA, 0-5 VDC, 1-5 VDC and 0-10 VDC.	4	PDF

General Specifications			XBF-AH04A	
			Voltage	Current
Input Performance Specifications	Analog Input Range*		1-5 VDC, 0-5 VDC, 0-10 VDC (Input resistance: 1MΩ or above)	4-20 mA DC, 0-20 mA DC (Input resistance 250Ω)
	Digital Output	Type	12-bit binary data	
		Unsigned Value	0-4000	
		Signed Value	±2000	
		Precise Value	100-500 (1-5 VDC), 0-500 (0-5 VDC), 0-1000 (0-10 VDC)	400-2000 (4-20 mA DC), 0-2000 (0-20 mA DC)
		Percentile Value	0-1000	
	Additional Function	Filter Function	Digital filter (4-64,000 ms)	
		Averaging Function	Time averaging (4-16,000 ms)	
			Count averaging (2-64,000 times)	
		Alarm Function	Moving averaging (2-100 samples)	
Output Performance Specifications	Analog Output Range*		1-5 VDC, 0-5 VDC, 0-10 VDC (Load resistance: 2kΩ or above)	4-20 mA DC, 0-20 mA DC (Load resistance 510Ω or less)
	Digital Input	Type	12-bit binary data	
		Unsigned Value	0-4000	
		Signed Value	±2000	
		Precise Value	100-500 (1-5 VDC), 0-500 (0-5 VDC), 0-1000 (0-10 VDC)	400-2000 (4-20 mA DC), 0-2000 (0-20 mA DC)
		Percentile Value	0-1000	
	Additional Function		Function setting channel output status (can select one from Previous, Minimum, Median, Maximum)	
Common Specifications	Maximum Resolution		1/4000	
			1.25 mV (1-5, 0-5 VDC) 2.5 mV (0-10 VDC)	5μA (4-20, 0-20 mA DC)
	Accuracy		±0.5%	
	Maximum Conversion Speed		1ms/channel	
	Absolute Maximum Input		±15VDC	±25mA DC
	Insulation Method		Photocoupler insulation between I/O terminal and PLC power (not insulated between channels)	
	I/O Terminal Block		11 points terminal block	
	I/O Points Occupied		Fixed type: 512 points	
	Current Consumption	Internal (5VDC)	120mA	
		External (24VDC)	130mA	
	Weight		73g	
	Power Supply		20.4-28.8 VDC	


* Input and Output Voltage/Current selection switch for each channel must match user program settings..

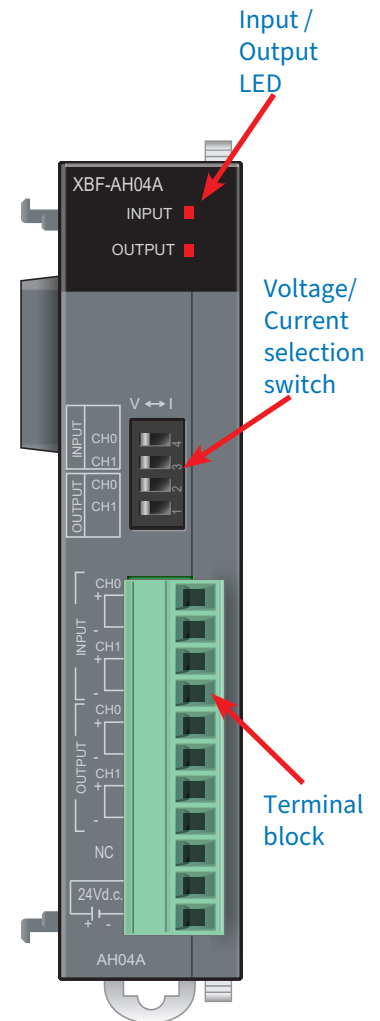

XBF-AH04A Analog Combo Module Wiring

When connecting cable to your XBF-AH04A:

- In case of voltage/current input/output, wiring is the same. Adjust the voltage/current setting switch according to the case.
- Keep the AC power line away from the analog input module's external input signal line to prevent surge or inductive noise.
- Use cable rated to meet your application's ambient temperature and current needs. AWG22 (0.3mm²) or greater recommended.
- Keep cable clear of high heat and oil.
- Check polarity when wiring the terminal.
- Using high-voltage line or power line may cause abnormal operations or defects due to inductive hindrance.
- Make sure the desired channel is enabled.

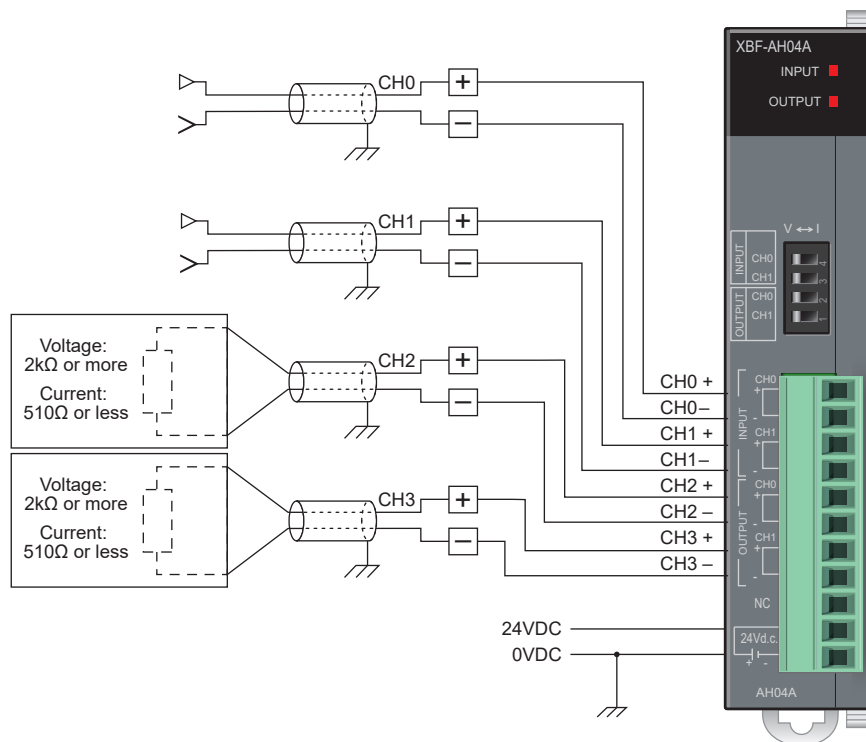

Notes:

- Use 2-core twisted shield cable
- Use AWG22 (0.3mm²) cable
- Current input resistance is 250Ω
- Current output load resistance is 510Ω or less
- Voltage input resistance is 1MΩ
- Voltage output load resistance is 2kΩ or above
- Terminal screwdriver: slotted 2.5 mm



XGB Analog Modules

XBF-AH04A Analog Combo Module Configuration

Follow the Quick start video to learn how to Register and Configure any Analog Module:

Analog Module Setup

Direct Variables

All XGB series analog modules are assigned 32 words in the "U" memory area based on the slot number assignment. (%UW0.z.0 - %UW0.z.31, z = slot number). The actual memory address used within the 32 word block are specific to each module. See the table below for Direct Variable assignments.

For Direct Variable nomenclature explanation, see [Direct Variable User Programming Memory](#).

Symbolic Variables

Symbolic variables for the analog module can be automatically created in XG5000 software by using the top MENU bar: Edit > Register Module Variable Comments.

Symbolic variables and direct variables for XBF-AH04A are as follows (z refers to module slot number (2 to 8)).

Type	Scope	Variable (Symbolic)	Address (Direct Variable Alias)	Data Type	Comment
Tag	Global/Variable	_0z_AD01_DATA_ARY	%UW0.z.4	ARRAY[0..1] OF WORD	Analog IO Module: Input each CH Data
Tag	Global/Variable	_0z_AD0_ACT	%UX0.z.16	BOOL	Analog IO Module: AD0 Activation Status
Tag	Global/Variable	_0z_AD0_DATA	%UW0.z.4	WORD	Analog IO Module: AD0 Digital Output Data
Tag	Global/Variable	_0z_AD0_ERR	%UX0.z.24	BOOL	Analog IO Module: AD0 Error Code
Tag	Global/Variable	_0z_AD0_IDD	%UX0.z.20	BOOL	Analog IO Module: AD0 Disconnection Flag
Tag	Global/Variable	_0z_AD1_ACT	%UX0.z.17	BOOL	Analog IO Module: AD1 Activation Status
Tag	Global/Variable	_0z_AD1_DATA	%UW0.z.5	WORD	Analog IO Module: AD1 Digital Output Data
Tag	Global/Variable	_0z_AD1_ERR	%UX0.z.25	BOOL	Analog IO Module: AD1 Error Code
Tag	Global/Variable	_0z_AD1_IDD	%UX0.z.21	BOOL	Analog IO Module: AD1 Disconnection Flag
Tag	Global/Variable	_0z_CH_ACT_ARY	%UX0.z.16	ARRAY[0..3] OF BOOL	Analog IO Module: Input/Output each CH Active
Tag	Global/Variable	_0z_CH_ERR_ARY	%UX0.z.24	ARRAY[0..1] OF BOOL	Analog IO Module: Input/Output each CH Error
Tag	Global/Variable	_0z_DA01_DATA_ARY	%UW0.z.7	ARRAY[0..1] OF WORD	Analog IO Module: Output each CH DATA
Tag	Global/Variable	_0z_DA0_ACT	%UX0.z.18	BOOL	Analog IO Module: DA0 Activation Status
Tag	Global/Variable	_0z_DA0_DATA	%UW0.z.7	WORD	Analog IO Module: DA0 Digital Input Data
Tag	Global/Variable	_0z_DA0_ERR	%UX0.z.26	BOOL	Analog IO Module: DA0 Error Code
Tag	Global/Variable	_0z_DA0_OUTEN	%UX0.z.96	BOOL	Analog IO Module: DA0 Output Enable
Tag	Global/Variable	_0z_DA1_ACT	%UX0.z.19	BOOL	Analog IO Module: Output CH1 Activation Status
Tag	Global/Variable	_0z_DA1_DATA	%UW0.z.8	WORD	Analog IO Module: DA1 Digital Input Data
Tag	Global/Variable	_0z_DA1_ERR	%UX0.z.27	BOOL	Analog IO Module: DA1 Error Code
Tag	Global/Variable	_0z_DA1_OUTEN	%UX0.z.97	BOOL	Analog IO Module: DA1 Output Enable
Tag	Global/Variable	_0z_DA_OUTEN_ARY	%UX0.z.96	ARRAY[0..1] OF BOOL	Analog IO Module: Output each CH Status Setting
Tag	Global/Variable	_0z_ERR	%UX0.z.0	BOOL	Analog IO Module: Error Flag
Tag	Global/Variable	_0z_RDY	%UX0.z.15	BOOL	Analog IO Module: Ready Flag



XGB Series PLC Family

Environmental Specifications, all XGB Series Modules

Item				Specification	Reference
Ambient Operating Temperature				0–55°C (32–131°F)	–
Storage Temperature				-25–70°C (-13–158°F)	
Ambient Operating Humidity				5–95% relative humidity (non-condensing)	
Storage Humidity				5–95% relative humidity (non-condensing)	
Vibration ¹	Occasional Vibration	Frequency	5 ≤ f < 8.4 Hz	3.5 mm pulse width	IEC61131-3-2
			8.4 ≤ f < 150Hz	9.8 m/s ² (1G)	
	Continuous Vibration		5 ≤ f < 8.4 Hz	1.75 mm pulse width	
			8.4 ≤ f < 150Hz	4.9 m/s ² (0.5G)	
Shocks		Peak Acceleration	147 m/s ² (15G)		
		Duration	11ms		
		Pulse Wave Type	Half-sine (3 times each direction per each axis)		
Noise Resistance	Square Wave Impulse Noise		1,500VAC 900VDC	LS Electric standard	
	Electrostatic Discharge		Voltage: 4kV (contact discharge)	IEC61131-3-2 IEC61000-4-2	
	Radiated Electromagnetic Field Noise		80–1,000 MHz, 10 V/m	IEC61131-3-2 IEC61000-4-3	
	Fast Transient / Burst Noise	Classification	Voltage	IEC61131-3-2 IEC61000-4-4	
		Power Supply	2kV		
		Digital/Analog Input/Output Communication Interface	1kV		
Environment			Free from corrosive gases and excessive dust	–	
Attitude			Less than 2,000m		
Pollution Degree			Less than 2 (see note 2)		
Cooling Method			Air-cooling		

1 - Vibration of 10 times each direction (X, Y, and Z)

2 - Normally only nonconductive pollution occurs. Temporary conductivity caused by condensation is to be expected.



XGB Series PLC Family

Available I/O Modules

XGB Series I/O Modules									
Part Number	Price	Description	Digital Input	Digital Output	Analog Input	Analog Output	Motion	Bus Coupler Compatible	Smart Link Required
Digital									
<u>XBE-DC08A</u>	\$59.00	LS Electric XGB discrete input module, 8-point, 24 VDC, sinking/sourcing, 1 common(s), 8 point(s) per common. Removable terminal block included.	✓					✓	
<u>XBE-DC16A</u>	\$70.00	LS Electric XGB discrete input module, 16-point, 24 VDC, sinking/sourcing, 1 common(s), 16 point(s) per common. Removable terminal blocks included.	✓					✓	
<u>XBE-DC16B</u>	\$78.00	LS Electric XGB discrete input module, 16-point, 12-24 VDC, sinking/sourcing, 1 common(s), 16 point(s) per common. Removable terminal blocks included.	✓					✓	
<u>XBE-DC32A</u>	\$97.00	LS Electric XGB discrete input module, 32-point, 24 VDC, sinking/sourcing, 1 common(s), 32 point(s) per common. Requires XTB-40H terminal block and C40HH-xxSB-XBI cable.	✓					✓	✓
<u>XBE-AC08A</u>	\$88.00	LS Electric XGB discrete input module, 8-point, 120 VAC, 2 common(s), 4 point(s) per common. Removable terminal blocks included.	✓					✓	
<u>XBE-RY08A</u>	\$80.00	LS Electric XGB relay output module, 8-point, 125 VDC/250 VAC, (8) Form A, 1 common(s), 8 point(s) per common, 2A/point, 5A/common. Removable terminal block included.		✓				✓	
<u>XBE-RY08B</u>	\$95.00	LS Electric XGB relay output module, 8-point, 125 VDC/250 VAC, (8) Form A, 8 isolated common(s), 1 point(s) per common, 2A/point. Removable terminal blocks included.		✓				✓	
<u>XBE-RY16A</u>	\$110.00	LS Electric XGB relay output module, 16-point, 125 VDC/250 VAC, (16) Form A, 2 isolated common(s), 8 point(s) per common, 2A/point, 5A/common. Removable terminal blocks included.		✓				✓	
<u>XBE-TN08A</u>	\$60.00	LS Electric XGB discrete output module, 8-point, 12-24 VDC, sinking, 1 common(s), 8 point(s) per common, 0.5A/point, 2A/common. Removable terminal blocks included.		✓				✓	
<u>XBE-TN16A</u>	\$78.00	LS Electric XGB discrete output module, 16-point, 12-24 VDC, sinking, 1 common(s), 16 point(s) per common, 0.5A/point, 2A/common. Removable terminal blocks included.		✓				✓	
<u>XBE-TN32A</u>	\$109.00	LS Electric XGB discrete output module, 32-point, 12-24 VDC, sinking, 1 common(s), 32 point(s) per common, 0.2A/point, 2A/common. Requires XTB-40H terminal block and C40HH-xxSB-XBI cable.		✓				✓	✓
<u>XBE-TP08A</u>	\$62.00	LS Electric XGB discrete output module, 8-point, 12-24 VDC, sourcing, 1 common(s), 8 point(s) per common, 0.5A/point, 2A/common. Removable terminal blocks included.		✓				✓	
<u>XBE-TP16A</u>	\$88.00	LS Electric XGB discrete output module, 16-point, 12-24 VDC, sourcing, 1 common(s), 16 point(s) per common, 0.5A/point, 2A/common. Removable terminal blocks included.		✓				✓	
<u>XBE-TP32A</u>	\$93.00	LS Electric XGB discrete output module, 32-point, 12-24 VDC, sourcing, 1 common(s), 32 point(s) per common, 0.2A/point, 2A/common. Requires XTB-40H terminal block and C40HH-xxSB-XBI cable.		✓				✓	✓
<u>XBE-DN32A</u>	\$172.00	LS Electric XGB discrete combo module, Input: 16-point, 24 VDC, sinking/sourcing, Output: 16-point, 12-24 VDC, sinking, 0.2A/point, 2A/common. Requires XTB-40H terminal block and C40HH-xxSB-XBI cable.	✓	✓				✓	✓
<u>XBE-DR16A</u>	\$97.00	LS Electric XGB discrete combo module, Input: 8-point, 24 VDC, sinking/sourcing, Output: 8-point, 125 VDC/250 VAC, relay, (8) Form A (SPST) relays, 2A/point, 5A/common. Removable terminal blocks included.	✓	✓				✓	
Motion									
<u>XBF-PN04B</u>	\$350.00	LS Electric XGB 4-axis positioning module, EtherCAT Master, 1 high-speed input point(s), sinking/line driver (differential), 1-channel, differential and single-ended encoder input(s), (1) Ethernet 100Base-TX (RJ45) port(s). For use with LS Electric XEM-DxxxHx PLCs.					✓		
<u>XBF-PN08B</u>	\$395.00	LS Electric XGB 8-axis positioning module, EtherCAT Master, 1 high-speed input point(s), sinking/line driver (differential), 1-channel, differential and single-ended encoder input(s), (1) Ethernet 100Base-TX (RJ45) port(s). For use with LS Electric XEM-DxxxHx PLCs.					✓		
<u>XBF-HO02A</u>	\$176.00	LS Electric XGB counter input module, 200 kHz maximum switching frequency, 2 high-speed input point(s), 5-24 VDC, sinking, 2-channel, single-ended encoder input(s), 2 high-speed output point(s), 5-24 VDC, sinking, external 24 VDC required.					✓	✓	✓
<u>XBF-HD02A</u>	\$253.00	LS Electric XGB counter input module, 500 kHz maximum switching frequency, 2 high-speed input point(s), 5-24 VDC, sinking, 2-channel, differential encoder input(s), 2 high-speed output point(s), 5-24 VDC, sinking, external 24 VDC required.					✓	✓	✓

Note: See "Smart Link I/O System" on page tLSE-131 for the XTB-40H terminal block and cables. See "XGB PLC Replacement Terminals" on page tLSE-149 for replacement removable terminal blocks.

Continued on next page