Enclosure Cooling

You need to cool down

Heat inside an enclosure can decrease the life expectancy of controlling units such as your PLC, HMI, AC drives and other items. Excessive heat can cause nuisance faults from your electrical and electronic components: for example, overloads tripping unexpectedly. Heat will also change the expected performance of circuit breakers and fuses, which can cause whole systems to shut down unexpectedly. So, if you have any electronic equipment or other heat sensitive devices, you may need cooling.

What causes all that heat?

There are basically two sources that can cause the enclosure's internal temperature to rise above the ratings of the control equipment.

Internal Sources

The same items that can be damaged by heat may also be the source of the heat. These include items such as:

- Power supplies Servos
- AC Drives/inverters Soft starters
- Transformers PLC systems
- Communication products HMI systems
- Battery back-up systems

External Sources

Other sources of heat that can cause the internal temperature of your enclosure to rise above a desired level involve the external environment. These include items such as:

- Industrial ovens
- Solar heat gain
- Foundry equipment
- Blast furnaces

Get the heat out

How do you get the heat out of your enclosure and away from those critical components? There are several basic cooling methods available, depending on the cooling requirements and the enclosure environment.

Radiation and Natural Convection Cooling

If the ambient temperature outside the enclosure is cooler than the inside of the enclosure, some heat will be radiated into the atmosphere from the surface of the enclosure. In environments where dust and water intrusion is not a concern, louvers can be added to allow outside air to flow through the enclosure via natural convection - the movement of air due to it's expansion (reduced density) when it's heated and contraction (increased density) when it cools.

On a large scale, natural convection can be a powerful force - it's one of the primary drivers of our weather. But on the scale of an electrical enclosure, its cooling capacity is very limited. For larger heat loads, a more powerful cooling system may be needed.


Since they create openings in the enclosure, louvers are typically limited to NEMA 1 and/or NEMA 3R applications. However, some louvers have optional filters that can be added to maintain NEMA 12 protection.


Forced Convection Cooling

The next step up from natural convection is forced convection cooling. The basic cooling mechanism is the same: cooler air from outside the enclosure passes through the enclosure to remove the heat. The difference is that the air is mechanically forced through the enclosure by a filter fan. The fan produces higher air flow rates than natural convection, which in turn increases the amount of heat removed.

As with natural convection cooling, the ambient air temperature must be lower than the desired enclosure temperature for forced convection to be effective.


A typical forced convection system consists of a fan and a grille, with a filter on the intake device and either a filter or louvers on the exhaust device. The filters and louvers allow the enclosure to maintain NEMA 12 protection. In NEMA 4 or NEMA 4X environments, hoods can be added to both the fan and the grille to prevent the ingress of water.

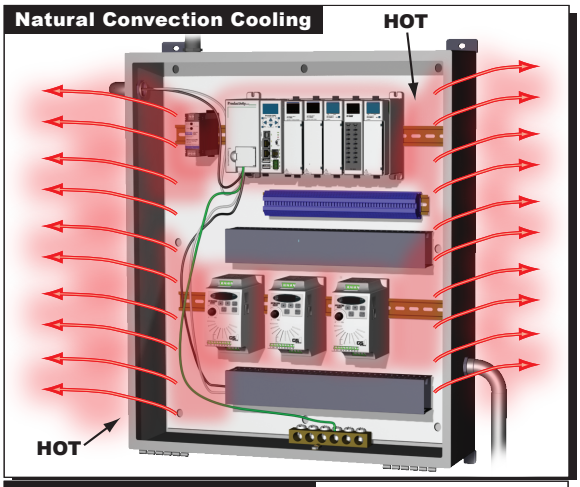

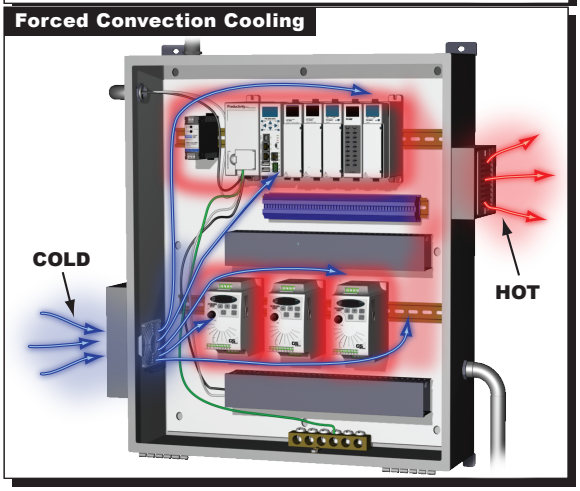

Enclosure Cooling

Closed Loop Cooling

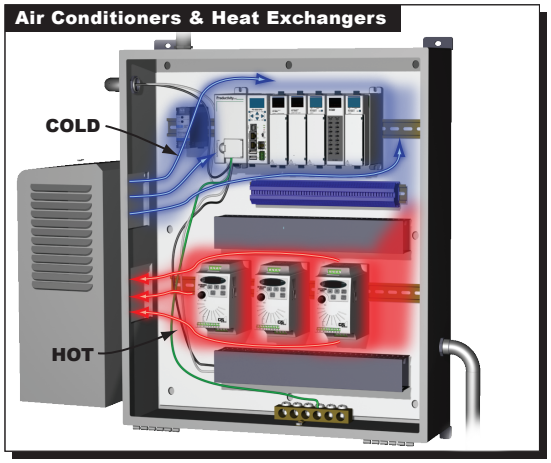

If the environment is harsh, with heavy dust and debris or the presence of airborne chemicals, or there are wash-down requirements, the cooling system must be able to keep the ambient air separate from the air inside the enclosure.

Closed loop systems, which include heat exchangers and air conditioners, circulate the internal air and ambient air through separate chambers connected by a refrigeration system that transfers heat from the internal air stream to the external air stream. Heat exchangers and air conditioners are both closed loop cooling systems. The primary difference in the two is the refrigeration system.

The refrigeration system in an air-to-air heat exchanger is a set of sealed tubes of alcohol. Heat absorbed from the internal enclosure air boils the liquid alcohol at the bottom of the tube, causing it to rise to the top. The heat is then rejected to the cooler ambient air stream, causing the alcohol to condense back to a liquid and fall to the bottom.

Heat exchangers are very efficient because the refrigeration system has no moving parts - the only moving parts are the fans. But for the heat to transfer through the system, the ambient air must be colder than the air inside the enclosure, just as it must be for filter fans.


If the ambient air temperature is too high, and a source of chilled water is available, then an air-to-water heat exchanger may be the ideal solution. Air-to-water heat exchangers use fans to blow across tubes with chilled water running through them. This creates a very effective closed loop cooling effect, but requires an external source of chilled water.

Enclosure air conditioners function in the same manner as a residential or automotive air conditioner, with refrigeration loop powered by a compressor. The refrigerant absorbs heat from the internal air at the evaporator coil and rejects it to the ambient air at the condenser coil. Unlike heat exchangers, they can provide cooling even if the ambient temperature is higher than the enclosure temperature. They can also be scaled to handle larger heat loads than any other cooling system.

Enclosure air conditioners are available for NEMA 12, NEMA 4 and NEMA 4X applications.

Vortex Coolers

Vortex coolers create a stream of extremely cold air from a supply of filtered compressed air. The cold air is injected into the enclosure, displacing warm air which is exhausted back through the vortex cooler. While not a closed-loop system, they can be used in the same harsh environments since the cold air injected into the enclosure is filtered air from a compressed air system, not ambient air. Vortex coolers can also be used where the ambient temperature is higher than the enclosure temperature.

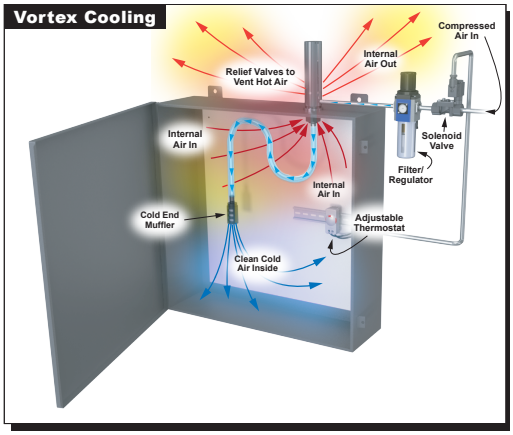


Since vortex coolers prevent the ingress of ambient air or sprayed water and are made from corrosion-resistant materials, they can be used on NEMA 4X enclosures in harsh, wash-down, and/or corrosive environments.

Vortex coolers are commonly used in lieu of a small or medium enclosure air conditioner in applications where there isn't adequate space to mount an air conditioner, provided there is an adequate supply of compressed air.

Thermoelectric Coolers

Another alternative to a conventional air conditioner is a thermoelectric cooler, which is sometimes referred to as a Peltier cooler. They function in a manner similar to an air conditioner or heat exchanger, with fans inside and outside the enclosure, but with a thermoelectric unit replacing the fluid-based refrigeration system.

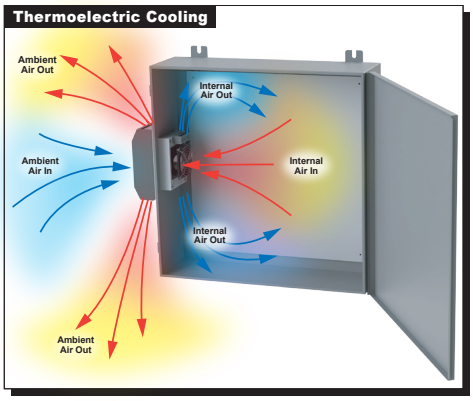

The thermoelectric units consist of an array of semiconductors sandwiched between two ceramic plates. When a DC current is applied to the semiconductor array, heat is driven from one plate to the other, creating a cold side and a warm side. This is known as the Peltier Effect. Fans circulate air across each of the plates, allowing the cold plate to absorb heat from the enclosure and the warm plate to reject it to the ambient air.

Like vortex coolers, thermoelectric coolers can be used with NEMA 4X enclosures in harsh, wash-down, and corrosive environments, and where the ambient temperature exceeds the enclosure temperature.

Thermoelectric coolers are an alternative to air conditioners in small cooling capacity applications where there isn't adequate space for an air conditioner.

Selecting an Enclosure Cooling Device

Cooling Basics

To select the proper cooling device for your enclosure, you need to determine how much heat the device must remove from the enclosure to maintain the desired internal temperature, which is the sum of two component heat loads: **Internal Heat Load** and **Heat Transfer Load**.

Internal Heat Load (Q_i)

The sum of all heat generated by the components within the enclosure. This can be calculated by adding the maximum heat output for each device installed in the enclosure (the worst-case conditions for the enclosure). The maximum heat output is typically specified in watts in the manufacturer's documentation. If it is not, contact the manufacturer to request the heat output or for guidance on how to measure or calculate it.

Heat Transfer Load (Q_x)

The heat gained (positive heat transfer) or lost (negative heat transfer) through the enclosure exterior surface with the surrounding ambient air. This can be calculated with the following formula:

Q_X = kAΔT (BTU/h), where:

k = heat transfer coefficient (BTU/(h·ft^2·°F))

The heat transfer coefficient is a measure of how easily an enclosure conducts heat from the internal air to the external air, which varies with the enclosure material. Suggested values for various enclosure materials are provided below:

Enclosure Material	*k, BTU/(h·ft^2·°F)*
Painted carbon steel	0.97
Stainless steel	0.83
Aluminum	2.1
Polycarbonate, fiberglass, PVC, ABS	0.62

A = exposed enclosure surface area (ft^2)

The total surface area of a rectangular enclosure is:

A = 2HW + 2HD + 2WD, where:

H = height

W = width

D = depth

But it's important to properly account for any surfaces that are against walls or floors, as those surfaces will absorb/reject heat from adjacent surfaces at a different rate (that is, have a different k value) than the exposed surfaces. Quantifying that difference is far beyond the scope of this document, but the q value for those surfaces will usually be less than the value for exposed surfaces. Therefore, the conservative design approach should be to ***exclude those surfaces when ΔT < 0 and use the total surface area when ΔT > 0.***

The equations for excluding those surfaces in several common situations are listed below.

Wall-mount (excludes back of the enclosure)	***A = HW + 2HD + 2WD***
Freestanding enclosure (excludes the bottom of the enclosure)	***A = 2HW + 2HD + WD***
Freestanding enclosure against a wall (excludes both the bottom and back)	***A = HW + 2HD + WD***
Freestanding enclosure in a corner (excludes the bottom, back, and one side)	***A = HW + HD + WD***

Using these formulas as written will produce answers in either in^2 or mm^2, depending on the enclosure. To convert to ft^2 use the appropriate conversion:

1ft² = 144in²

1ft² = 92,900mm²

Selecting an Enclosure Cooling Device

$\Delta T = T_A - T_E$, where T_A is maximum ambient air temperature (°F) and T_E is maximum allowable enclosure air temperature (°F)

Note that ΔT may be negative if the ambient temperature is less than the enclosure temperature. When this is the case, the heat transfer load will also be negative, meaning that the ambient air is providing some degree of cooling. Whereas a positive ΔT indicates that the ambient air is warming the enclosure.

A positive ΔT also indicates that neither a fan nor a heat exchanger is a viable cooling device for this application. Both devices exchange heat between the interior and exterior of the enclosure. Since heat will always move from the higher temperature material to the lower temperature, these devices will add heat to the enclosure which will raise the internal air temperature, not lower it.

The maximum allowable enclosure air temperature will typically be dictated by the maximum operating temperature of the components inside the enclosure. Be sure to choose the component value with the lowest maximum operating temperature.

Required Cooling Capacity (Q_r)

The required cooling capacity (Q_r) for an enclosure is simply the sum of the Internal Heat Load and the Heat Transfer Load. However, as presented these values cannot be simply added since one is typically given in watts and the other in BTU/h. Additionally, fan and heat exchanger sizing formulas require the total heat load in watts, while the cooling capacities of vortex coolers are generally expressed in BTU/h. However, the cooling capacities of air conditioners and thermoelectric coolers may be expressed in either unit, or sometimes both. Apply one of the following conversions to the heat loads to add them:

1 W = 3.41 BTU/h $\quad Q_r\ (BTU/h) = Q_i \times 3.41\ (BTU/h)/W + Q_x$


1 BTU/h = 0.293 W $\quad Q_r\ (W) = Q_i + Q_x \times 0.293\ W/(BTU/h)$

Vortex Cooler Selection

Once the required cooling capacity has been calculated, selection of a vortex cooler is simple – just select a cooler with a nominal cooling capacity greater than the calculated requirement.

Air Conditioner, Air-to-Water Heat Exchanger, and Thermoelectric Cooler Selection

Selecting an air conditioner, air-to-water heat exchanger, or thermoelectric cooler is more complex because their performance depends on both the ambient temperature and the enclosure temperature or the chilled water temperature. Generally, more strenuous operating parameters (higher ambient temperature, lower enclosure air temperature) will reduce the unit's performance. For this reason, manufacturers publish curves that graphically describe the unit's cooling capacity over a range of conditions. Here's an example:

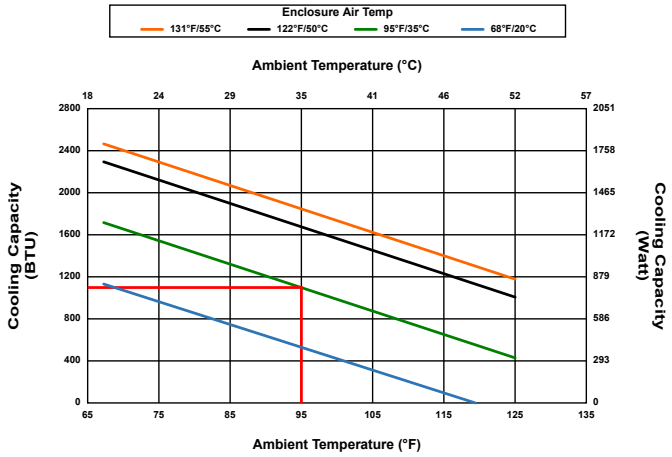

As indicated by the red lines, this air conditioner would be able to remove 1000 BTU/H when the ambient temperature is 95°F and enclosure air temperature is 95°F. If the ambient temperature was only 75°F, the cooling capacity of the unit would increase to approximately 1105 BTU/H as the lower ambient temperature increases the unit's condenser's ability to reject heat to the surrounding atmosphere. Conversely, at a 95°F ambient temperature and a 68°F enclosure air temperature, the unit's capacity would be reduced to approximately 945 BTU/H, as the lower enclosure air temperature would reduce the heat transfer rate between the internal enclosure air and the unit's evaporator coils.

An air-to-water heat exchanger performance curve is similar only the x-axis is the temperature of the chilled water provided to the heat exchanger instead of the ambient air temperature.

To determine if an air conditioner, air-to-water heat exchanger, or thermoelectric cooler meets application requirements, simply plot the two maximum temperatures used in the ΔT calculations and read the corresponding cooling capacity on the y-axis of the chart. If that value exceeds the required cooling capacity, the air conditioner will be adequate for the application. If not, select a larger capacity unit.

Selecting an Enclosure Cooling Device

The 95°F/95°F point is typically used as the nominal cooling capacity of the unit. But always keep in mind that any nominal capacity only represents one set of operating parameters. If those parameters to not match the actual application conditions, the actual performance of the air conditioner/thermoelectric cooler will be different.

Never rely solely on a nominal cooling capacity when selecting an air conditioner or a thermoelectric cooler! The nominal capacity is solely intended to provide an approximation to get the user "in the ballpark" of the selection process.

In addition to the required cooling capacity, an air conditioner, air-to-water heat exchanger, or thermoelectric cooler should also maintain the NEMA rating of the enclosure. Ideally, it should also operate on a voltage already available within the enclosure to avoid necessitating a transformer or power supply.

Air Conditioner Selection Example

A NEMA 12 Wiegmann N12302412 wall-mount enclosure (30in high x 24in wide x 12in deep) contains a GS4-4060 AC drive (60 HP 460V) that has a maximum allowable operating temperature of 104°F and is inside a plant with a maximum ambient air temperature of 115°F. The GS4-4060 specifications table indicates its maximum Watt Loss to be 1147 W.

Internal heat load:

$$Q_i = 1147\ W \times 3.413\ (BTU/h)/W = 3914\ BTU/h$$

Heat load transfer:

$$k = 0.97\ BTU/(h \cdot ft^2 \cdot °F)$$

$$\Delta T = 115°F - 104°F = 11°F$$ (Reminder: ΔT >0 means that fans or heat exchangers will not cool the enclosure!)


$$A = [2(30in \times 24in) + 2(30in \times 12in) + 2(24in \times 12in)]/144in^2/ft^2 = 19ft^2$$

$$Q_x = kA\Delta T = (0.97\ BTU/(h \cdot ft^2 \cdot °F))(19ft^2)(11°F) = 202\ BTU/h$$


Required cooling capacity:

$$Q_r = Q_i + Q_x = 3914\ BTU/h + 202\ BTU/h = 4116\ BTU/h$$


AutomationDirect offers several NEMA 12 460VAC models that meet or exceed 4605 BTU/h at 104°F. The curves for the appropriate sizes of some of these series are shown below.

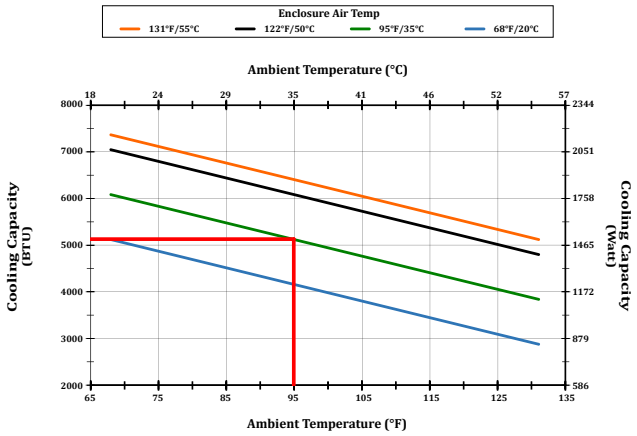

The NEMA 12 460VAC selection from this series is SCE-AC5100B460V.

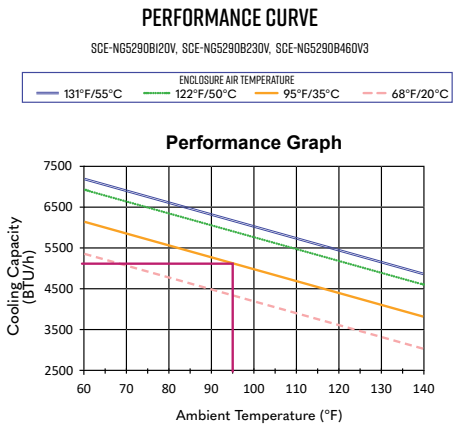

The NEMA 12 460VAC selection from this series is SCE-NG5290B460V3.

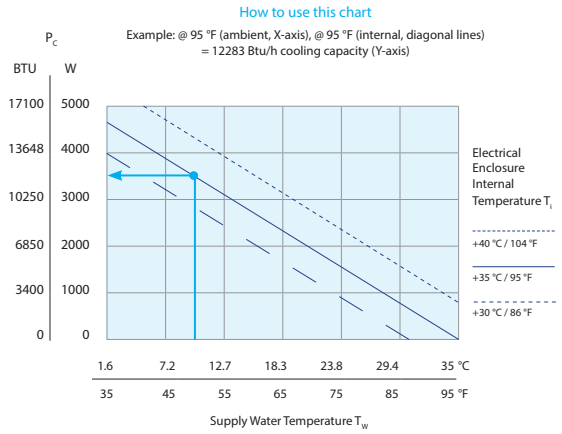

The NEMA 12 115VAC air-to-water heat exchanger 12358410045 will work as long as chilled water at least 65°F is readily available

Selecting an Enclosure Cooling Device

Air-to-Air Heat Exchanger Selection

Air-to-Air Heat exchanger capacities also depend on the internal enclosure air temperature and the ambient temperature, but the dependency is a simple linear relationship between the capacity and ΔT. So rather than graphing the cooling capacity of the heat exchanger, it is simply expressed in terms of W/°C and compared to the value of $-Q_r/\Delta T$.

To convert ΔT from °F to °C, use the conversion 1°C = 1.8°F.

Note that this simplified conversion only works for temperature differences. It does not work for measured temperatures since 0°F ≠ 0°C. DO NOT apply this conversion directly to the ambient and enclosure air temperatures. Only apply it to ΔT.

Air-to-Air Heat Exchanger Selection Example

A NEMA 12 Wiegmann N12302412 wall-mount enclosure (30in high x 24in wide x 12in deep) contains a GS4-4010 AC drive (10 HP 460 volt) that has a maximum allowable operating temperature of 104°F and is in a plant that has a maximum ambient air temperature of 90°F.

The GS4-4010 specifications table indicates its maximum Watt Loss to be 292 watts.

Internal heat load:

$$Q_i = 292\ W$$

Heat load transfer:

$$k = 0.97\ BTU/(h \cdot ft2 \cdot °F)$$

$$\Delta T = 90°F - 104°F = -14°F$$ (Since ΔT <0, a heat exchanger is a potentially valid cooling device)

$$\Delta T = -14°F/(1.8°F/°C) = -7.8°C$$

$$A = [(30in \times 24in) + 2(30in \times 12in) + 2(24in \times 12in)]/144in^2/ft^2 = 14ft^2$$

$$Q_x = kA\Delta T = (0.97\ BTU/(h \cdot ft^2 \cdot °F))(14\ ft^2)(-14°F) = -190\ BTU/h \times 0.293\ W/(BTU/h) = -56\ W$$

Required cooling capacity:

$$Q_r = Q_i + Q_x = 292\ W - 56\ W = 236\ W$$

$$-Q_r/\Delta T = -236\ W/-7.8°C = 30\ W/°C$$

A Stratus heat exchanger with a capacity of at least 30 W/°C is needed, such as a TE30-030-17-04.



Selecting an Enclosure Cooling Device

Fan Selection

A fan cools the enclosure simply by displacing the hot air within the enclosure with cooler air from the outside. Combining the specific heat of air, the density of air, and various conversion factors into a single coefficient gives a simple equation for correlating a fan's required airflow rate to the enclosure's required cooling capacity:

$$F_r = -(3.17\ CFM \cdot °F/W) Q_r / \Delta T$$

Once the fan airflow requirement is determined, fan selection is simply a matter of finding a fan with an airflow greater than the required airflow. Most applications will require an accompanying grille and one or more filters which will restrict airflow to some degree. (Exceptions would be a NEMA 1 enclosure or a similar circumstance where an open vent can be used for exhaust/makeup air.) Therefore, the fan selection should almost always be made based on the "Airflow with Grille and Filters (CFM)" column of the specifications, not the fan's Free Airflow.

Fan Selection Example

A NEMA 12 Wiegmann N12302412 wall-mount enclosure (30in high x 24in wide x 12in deep) contains a GS4-2025 AC drive (25 HP 230 volt) that has a maximum allowable operating temperature of 104°F and is in a plant that has a maximum ambient air temperature of 92°F.

The GS4-2025 specifications table indicates its maximum Watt Loss to be 733 watts.

Internal heat load:

$$Q_i = 733\ W$$

Heat load transfer:

$$k = 0.97\ BTU/(h \cdot ft^2 \cdot °F)$$

$$\Delta T = 92°F - 104°F = -12°F\ (Since\ \Delta T < 0,\ a\ fan\ is\ a\ potentially\ valid\ cooling\ device)$$

$$A = [(30in \times 24in) + 2(30in \times 12in) + 2(24in \times 12in)]/144in^2/ft^2 = 14ft^2$$

$$Q_x = kA\Delta T = (0.97\ BTU/(h \cdot ft^2 \cdot °F))(12\ ft^2)(-12°F) = -163\ BTU/h \times 0.293\ W/(BTU/h) = -48\ W$$

Required cooling capacity:

$$Q_r = Q_i + Q_x = 733\ W - 48\ W = 685\ W$$

Required air flow:

$$F_r = -(3.17\ CFM \cdot °F/W)(685\ W)/-12°F = 181\ CFM$$

Possible 230VAC fan & grille combinations include:

- Stego 018840-40 exhaust fan with 118840-30 grille (187 CFM)
- Fandis FF20A230UE1 intake fan with FF20U grille (209 CFM)
- Stego 018740-30 intake fan with 118740-00 grille (220 CFM)
- Stego 018840-00 exhaust fan with 118840-30 grille (243 CFM)
- Fandis TP19U230B1 roof-mount exhaust fan with FF20U grille (297 CFM)



Industrial strength cooling options for your enclosure from AutomationDirect

Heat Exchangers

- For NEMA 4 and 4X enclosures
- Closed loop cooling
- Energy efficient: uses approximately the same power as a filtered fan system
- 120VAC and 24VDC models available
- UL
- Made in the USA



Made in the USA

Air Conditioning Units

- For NEMA 12, 4, 4X type enclosures
- Digital temperature controller
- Active condensate evaporation system
- High unit efficiency
- Tough industrial construction
- Compressor protection system



Made in the USA

Enclosure Vortex Coolers

- For NEMA 12, 4, 4X type enclosures
- Operates on compressed air
- Stainless steel construction
- No moving parts, no maintenance required
- Vortex coolers can be "resized" for changing applications by simply replacing the generator inside the cooler. No need to purchase a new unit
- Replacing the vortex generator takes minutes



Made in the USA

Seifert Thermoelectric Cooling Units

- For NEMA 4, 4X, and 12 enclosures
- Stainless steel housing
- 170, 340, 510, 680 BTU/H cooling capacity
- Recessed mounting
- No maintenance required
- 24VDC and 120VAC power options



Enclosure Cooling – Selecting an Air-to-Air Heat Exchanger

Air-to-Air Heat Exchanger Selection

To select the proper size heat exchanger, the worst-case conditions should be considered. For a heat exchanger to work, the ambient air temperature must be lower than the desired internal enclosure air temperature.

There are three main factors in choosing a heat exchanger for an uninsulated metal NEMA rated enclosure located indoors:

- Internal heat load
- Delta T
- Heat load transfer

Internal Heat Load

Internal heat load is the heat generated by the components inside the enclosure. This can be determined by a few different methods. The preferred method is to add the maximum heat output specifications that the manufacturers list for all the equipment installed in the cabinet. This is typically given in Watts.

Delta T (ΔT)

Delta T = maximum allowable internal enclosure temperature °F – maximum outside ambient temperature °F.

Heat Load Transfer

Heat load transfer is the heat lost (negative heat load transfer) or gained (positive heat load transfer) through the enclosure walls with the surrounding ambient air. This can be calculated by the following formulas:

Surface Area (sq. ft.) = 2 [(H x W) + (H x D) + (W x D)] / (144 sq. inches/sq. ft.)

Note: Only include exposed surfaces of enclosue in calculations. Exclude surfaces such as a surface mounted to a wall.

Heat Load Transfer (W/°F) = 0.22 W/°F sq. ft. x surface area

Note: Use 0.22 Watts/°F sq. ft. for painted steel and non-metallic enclosures. Use.10 Watts/°F sq. ft. for stainless steel and bare aluminum enclosures.

Cooling Capacity

Once you have determined your Internal Heat Load, the Heat Load Transfer and the Delta T, you can choose the proper size unit by calculating the needed cooling capacity.

Cooling Capacity (W/°F) = Internal Heat Load / ΔT - Heat Load Transfer

Air-to-Air Heat Exchanger Selection Example

A NEMA 12 Wiegmann N12302412 enclosure (30in [762mm] high x 24in [610mm] wide x 12in [305mm] deep) contains a GS3-4010 AC drive 10 HP 460 volt) that has a maximum allowable operating temperature of 104°F and is located in a warehouse that has a maximum outside ambient air temperature of 90°F.

Power to be dissipated is stated in the specifications of the GS3-4010 and is found to be 345 watts.

Internal heat load:

Internal Heat Load = 345 Watts

Delta T:

ΔT (°F) 104°F – 90°F = 14°F

Heat load transfer:

Surface Area (ft.2) = 2 [(30 x 24) + (30 x 12) + (24 x 12)] / 144 sq. inches = 19 ft.2
Heat Load Transfer = 0.22 x 19 ft2 = 4.2 Watts/°F

Cooling capacity:

Cooling Capacity = 345 Watts/14°F - 4.2 Watts/°F = 20.4 Watts/°F

In this example, you are able to determine that a heat exchanger, with a capacity of at least 20.4 Watts/°F is needed, such as a Stratus TE30-030-17-04 or a Saginaw Enviro-Therm SCE-HE24W120V.

*This selection procedure applies to metal and non-metal, uninsulated, sealed enclosures in indoor locations. This selection procedure gives the minimum required size; be careful not to undersize when purchasing.

Enclosure Heating and Heater Selection

Why Heat an Enclosure?

Today's miniaturization of enclosure components results in high packing densities, which in turn results in higher temperatures within the enclosure. These high temperatures are harmful to electronic components. In response, cooling systems have become standard in many applications. However, just as critical and widely underestimated, are failures caused by the formation of moisture.

Under certain climatic conditions, moisture can build up not only in outdoor or poorly insulated enclosures, but also in highly protected and well-sealed enclosures.

Moisture and Failure

Moisture, especially when combined with aggressive gases and dust, causes atmospheric corrosion and can result in the failure of components such as circuit breakers, busbars, relays, integrated circuit boards and transformers. The greatest danger lies in conditions where electronic equipment is exposed to relatively high air humidity or extreme variations in temperature, such as day-and-night operation or outdoor installation. Failure of components in such cases is usually caused by changing contact resistances, flashovers, creepage currents or reduced insulation properties.

Eliminate Moisture

Moisture and corrosion will remain low if relative air humidity stays below 60%. However, relative humidity above 65% will significantly increase moisture and corrosion problems. This can be prevented by keeping the environment inside an enclosure at a temperature as little as 9°F (5°C) higher than that of the ambient air. Constant temperatures are a necessity to guarantee optimal operating conditions. Continuous temperature changes not only create condensation but they reduce the life expectancy of electronic components significantly. Electronic components can be protected by cooling during the day and heating at night.

Thermal Management

Modern enclosure heaters are designed to protect against condensation. They heat the air inside enclosures, preventing water vapor from condensing on components while providing the greatest possible air circulation and low energy consumption.

Other heating element technology improvements include:

- Longer operating life
- Greater energy efficiencies
- Quick wiring options
- Easier mounting
- Fan heaters should be considered for larger enclosures to ensure that the entire enclosure is heated uniformly

Heater Location

Ideally, most heaters will perform optimally when mounted near the bottom of an enclosure and used in conjunction with a control device, thermostat, and/or hygrostat. The control device may be a separate device, or it may be integral to the heater. With the controller located in an area of the cabinet that is representative of the average temperature or humidity requirement, the heater should then be placed in a position near the bottom of the enclosure. If a separate control device is used, the heater should not be located directly beneath the controller to ensure that the controller is not influenced by direct heat from the heater.

Heater Calculation

Follow Steps 1-5 to determine the heating requirement of an enclosure (US units - left column, metric - right)

STEP 1: Determine the Surface Area (A) of your enclosure which is exposed to open air.

Enclosure Dimensions:

height =_____feet _____meters

width =_____feet _____meters

depth =_____feet _____meters

Choose Mounting Option from next page, and calculate the surface area as indicated

A = _____ ft2 or _____ m2

STEP 2: Choose the Heat Transmission Coefficient (k) for your enclosure's material of construction.

painted steel = 0.511 W/(ft2K) 5.5 W/(m2K)

stainless steel = 0.344 W/(ft2K) 3.7 W/(m2K)

aluminum = 1.115 W/(ft2K) 12 W/(m2K)

plastic or insulatedstainless = 0.325 W/(ft2K) 3.5 W/(m2K)

k = _____W/(ft2K) or _____ W/(m2K)

STEP 3: Determine the Temperature Differential (ΔT).

A. Desired enclosure interior temp. = ___oF ___oC

B. Lowest ambient (outside) temp. = ___oF ___oC

Subtract B from A = Temp. diff. (ΔT) = ___oF ___oC

For these calculations, ΔT must be in° Kelvin (K). Therefore, divide ΔT (oF) by 1.8. ΔT = _____ K

STEP 4: Determine Heating Power (PV), if any (generated from existing components, i.e. transformer).

PV = _____ W or _____ W

STEP 5: Calculate the Required Heating Power (PH) for your enclosure based on the above values.

If enclosure is located inside:


PH = (A x k x ΔT) - PV = _____ W

If enclosure is located outside:


PH = 2 x (A x k x ΔT) - PV = _____ W

Enclosure Mounting Types and Surface Area Calculations


1. Free-Standing

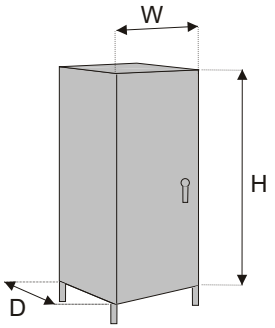

Area (A) =1.8ft³ [0.05m³] (H x W) + 1.8 (H x D) +1.8ft³ [0.05m³] (W x D)

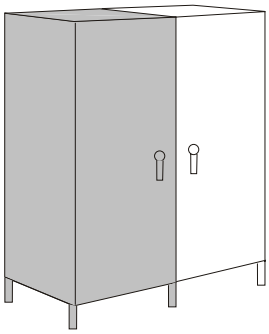


Area (A) =1.8ft³ [0.05m³] (H x W) + 1.4 (H x D) +1.8ft³ [0.05m³] (W x D)

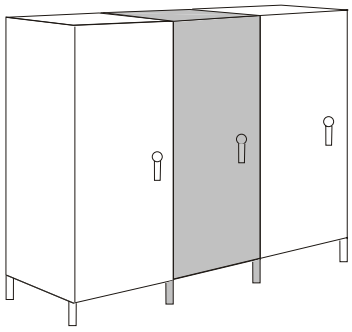


Area (A) =1.8ft³ [0.05m³] (H x W) + (H x D) +1.8ft³ [0.05m³] (W x D)


2. Wall-Mounted

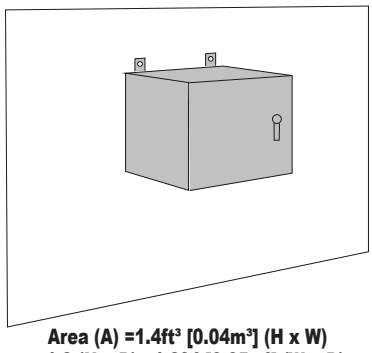

Area (A) =1.4ft³ [0.04m³] (H x W) + 1.8 (H x D) +1.8ft³ [0.05m³] (W x D)

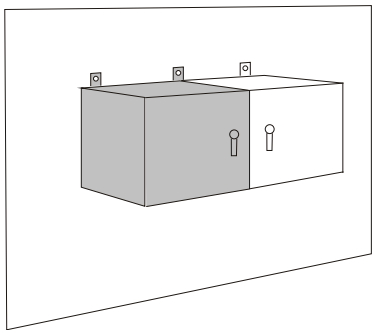


Area (A) =1.4ft³ [0.04m³] (H x W) + 1.4 (H x D) +1.8ft³ [0.05m³] (W x D)

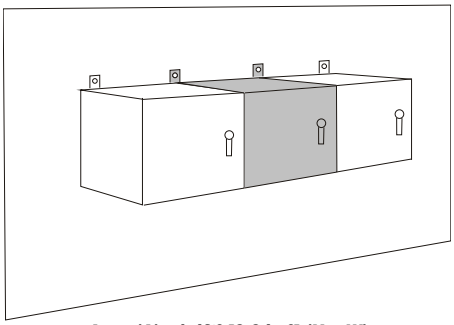


Area (A) =1.4ft³ [0.04m³] (H x W) + (H x D) +1.8ft³ [0.05m³] (W x D)


3. Ground

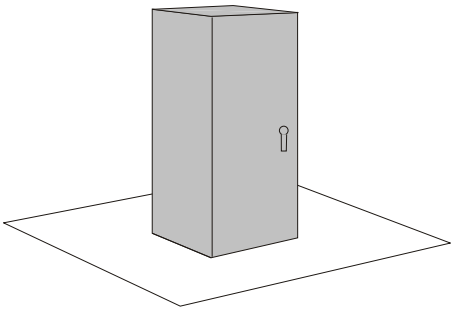

Area (A) =1.8ft³ [0.05m³] (H x W) + 1.8 (H x D) +1.4ft³ [0.04m³] (W x D)

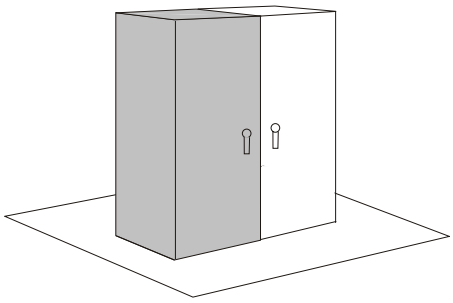


Area (A) =1.8ft³ [0.05m³] (H x W) + 1.4 (H x D) +1.4ft³ [0.04m³] (W x D)

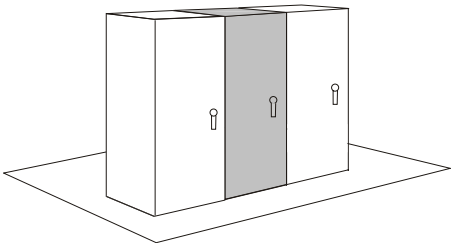


Area (A) =1.8ft³ [0.05m³] (H x W) + (H x D) +1.4ft³ [0.04m³] (W x D)


4. Ground and Wall

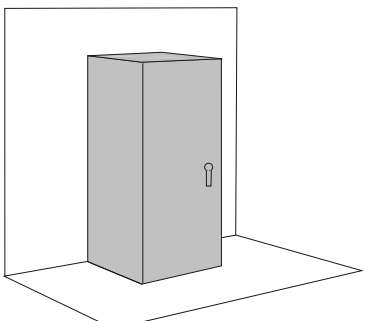

Area (A) =1.4ft³ [0.04m³] (H x W) + 1.8 (H x D) +1.4ft³ [0.04m³] (W x D)

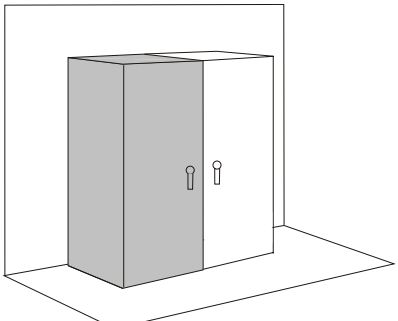

Area (A) =1.4ft³ [0.04m³] (H x W) + 1.4 (H x D) +1.4ft³ [0.04m³] (W x D)

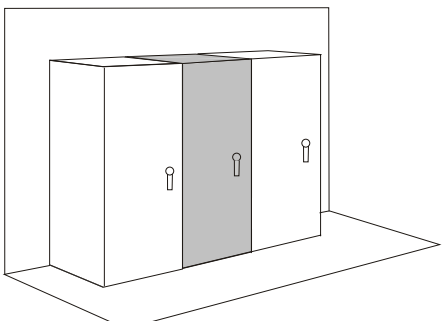

Area (A) =1.4ft³ [0.04m³] (H x W) + (H x D) +1.4ft³ [0.04m³] (W x D)