


# DIGITAL AND ANALOG I/O PARAMETER MAPS

---



**APPENDIX**

**C**

## TABLE OF CONTENTS

### *Appendix C: Digital and Analog I/O Parameter Maps*

<b><i>Introduction</i></b> . . . . .	<b><i>C-2</i></b>
<i>GS20(X) Digital Inputs – Main Control Board</i> . . . . .	<i>C-3</i>
<i>GS20(X) Digital Outputs – Main Control Board</i> . . . . .	<i>C-4</i>
<i>GS20(X) Analog Common Parameters</i> . . . . .	<i>C-5</i>
<i>GS20(X) Analog Input 1 Parameters</i> . . . . .	<i>C-5</i>
<i>GS20(X) Analog Input 2 Parameters</i> . . . . .	<i>C-6</i>
<i>GS20(X) Analog Output 1 Parameters</i> . . . . .	<i>C-8</i>
<i>GS20(X) Frequency Output Parameters</i> . . . . .	<i>C-8</i>

## **INTRODUCTION**

This section contains worksheets to help with designing and programming the physical inputs and outputs of the GS20(X) (digital, analog, and frequency interfaces). These worksheets provide the GS20(X) parameters and addresses associated with each input and output. For detailed parameter descriptions, please see Chapter 4 “AC Drive Parameters”. For more detailed wiring information, please see Chapter 2 “Installation and Wiring”.

Digital and analog I/O parameter maps begin on the following page.

**GS20(X) DIGITAL INPUTS**

GS20(X) Digital Inputs							
Parameter	FWD/DI1	REV/DI2	DI3	DI4	DI5	DI6	DI7
PLC Address	X0	X1	X2	X3	X4	X5	X6
<b>P02.00</b> if ≠ 0, else: <b>P02.01</b>			<b>(P02.00 if=3 or 6) else P02.03</b>				
<b>P02.02</b>		<b>P02.00=1, P02.02=0</b>	1	2	3	4	0
<b>P02.03</b>							
Default Setting	<b>P2.00=1, P02.01=0</b>						
Default Configuration	2 wire mode: FWD/STOP	2 wire mode: REV/STOP	Multi Spd 1	Multi Spd 2	Multi Spd 3	Multi Spd 4	No Function
User Defined Selection / Value							
DI - N.O./N.O. Select <b>P02.12 - Bit #</b>	0	1	2	3	4	5	6
Default Configuration							
User Defined Selection / Value							
DI - Response Time							
Default Configuration			0.005 seconds				
User Defined Selection / Value							
DI - Active Status Monitor <b>P02.50 - Bit #</b>	0	1	2	3	4	5	6
DI - PLC Status Monitor <b>P02.52 - Bit #</b>	0	1	2	3	4	5	6
0 = Normally Open							
<b>P02.11</b>							
0 to 30.000 seconds							
Read Only!							
* Note for PLC Address: When an external input is used in the PLC and the PLC is in Run or Stop mode, the PLC then controls that input and any Multi-Function Input setting assigned via P02.00~P02.07 is void. To read the status of an input into the PLC while maintaining the multifunction input setting use the RPR command on the DI Status Register (P02.50). The control of the IO can be given back to the drive by disabling the PLC either through the Keypad or Digital Inputs when they are assigned values 51 and 52.							
Digital Input Configurations - Parameters P02.01~P02.07							
0: No function	11: Base Block (B.) input from external source	28: Emergency stop (EF1)	56: Local / Remote selection				
1: Multi-step speed command 1	12: Output stop	29: Signal confirmation for Y-connection	58: Enable fire mode (without RUN command)				
2: Multi-step speed command 2	13: Cancel the setting of autoacceleration / auto-deceleration time	30: Signal confirmation for S-connection	59: Enable fire mode (without RUN command)				
3: Multi-step speed command 3	15: Frequency command from A11	31: High torque bias (P11.30)	70: Force auxiliary frequency return to 0				
4: Multi-step speed command 4	16: Frequency command from A12	32: Middle torque bias (P11.31)	71: Disable PID function, force PID output return to 0				
5: Reset	18: Force to stop (P07.20)	33: Low torque bias (P11.32)	72: Disable PID function, retain the output value before disabled				
6: JOG [by external control or GS4-KPD (optional)]	19: Digital up command	38: Disable writing EEPROM function	73: Force PID integral gain return to 0, disable integral				
7: Acceleration / deceleration / speed inhibit	20: Digital down command	39: Torque command direction	74: Reverse PID feedback				
8: 1st and 2nd acceleration / deceleration time selection	21: PID function disabled	40: Force coasting to stop					
9: 3rd and 4th acceleration / deceleration time selection	22: Clear the counter	41: HAND switch					
10: External Fault (EF) Input (P07.20)	23: Input the counter value (D16)	42: AUTO switch					
	24: FWD JOG command	48: Mechanical gear ratio switch					
	25: REV JOG command	49: Enable drive					
	26: TQC / FOC mode selection	50: Slave dEb action to execute					
	27: ASR1 / ASR2 selection	51: Selection for PLC mode bit 0					
		52: Selection for PLC mode bit 1					

## GS20(X) DIGITAL OUTPUTS

GS20(X) Digital Outputs				
GS20(X) Terminals	R1-R1C-R1O	DO1-DOC	DO2-DOC	Comments
PLC Address	Y0	Y3	Y4	
Parameter	<b>P02.13</b>	<b>P02.16</b>	<b>P02.17</b>	
Default Setting	11	0	0	
Default Configuration	Malfunction Indication	No Function		See Digital Output Configurations Below
User Defined Selection / Value				
DO - N.C. / N.O. Select <b>P02.18 - Bit #</b>	0	3	4	0 = N.O. 1 = N.C.
Default Configuration	0	0	0	
User Defined Selection / Value				
DO - Active Status Monitor <b>P02.51 - Bit #</b>	0	3	4	Read Only!
DO - PLC Status Monitor <b>P03.53 - Bit #</b>	0	3	4	

\* Note for PLC Address: When an external output is used in the PLC and the PLC is in Run or Stop mode, the PLC then controls that output and any Multi-Function Output setting assigned via P02.13, P02.16, and P02.17 is void. To read the status of an output from the PLC while maintaining the multifunction output setting, use the RPR command on the DO Status Register (P02.51). The ownership of the IO can be given back to the drive by disabling the PLC either through the Keypad or Digital Inputs when they are assigned values 51 and 52.

### Digital Output Configurations – Parameters P02.13, P02.16, and P02.17

0: No function	18: Count value reached, return to 0 (P02.19)	37: Error output selection 3 (P06.25)
1: Indication during RUN	19: External interrupt B.B. input (Base Block)	38: Error output selection 4 (P06.26)
2: Operation speed reached	20: Warning output	40: Speed reached (including STOP)
3: Desired frequency reached 1 (P02.22)	21: Over-voltage	42: Crane function
4: Desired frequency reached 2 (P02.24)	22: Over-current stall prevention	43: Motor speed detection
5: Zero speed (Frequency command)	23: Over-voltage stall prevention	44: Low current output (use with P06.71–06.73)
6: Zero speed including STOP (Frequency command)	24: Operation mode	45: UVW output electromagnetic valve switch
7: Over-torque 1 (P06.06–06.08)	25: Forward command	46: Master dEb output
8: Over-torque 2 (P06.09–06.11)	26: Reverse command	51: Analog output control for RS-485 interface
9: Drive is ready	29: Output when frequency ≥ P02.34	52: Output control for communication cards
10: Low voltage warning (Lv) (P06.00)	30: Output when frequency < P02.34	53: Fire mode indication
11: Malfunction indication	31: Y-connection for the motor coil	66: SO output logic A
13: Overheat warning (P06.15)	32: Δ-connection for the motor coil	67: Analog input level reached
14: Software brake signal indicator (P07.00)	33: Zero speed (actual output frequency)	68: SO output logic B
15: PID feedback error (P08.13, P08.14)	34: Zero speed including STOP (actual output frequency)	73: Over-torque 3
16: Slip error (oSL)	35: Error output selection 1 (P06.23)	74: Over-torque 4
17: Count value reached, does not return to 0 (P02.20)	36: Error output selection 2 (P06.24)	75: Forward RUN status
		76: Reverse RUN status

**GS20(X) ANALOG COMMON PARAMETERS**

GS20(X) – AI1 and AI2 – Common Parameters				
Parameter		Selection / Value	Default	User Selection
<b>P00.20</b>	Master frequency command source (AUTO, REMOTE)	0: Digital keypad 1: RS-485 communication input 2: External analog input (Refer to P03.00) 3: External UP / DOWN terminal (digital input terminals) 4: Pulse input (DI7) without direction command 6: Not used 7: Digital keypad VR/potentiometer dial (GS20 only) 8: Communication card 9: PID controller	0	
<b>P00.30</b>	Master frequency command source (HAND, LOCAL)	0		


**GS20(X) ANALOG INPUT 1 PARAMETERS**

GS20(X) – AI1 Specific Parameters				
Parameter		Selection / Value	Default	User Selection
Terminals		AI1 – ACM	N/A	N/A
PLC Address		D1028	N/A	N/A
<b>P03.00</b>	Analog input selection (AI1)	1: Frequency command 2: Torque command (torque limit under speed mode) 3: Torque compensation command 4: PID target value 5: PID feedback signal 6: Thermistor (PTC) input value 7: Positive torque limit 8: Negative torque limit 9: Regenerative torque limit 10: Positive / negative torque limit 11: PT100 RTD input value 12: Auxiliary frequency input 13: PID compensation value	1	
<b>P03.28</b>	AI1 terminal input selection	0: 0–10 V (P03.63–P03.68 is valid) 3: -10–10 V (P03.63–P03.74 are valid)	0	
<b>P03.03</b>	Analog input bias (AI1)	-100.0% to +100.0%	0	
<b>P03.07</b>	Positive / negative bias mode (AI1)	0: No bias 1: Lower than or equal to bias 2: Greater than or equal to bias 3: The absolute value of the bias voltage while serving as the center 4: Bias serves as the center	0	
<b>P03.11</b>	Analog input gain (AI1)	-500.0% to +500.0%	100.0	
<b>P03.15</b>	Analog input filter (LPF) time (AI1)	0.00~20.00 sec	0.01	
<b>P03.47</b>	AI1%	-100 to 100%	0	
<b>P03.50</b>	Analog input curve calculation selection	0: Normal curve 1: Three-point curve of AI1 2: Three-point curve of AI2 3: Three-point curve of AI1 & AI2	0	

Parameters below are used to characterize the GS20(X) drive output frequency with three point curve parameters if using AI1 for speed reference (bias and gain parameters above are not used when P03.50 ≠ 0).

<b>P03.63</b>	AI1 voltage lowest point	0.00~10.00V	0	
<b>P03.64</b>	AI1 proportional lowest point	0.00~100.00%	0	
<b>P03.65</b>	AI1 voltage mid-point	0.00~10.00V	5	
<b>P03.66</b>	AI1 proportional mid-point	0.00~100.00%	50.00	

GS20(X) – AI1 Specific Parameters (continued)				
Parameter		Selection / Value	Default	User Selection
P03.67	AI1 voltage highest point	0.00~10.00V	10	
P03.68	AI1 proportional highest point	0.00~100.00%	100.00	
P03.69	Negative AI1 voltage highest point	-10.00~0.00 V (valid when P03.28 sets as -10~10 V)	0.00	
P03.70	Negative AI1 proportional highest point	-100.00~100.00% (valid when P03.28 sets as -10~10 V)	0.00	
P03.71	Negative AI1 voltage mid-point	-10.00~0.00 V (valid when P03.28 sets as -10~10 V)	-5.00	
P03.72	Negative AI1 proportional mid-point	-100.00~100.00% (valid when P03.28 sets as -10~10 V)	-50.00	
P03.73	Negative AI1 voltage lowest point	-10.00~0.00 V (valid when P03.28 sets as -10~10 V)	-10.00	
P03.74	Negative AI1 proportional lowest point	-100.00~100.00% (valid when P03.28 sets as -10~10 V)	-100.00	

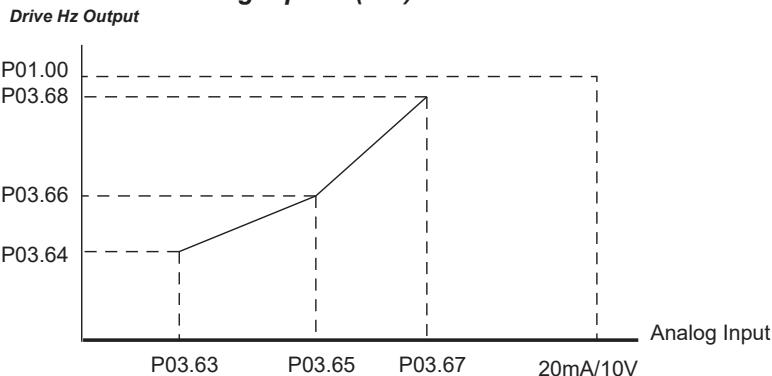**Analog Input 1 (AI1) Three Point Curve****GS20(X) ANALOG INPUT 2 PARAMETERS**


GS20(X) – AI2 Specific Parameters				
Parameter		Selection / Value	Default	User Selection
<b>Terminals</b>		<b>AI2 – ACM</b>	<b>N/A</b>	<b>N/A</b>
<b>PLC Address</b>		<b>D1029</b>	<b>N/A</b>	<b>N/A</b>
P03.01	Analog input selection (AI2)	1: Frequency command 2: Torque command (torque limit under speed mode) 3: Torque compensation command 4: PID target value 5: PID feedback signal 6: Thermistor (PTC) input value 7: Positive torque limit 8: Negative torque limit 9: Regenerative torque limit 10: Positive / negative torque limit 11: PT100 RTD input value 12: Auxiliary frequency input 13: PID compensation value	0	

GS20(X) – AI2 Specific Parameters (continued)				
Parameter		Selection / Value	Default	User Selection
<b>P03.29</b>	AI2 terminal input selection	0: 4–20 mA 1: 0–10 V 2: 0–20 mA	0	
<b>P03.04</b>	Analog input bias (AI2)	-100.0% to +100.0%	0	
<b>P03.08</b>	Positive/negative bias mode (AI2)	0: No bias 1: Lower than or equal to bias 2: Greater than or equal to bias 3: The absolute value of the bias voltage while serving as the center 4: Bias serves as the center	0	
<b>P03.12</b>	Analog input gain (AI2)	-500.0% to +500.0%	100.0	
<b>P03.16</b>	Analog input filter (LPF) time (AI2)	0.00~20.00 sec	0.01	
<b>P03.48</b>	AI2%	-100 to 100%	0	
<b>P03.50</b>	Analog input curve calculation selection	0: Normal curve 1: Three-point curve of AI1 2: Three-point curve of AI2 3: Three-point curve of AI1 & AI2	0	

**Parameters below are used to characterize the GS20(X) drive output frequency with three point curve parameters if using AI2 for speed reference (bias and gain parameters above are not used when P03.50 ≠ 0).**

<b>P03.57</b>	AI2 lowest point	P03.29=0: 0.00~10.00V P03.29=1: 4.00~20.00mA P03.29=2: 0.00~20.00mA	P03.29=0: 0.00V P03.29=1: 4.00mA P03.29=2: 0.00mA	
<b>P03.58</b>	AI2 proportional lowest point	0.00~100.00%	0	
<b>P03.59</b>	AI2 voltage mid-point	P03.29=0: 0.00~10.00V P03.29=1: 4.00~20.00mA P03.29=2: 0.00~20.00mA	P03.29=0: 5.00V P03.29=1: 12.00mA P03.29=2: 10.00mA	
<b>P03.60</b>	AI2 proportional mid-point	0.00~100.00%	50.00	
<b>P03.61</b>	AI2 voltage highest point	P03.29=0: 0.00~10.00V P03.29=1: 4.00~20.00mA P03.29=2: 0.00~20.00mA	P03.29=0: 10.00V P03.29=1: 20.00mA P03.29=2: 20.00mA	
<b>P03.62</b>	AI2 proportional highest point	0.00~100.00%	100.00	

#### Analog Input 2 (AI2) Three Point Curve

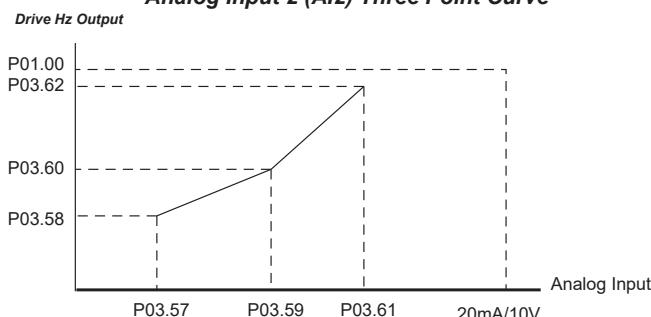

**P03.19 (Loss of AI2)**  
*determines the drive behavior if the 4–20mA signal is lost.*

**GS20(X) ANALOG OUTPUT 1 PARAMETERS**

GS20(X) – AO1 Specific Parameters			
Parameter	Selection / Value	Default	User Selection
Terminals	AO1 – ACM	N/A	N/A
PLC Address	D1040	N/A	N/A
P03.20	Multi-function output (A01) 0: Output frequency (Hz) 1: Frequency command (Hz) 2: Motor speed (Hz) 3: Output current (rms) 4: Output voltage 5: DC bus voltage 6: Power factor 7: Power 8: Output torque 9: AI1 10: AI2 12: Iq current command 13: Iq feedback value 14: Id current command 15: Id feedback value 16: Vq-axis voltage command 17: Vd-axis voltage command 18: Torque command 19: PG2 (DI7) frequency command 21: RS-485 analog output 22: Communication card analog output 23: Constant voltage output	0	
P03.21	Analog output gain (A01)	0.0~500.0%	100.0
P03.22	Analog output in REV direction (A01)	0: Absolute Value 1: 0V When Negative 2: Offset 5V = 0 Value	0
P03.27	A01 output bias	-100.00~100.00%	0.00
P03.31	A01 output selection	0: 0-10 V output 1: 0-20 mA output 2: 4-20 mA output	0
P03.32	A01 DC output setting level	0.00~100.00%	0.00
P03.35	A01 output filter time	0.00~20.00 sec.	0.01

**GS20(X) FREQUENCY OUTPUT PARAMETERS**

GS20(X) – Frequency Output Specific Parameters			
Parameter	Selection / Value	Default	User Selection
Terminals	DO – DCM	N/A	N/A
PLC Address	N/A	N/A	N/A
P02.21	Digital output gain (DO) (Pulse per second output = actual output frequency x P3.38)	1~55 (1 = no scaling)	1