

# DATA SHEET

Premium Efficiency Motor: **MTSP-001-3BD36**

**60 Hz**

Document Generated: 22-Sep-2021  
Document ID:

Customer:

## MOTOR INFORMATION

HP	1
RPM	3600
Phase	3
Frequency	60
Voltage	230/460
Frame Size	56C
Enclosure	TEFC
Degree of Protection	IP69K
Service Factor	1.15
Poles	2
Full Load Speed	3470
Insulation Class	F
Temp Rise	80°C
NEMA Code Letter	N
Duty Cycle	S1
Slip	3.61%
NEMA Design	B
Moment of Inertia	0.054 lb.ft.^2
Locked Rotor Time (Hot)	12 seconds
Sound Pressure Level	76 dB(A)
Number of Starts	10
Max Ambient Temperature	40° C
Max Elevation	1000 m.a.s.l (3300 f.a.s.l)
Mounting	F1
Rotation	Bidirectional
Area of Classification	Div.2 Class I, Gr. A,B,C&D T2B
Inverter Rating	10:1 CT/20:1 VT
Standard	NEMA MG1, UL1004
Approvals	CSA,UL,CE

## EFFICIENCY/POWER FACTOR

LOAD	EFF	P. F.
100%	77.0 %	0.9
75%	75.0 %	0.86
50%	74.0 %	0.78

## TORQUE

FULL LOAD	LRT	BDT
1.5 lb.ft.	285 %	300 %

## AMPERAGE INFORMATION


	230V	460V
Full Load Amps	2.8	1.4
Locked Rotor Amps	30	15
No Load Current	1.4	0.7
Usable at 208V	3	

## BEARING INFORMATION

DE Bearing	6205 2RS
ODE Bearing	6205 2RS
Grease Type	Mobil Polyrex EM
DE Regreasing Interval	-- Hours
ODE Regreasing Interval	-- Hours
Grease Quantity	--

## ADDITIONAL DATA

F2 Suitable	No
Shaft Material	304 Stainless Steel
Connection Diagram	9 Lead 2Y/Y
Approximate Weight	35 lbs.

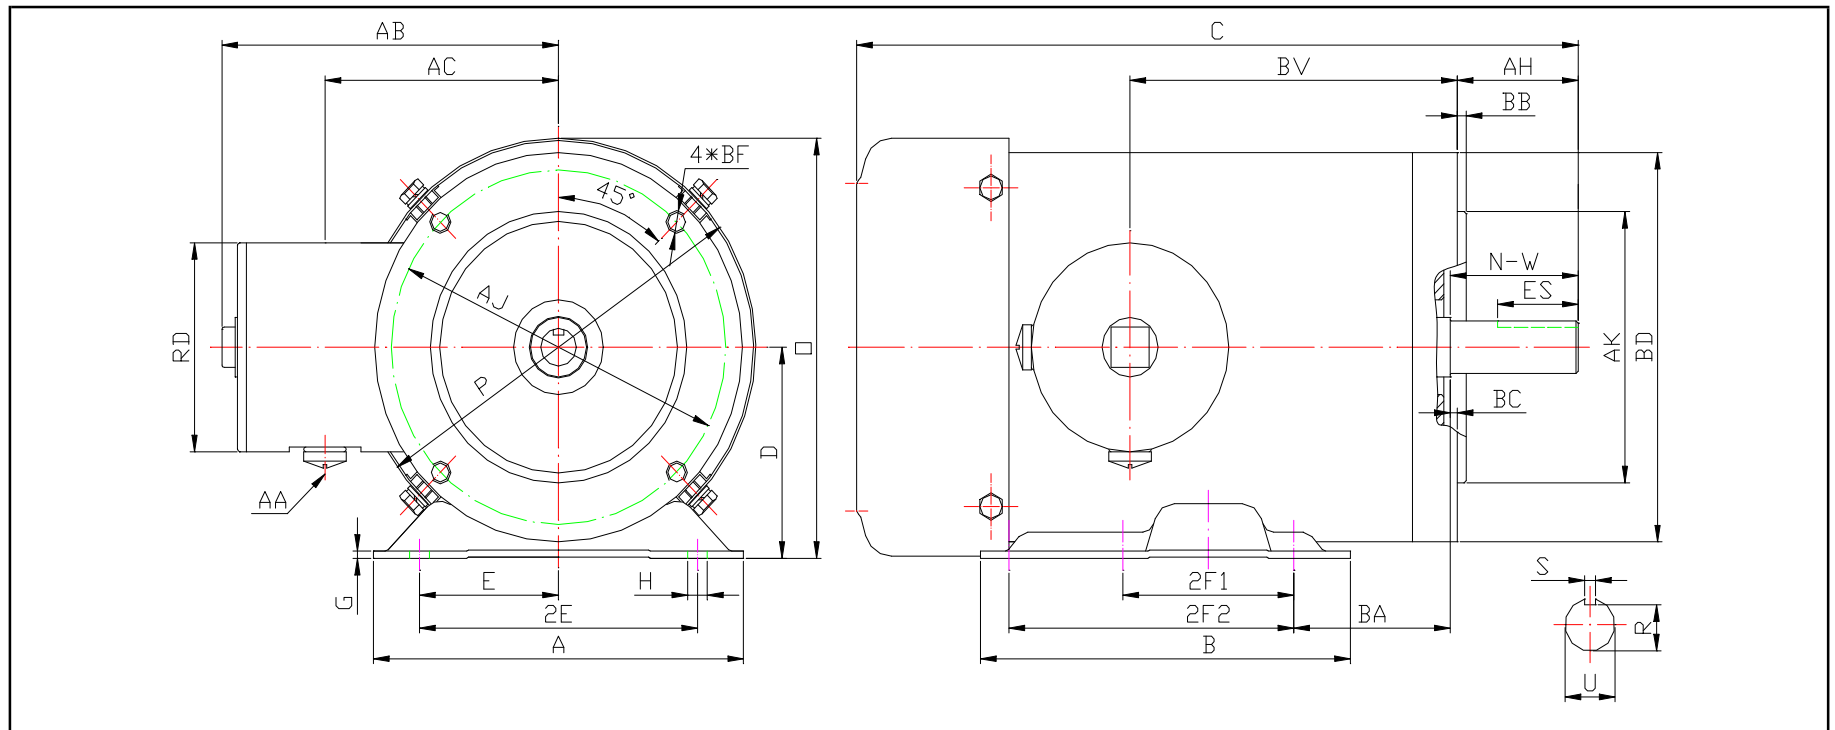

**DIMENSIONS - INCHES**

MOUNTING					A	B	C	D	G	T	P	O	BC	AB
E	2F1	2F2	H	BA										
2.44	3	5	1.22*0.34	2.75	6.5	5	12.57	3.5	0.118	--	6.95	6.98	-0.19	5.95

SHAFT & KEY					
S	ES	R	N-W	U	AH
0.188	1.41	0.517	1.88	0.625	2.06

TERMINAL BOX				
AA	AB	AC	RD	BV
1/2	5.95	4.5	3.45	5.75

FLANGE				
AK	BD	AJ	BF	BB
4.5	6.45	5.875	(4)3/8-16	0.16


# PERFORMANCE CURVES

Premium Efficiency Motor: **MTSP-001-3BD36**

Document Generated: 22-Sep-2021	Customer:
Document ID:	

Motor Type	MTS		FL Speed	3470	
Output Rating (HP)	1		LRT (%FLT)	285	
Full Load Torque	1.5	lb.ft	460 volt FLA	1.4	
Rotor Wk <sup>2</sup>	0.054	lb-ft <sup>2</sup>	230 volt FLA	2.8	
			BDT (%FLT)	300	

SPEED VS TORQUE & CURRENT CURVE

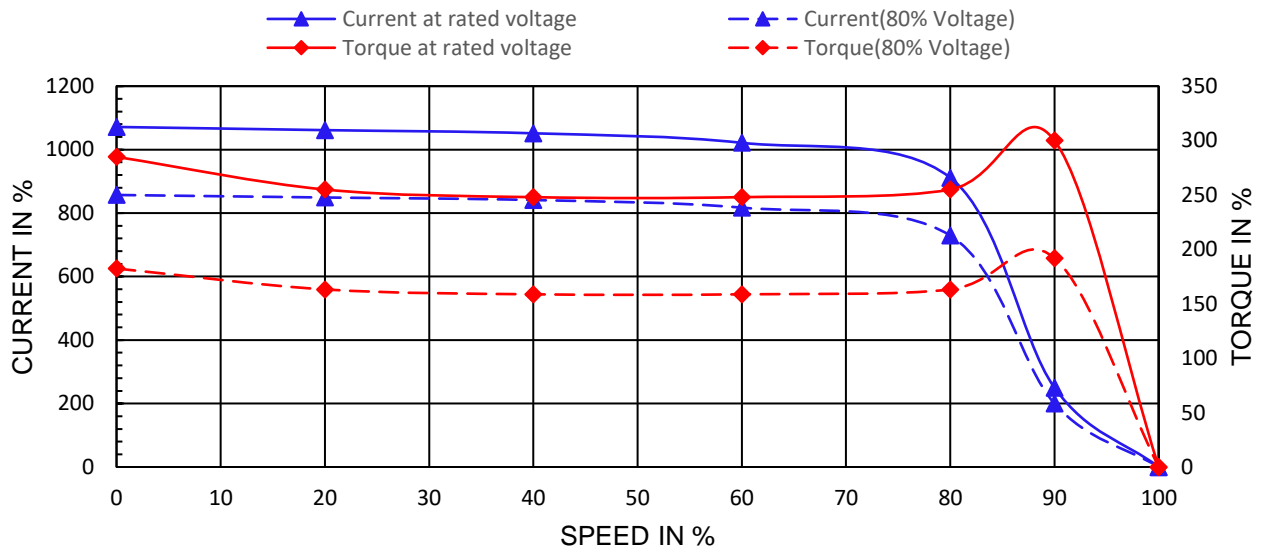

OUTPUT VS EFF., P.F. & CURRENT CURVE

