


RHINO Installation Instructions for PSN24-480 Power Supply

READ INSTRUCTIONS BEFORE INSTALLING OR OPERATING THIS DEVICE. KEEP FOR FUTURE REFERENCE.



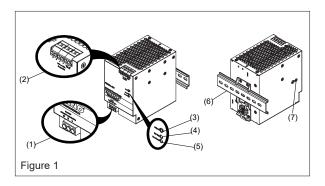








	Overload LED	DC OK LED	DC OK Contact
Normal mode	OFF	ON	Closed
During Power Boost	OFF	ON	Closed
Overload (V _{out} < 90%)	Flashing	OFF	Open
Output short circuit	Flashing	OFF	Open
Temperature shut down	Flashing	OFF	Open
No input power	OFF	OFF	Open

Figure 4





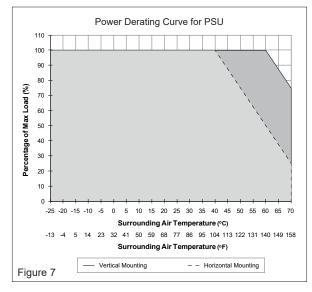

1. Safety instructions

- An easily accessible disconnecting device shall be provided to disconnect the unit from the mains supply for servicing.
- Switch main power off before connecting or disconnecting the device. Risk of explosion!
- If the unit is used in a manner not specified by the manufacturer, the protection provided by the equipment may be impaired.
- To guarantee sufficient convection cooling, please refer to the following instructions to ensure sufficient clearance around the device.

Vertical Mounting: 40 mm [1.57 in] above and 20 mm [0.79 in] below the device as well as a lateral distance of 5 mm [0.20 in] to other units. In case the adjacent device is a heat source, the lateral distance will be 15 mm [0.59 in]. Horizontal Mounting: 40 mm [1.57 in] above and below the device as well as a lateral distance of 20 mm [0.79 in] to other units.

- The external enclosure where the unit will be installed shall meet the requirements for mechanical, electrical and fire enclosure.
- Note that the enclosure of the device can become very hot depending on the ambient temperature and load of the power supply. Risk of burns!
- The main power must be turned off before connecting or disconnecting wires to the terminals!
- · Do not introduce any objects into the unit!
- Dangerous voltage present for at least 5 minutes after disconnecting all sources of power.
- The power supplies are built in units and must be installed in a cabinet or room (condensation free environment and indoor location) that is relatively free of conductive contaminants.
- · CAUTION: "For use in a controlled environment".

2. Device description (Fig. 1)

- (1) Input terminal block connector
- (2) Output terminal block connector
- (3) DC voltage adjustment potentiometer
- (4) DC OK control LED (green)
- (5) Overload LED (red)

- (6) 35mm DIN rail mounting (DIN rail sold separately)
- (7) Gas discharge tube (on left side of housing) used for surge protection. Disconnect gas discharge tube (remove Phillips head screw) during dielectric test of > 0.9 kVAC or 1.3 kVDC.

3. Mounting and dismounting (Fig. 2, Fig. 3)

The power supply unit can be mounted on 35 mm DIN rails in accordance with EN60715. For Vertical Mounting, the device should be installed with input terminal block on the bottom. For Horizontal Mounting, the device should be installed with input terminal block on the left side.

Each device is delivered ready to install.

- 1. Tilt the unit slightly upwards and put it onto the DIN rail. Snap on the DIN rail as shown in Fig. 2.
- 2. Push downwards until stopped.
- 3. Press against the bottom front side for locking.
- 4. Shake the unit slightly to ensure that it is secured.
- 5. To uninstall, pull or slide down the latch as shown in Fig. 3. Then, slide the PSU in the opposite direction, release the latch and pull out the PSU from the rail.

4. Connection

The terminal block connectors allow easy and fast wiring.

You can use flexible (stranded wire) or solid cables with the following cross sections:

Table 1	Standard / Solid		Torque	
Refer to Fig. 1:	(mm²)	(AWG)	(Nm)	(lb in)
(1)	0.82-8.4	18-8	0.91	8.1
(2)	2.1-3.3	14-12	0.61	5.4

To secure reliable and shock proof connections, the stripping length should be 7 mm [0.28 in] (see Fig. 5 (1)). Please ensure that wires are fully inserted into the connecting terminals as shown in Fig. 5 (2). All wire strands must be fully inserted into the terminals with the screws securely fastened in order to ensure safety and maximum contact. In accordance to EN 60950 / UL 60950, flexible wires require ferrules.

Use appropriate copper wire that is designed to sustain operating temperature of:

- 1. At least 60°C / 75°C (140°F / 167°F) for USA.
- 2. At least 90°C (194°F) for Canada and IEC/EN61010-1, IEC/EN61010-2-201.

4.1. Input connection (Fig. 1, Fig. 6)

For AC input connections, use L, N and PE connections on the input terminal connector (see Fig. 1 (1)) to establish the 100-240 VAC connection. Fig. 6 shows the connection to the various network types.

For DC input connections, connect L pin to + from DC source and connect N pin to - from DC source.

The unit is protected with internal fuse (not replaceable) at L pin and it has been tested and approved on 20A (UL) and 16A (IEC) branch circuits without additional protection device. An external protection device is only required if the supplying branch has an ampacity greater than above. Thus, if an external protective device is necessary, or, utilized, a minimum value of 10A B- or 6A C- characteristic breaker should be used.



The internal fuse must not be replaced by the user.

4.2. Output Connection (Fig. 1 (2))

Use the "+" and "-" screw connections to establish the 24 VDC connection. The output provides 24 VDC. The output voltage can be adjusted from 24 to 28 VDC on the potentiometer. The green LED DC OK displays correct function of the output (Fig. 1 (4)). The device has a short circuit and overload protection and an overvoltage protection limited to 35 VDC.

4.3. Output characteristic curv

The device functions normal under operating line and load conditions. In the event of an over load ($I_0 > 150\%$) the output voltage will start to droop and bounce until over load has been removed. If the loads are in short circuit, the secondary voltage will bounce and recover once the short circuit has been removed.

- 4.4. Indicators and relay contacts (Fig. 4)
- 4.5. Thermal behavior (Fig. 7)

If the output capacity is beyond what is recommended in Fig. 7, the device will run into thermal protection by switching off i.e. device will go in bouncing mode and will recover when ambient temperature is lowered or load is reduced as far as necessary to keep device in working condition.

FOR TECHNICAL ASSISTANCE CALL 770-844-4200

Technical Data For PSN24-480

Input (AC)			
Nominal input voltage / frequency	100-240 VAC / 50-60Hz; or		
Voltage range	110-300 VDC (for ITE only)		
Frequency	85-276 VAC (DC input range 88-375 VDC) 47-63Hz		
	47-03F1Z < 5.27 A @ 100 VAC, < 2.48 A @ 230 VAC		
Nominal current	< 5.00 A @ 110 VDC, < 3.00 A @ 300 VDC		
Inrush current limitation (+25°C, cold start)	9 A typ. @ 120 VAC, 7 A typ. @ 230 VAC		
Mains buffering at nominal load (typ.)	32 ms typ. @ 120 VAC & 230 VAC		
Turn-on time	610 ms typ. @ 120 VAC, 660 ms typ. @ 230 VAC		
Internal fuse	T 8 A / 500 VAC or 400 VDC min.		
	TN/TT-system / IT-system: < 0.34 mA / 0.79 mA @ 110 VAC, 50Hz		
Leakage current	TN/TT-system / IT-system: < 0.45 mA / 1.13 mA @ 132 VAC, 50Hz		
	TN/TT-system / IT-system: < 0.84 mA / 2.15 mA @ 264 VAC, 50Hz		
Output (DC)			
Nominal output voltage U_N	24 VDC		
Adjustment range of the voltage	24-28 VDC		
	20 A (Vout = 24 VDC)		
Nominal current	17 A (Vout = 28 VDC)		
	30 A (for 5 s, Vout = 24 VDC)		
	25.5 A (for 5 s, Vout = 28 VDC) > 60°C [140°F] (2.5% / °C) in Vertical		
Derating	> 40°C [140°F] (2.5% / °C) in Horizontal		
Startup with capacitive loads	20,000 µF typ.		
Max. power dissipation idling / nominal load approx.	10W / 31.4W		
Efficiency	92.4% typ. @ 120 VAC, 93.9% typ. @ 230 VAC		
PARD (20MHz) at 100% load	< 100 mVpp		
Max. relay contact rating	30V (SELV) / 1 A resistive load		
Parallel operation	PSB60-REM40S		
General Data			
Type of housing	Aluminum		
	Green LED DC OK		
Signals	Red LED Overload		
MTBF	> 778,800 hrs. as per Telcordia SR-332		
	(I/P: 100 VAC; O/P: 24V, 20 A; Ta: 25°C)		
Dimensions (L x W x H)	124 mm x 82 mm x 117 mm [4.88 in x 3.23 in x 4.61 in]		
Weight	1.4 kg [3.09 lb]		
Connection method	Screw connection		
Wire size / torque	See Table 1		
Stripping length	7 mm [0.28 in]		
Operating temperature (surrounding air temperature)	-25°C to +70°C [-13°F to 158°F] (Refer to Fig. 7)		
Storage temperature Humidity at +25°C, no condensation	-40°C to +85°C [-40°F to 185°F] 5 to 95% RH		
Vibration (non-operating)	10 to 500Hz @ 30m/S² (3G peak); displacement of 0.35mm; 60 min. per axis for all X, Y, Z directions in acc. with IEC60068-2-6		
Shock (non-operating, in all directions)	30G (300m/S²) in all directions according to IEC60068-2-27		
Pollution degree	300 (300H)3") III all directions according to IEC00000-2-27		
Altitude (operating)	5000m; 2500m for IEC/EN61558		
Certification and Standards	3000H, 2300HHU IEQ/EN01330		
	IFOCOCA 4 (consultant all III)		
Electrical equipment of machines	IEC60204-1 (over voltage category III)		
Electronic equipment for use in electrical power installations	IEC/EN 62477-1 / IEC62103 PELV (EN 60204-1), SELV (EN 60950-1)		
Safety entry low voltage	VL/C-UL recognized to UL60950-1 and CSA C22.2 No. 60950-1 (File No. E198298),		
Electrical safety (of information technology equipment)	CB scheme to IEC 60950-1, IEC 61558-1, IEC 61558-2-16, IEC 61010-1, IEC 61010-2-201		
Industrial control equipment	UL/C-UL listed to UL508 and CSA C22.2 No. 107.1-01 (File No. E197592), CSA to CSA C22.2 No. 107.1-01 (File No. 249074)		
CE	In conformance with EMC directive 2014/30/EU and low voltage directive 2014/35/EU		
Component power supply for general use	EN61204-3		
	EN 55024, EN 61000-6-2		
Immunity	(EN61000-4-2, 3, 4, 5, 6, 8, 11, 12)		
Emission	EN55032, EN55011, EN61000-3-2 Class A, EN61000-3-3, EN61000-6-3		
	249074		
	C(U) E197592		
CE	LIETED C TABUS (SA)		
	Ind. Cont. Eq. E198298		
D 110.0			
RoHS Compliant	Yes		
Safety and Protection			
Transient surge voltage protection	VARISTOR		
Current limitation at short-circuits approx.	Isurge = 150 % of Pomax typically (hiccup mode)		
Surge voltage protection against internal surge voltages	Yes		
Isolation voltage:	454000		
Input / Output	4.54 KVAC		
Input / PE	2.50 KVAC		
Input / DC OK*	4.54 kVAC		
Output / PE Output / DC OK	1.50 kVAC		
DC OK / PE	0.50 kVAC 1.50 kVAC		
Protection degree	IP20		
Safety class	Class I with GND connection		
*Recommend connecting DC OK pins to output pins.	Trace i mai dire comiccion		

^{*}Recommend connecting DC OK pins to output pins.