

# Installation manual for PSC1 modules


Series

PSC1-C-100

PSC1-E-2x

PSC1-E-3x-RIO

PSC1-E-13x

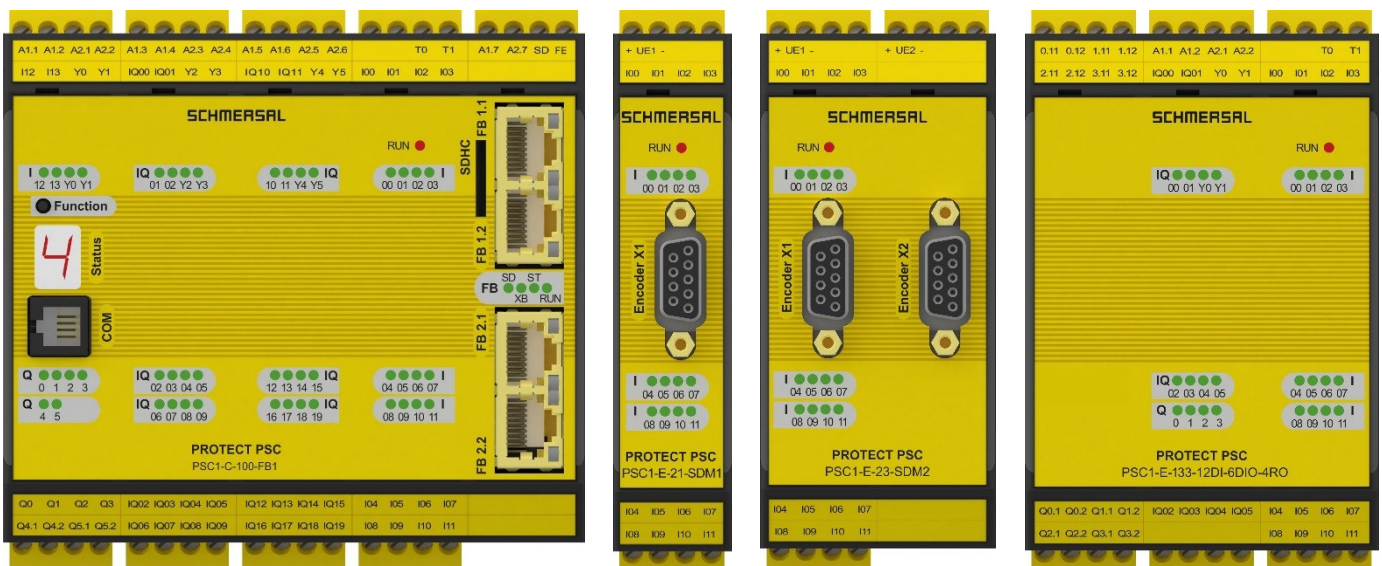

Installation instructions for basic devices in the series PSC1-C-100

- PSC1-C-100
- PSC1-C-100-MC<sup>(1)</sup>
- PSC1-C-100-FBx<sup>(2)</sup>

and their expansion modules

- PSC1-E-21-SDM1
- PSC1-E-22-SDM1-2
- PSC1-E-23-SDM2
- PSC1-E-24-SDM2-2
  
- PSC1-E-131-12DI-10DIO
- PSC1-E-133-12DI-6DIO-4RO
- PSC1-E-37-14DI-4DO-2RO-RIO
- PSC1-E-38-14DI-4DO-10DIO-2RO-RIO

Options:

- <sup>(1)</sup> Memory Card to store the configuration, the program and the data; see chapter 0
- <sup>(2)</sup> For version see: "Optional universal communication interface"

## **Note:**

The German version is the original version of the installation instructions

As of: 08/2023

Valid from firmware release	Master	04-00-00-01
	Central slave	04-00-00-01
	Decentral slave	01-00-00-01

## **Subject to technical change without notice.**

The content of this documentation has been prepared with the greatest possible care and corresponds to the latest information available to us.

Nevertheless, we draw your attention to that fact that this document cannot always be updated simultaneously with the further technical development of our products.

Information and specifications may be changed at any time. Please obtain information on the latest version at: [www.schmersal.net](http://www.schmersal.net).

K. A. Schmersal GmbH & Co. KG  
Möddinghofe 30  
D - 42279 Wuppertal

## Revision history

Version-No.	Date	Comment
V 1.0	Feb 2 <sup>nd</sup> , 2017	Release
- V 2.0	May 2 <sup>nd</sup> , 2018	Editorial changes
V 2.1	Oct 31 <sup>th</sup> , 2018	Terminal designation CPU-ENC/ENC adapted, DC value specified for 2x Proxy 2, X22 without function with PSC1-E-(1)33-..., CANopen added, Reference to protective circuit for contactors, etc., Additional reference to derating in Chap. 4.3.4, Note on the use of the read-back contacts on the PSC1-E-(1)33-... module,
V 2.2	May, 2020	Programming examples converted to SafePLC2 Editorial changes
V 2.3	March, 2021	Editorial changes Chap. 5.2, 5.5, 5.6, 5.7.7. complemented. Chap. 3.7.2.5, 4.3.4, 4.3.5.3, 3.7.4: Notes added Chap. 3.9.1.: Scope of delivery amended
V 2.4	May, 2021	Editorial changes
V 2.5	December, 2021	5.12.2.6 reworked
V 2.6	June, 2022	Chap. 5.5.1 added Chap. 5.8, 5.9.1, 5.11.2ff substantiated
V 2.7	March, 2023	'In preparation', 'on request' removed Chapter 'Type code' added References to FB10/FB20 added
V 2.8	September, 2023	Current declaration of conformity added
V 2.9	January, 2024	PSC1-E-38 added 5.12.2.6 specified
V 2.10	February, 2025	Chapter 5.5.3 added Editorial changes

## Contents

<b>1</b>	<b>IMPORTANT NOTES .....</b>	<b>7</b>
1.1	Definitions .....	7
1.2	Reference documents .....	8
1.3	Abbreviations used .....	9
<b>2</b>	<b>SAFETY INSTRUCTIONS .....</b>	<b>11</b>
2.1	Intended use.....	11
2.2	Usage in regions with UL/CSA requirement .....	11
2.3	General safety instructions .....	12
2.4	Operating and service .....	13
2.5	Transport/storage .....	13
<b>3</b>	<b>DEVICE TYPES .....</b>	<b>14</b>
3.1	Type code .....	15
3.2	Module overview.....	16
3.3	Device characteristic data.....	18
3.3.1	Base modules .....	18
3.3.1.1	PSC1-C-100 (-FBx <sup>(1)</sup> ) (-MC) .....	18
3.3.2	Central expansion modules .....	22
3.3.2.1	Expansion module PSC1-E-21-SDM1 .....	22
3.3.2.2	Expansion module PSC1-E-22-SDM1-2 .....	24
3.3.2.3	Expansion module PSC1-E-23-SDM2 .....	26
3.3.2.4	Expansion module PSC1-E-24-SDM2-2 .....	28
3.3.2.5	Expansion modules PSC1-E-131 and PSC1-E-133.....	30
3.3.3	Decentral expansion module .....	33
3.3.3.1	PSC1-E-37/38.....	33
3.3.4	Optional universal communication interface.....	36
3.3.4.1	Tech. characteristic data: Optional universal communication interface .....	37
3.4	Derating outputs .....	38
3.5	Marking .....	38
3.5.1	Type plate .....	38
3.5.2	Items supplied.....	39
<b>4</b>	<b>SAFETY-RELATED FEATURES .....</b>	<b>40</b>
4.1	General layout, safety-related architecture and characteristic data .....	40
4.2	Safety-related characteristic data and circuitry for sensors connected .....	44
4.2.1	Digital sensors .....	44
4.2.1.1	Characteristics of the sensors / input elements.....	44
4.2.1.2	DC digital sensors/inputs .....	45
4.2.1.3	Classification of the safe digital inputs.....	49
4.2.1.4	Connection examples, digital sensors/safety switch .....	51
4.2.1.5	Overview of achievable PL for digital safety inputs .....	56
4.2.2	Sensors for speed and/or position acquisition.....	58
4.2.2.1	General safety-related layout of sensor interface for position and/or speed .....	58
4.2.2.2	General diagnostic measures for encoder interface.....	59
4.2.2.3	Encoder types and their combinations, diagnostic characteristic data.....	60
4.2.2.4	Specific diagnostic measures in relation to the encoder type used .....	63
4.2.2.5	Safety-related shutdown thresholds, encoder systems for position and speed acquisition .....	64
4.2.2.6	Safety-related assessment of the encoder types and their combination.....	67
4.3	Safety-related characteristic data and circuitry for the outputs.....	69
4.3.1	Characteristics of the output elements .....	69
4.3.2	Diagnostics in the shutdown circuit .....	71
4.3.2.1	Diagnostic functions .....	71
4.3.2.2	Overview of DC in relation to selected diagnostic functions .....	72
4.3.3	Permissible capacitive and inductive load on safe outputs .....	73
4.3.4	Digital outputs .....	74
4.3.4.1	Example circuits, basic outputs .....	76
4.3.5	Digital outputs I/O (IQQx) .....	83
4.3.5.1	Classification of the I/O (IQQx) when used as an output .....	83

4.3.5.2	Example circuits for safe digital outputs I/O (IQQx)	84
4.3.5.3	Overview of achievable PL for digital safety outputs	89
<b>5</b>	<b>CONNECTION AND INSTALLATION</b>	<b>91</b>
5.1	General installation instructions	91
5.2	Installation and mounting PSC1 module	93
5.3	Mounting backplane bus	93
5.3.1	Arrangement examples	94
5.3.1.1	PSC1-C-100-FBx + PSC1-E-23-SDM2	94
5.3.1.2	PSC1-C-100 + PSC1-E-24-SDM2-2	94
5.4	Mounting the modules	95
5.4.1	5.4.1 Mounting on C rail	95
5.4.2	Mounting on backplane bus	96
5.5	Installation and configuration of master ↔ master (SMMC) and master ↔ slave (SDDC)	97
5.5.1	SMMC/SDDC topology rules	98
5.5.2	Exemplary schematic diagram of a network topology	99
5.5.3	Use of serial number 0 for decentralised SDDC communication	100
5.6	Installation of I/O expansion	102
5.6.1	Physical address configuration for the slave modules (central/decentral)	102
5.7	Terminal assignment	103
5.7.1	Terminal assignment PSC1-C-100 (-FBx/-MC)	103
5.7.2	Terminal assignment PSC1-E-21-SDM1	105
5.7.3	Terminal assignment PSC1-E-22-SDM1-2	106
5.7.4	Terminal assignment PSC1-E-23-SDM2	108
5.7.5	Terminal assignment PSC1-E-24-SDM2-2	110
5.7.6	Terminal assignment PSC1-E-131	113
5.7.7	Terminal assignment PSC1-E-133	114
5.7.8	Terminal assignment PSC1-E-37	116
5.7.9	Terminal assignment PSC1-E-38	117
5.8	External 24 VDC power supply	119
5.9	Connection of the external encoder supply	121
5.9.1	Incremental, HTL, SIN/COS, SSI	121
5.9.2	Resolver	122
5.10	Connection of the digital inputs	123
5.11	Connection of position and speed sensors	124
5.11.1	General instructions	124
5.11.2	Pin assignment on the encoder interface	126
5.11.3	Connection variants	127
5.11.3.1	Connection of an absolute encoder as master	127
5.11.3.2	Connection of an absolute encoder as slave	128
5.11.3.3	Connection of an incremental encoder with TTL signal level	129
5.11.3.4	Connection of a SIN/COS encoder	130
5.11.3.5	Connection of resolver as master	131
5.11.3.6	Connection of resolver as slave	132
5.11.3.7	Connection of proximity switches	133
5.11.3.8	Connection of HTL/proximity switches	134
5.12	Configuration of the measurement sections	136
5.12.1	General description of the encoder configuration	136
5.12.2	Sensor type	136
5.12.2.1	Absolute encoder:	136
5.12.2.2	Incremental encoder:	138
5.12.2.3	SineCosine encoder – standard mode	138
5.12.2.4	SineCosine encoder – high-resolution mode:	139
5.12.2.5	Proximity switch	139
5.12.2.6	Extended monitoring with 2 proximity switches	140
5.12.2.7	HTL sensor	141
5.12.2.8	Resolver	141
<b>6</b>	<b>RESPONSE TIMES OF THE PSC1</b>	<b>142</b>
6.1	Response times in standard operation	143
6.2	Response times for FAST_CHANNEL	144
6.3	Response times for overspeed distance monitoring	144

6.4	Response times when using the inputs and outputs on the expansion modules.....	146
<b>7</b>	<b>COMMISSIONING .....</b>	<b>148</b>
7.1	Procedure .....	148
7.2	Sequences for switching on .....	148
7.3	Reset behaviour.....	150
7.3.1	Reset types and triggering element.....	150
7.3.2	Reset timing.....	151
7.3.3	Reset function.....	151
7.3.3.1	Example reset function with protection against incorrect usage .....	153
7.4	LED indication.....	156
7.5	Parameter configuration.....	157
7.5.1	Using the Memory Card.....	157
7.6	Function check.....	158
7.7	Validation .....	158
<b>8</b>	<b>SAFETY-RELATED CHECK .....</b>	<b>159</b>
<b>9</b>	<b>MAINTENANCE .....</b>	<b>160</b>
9.1	Modification / dealing with changes to the device .....	160
9.2	Replacement of a module.....	160
9.3	Servicing interval .....	160
<b>10</b>	<b>TECHNICAL SPECIFICATIONS .....</b>	<b>161</b>
10.1	Ambient conditions .....	161
10.2	Safety-related characteristic data .....	161
<b>11</b>	<b>SWITCH TYPES .....</b>	<b>162</b>
<b>12</b>	<b>NOTES FOR DESIGNING, PROGRAMMING, VALIDATING AND TESTING</b>	
	<b>SAFETY-RELATED APPLICATIONS.....</b>	<b>168</b>
12.1	Risk assessment.....	168
12.2	Technical documentation required .....	170
12.3	Steps required for designing, realisation and testing .....	171
12.3.1	Phases of the V model .....	172
12.3.2	Specification of the safety requirements (breakdown) .....	173
12.3.3	Specification of the functional safety system.....	176
12.3.3.1	Definition of the safety functions.....	176
12.3.3.2	Performance Level required (PLr) (additional emergency stop) .....	177
12.3.3.3	Example – specification of the safety functions in tabular form .....	178
12.3.4	Software specification.....	179
12.3.5	Hardware specification .....	181
12.3.5.1	Selection of SRP/CS and equipment .....	181
12.3.5.2	Examples for hardware specification.....	182
12.3.5.3	Consideration of systematic failures.....	183
12.3.6	Hardware and software design.....	185
12.3.7	Check of the hardware design.....	185
12.3.7.1	Iterative check on the safety level achieved .....	185
12.3.8	Verification of software (program) and parameters .....	188
12.3.8.1	FUP check .....	188
12.3.8.2	Validating FUP against IL and parameters using validation report .....	190
12.3.9	Performance of system tests / FIT test (Fault Injection Test).....	192
<b>13</b>	<b>APPENDIX .....</b>	<b>193</b>
13.1	Appendix A – categorisation of the switch types .....	193
13.2	CE – declaration of conformity.....	196

## 1 Important notes

The documentation is part of the product and contains important information on integrating the module, as well as on their operation and service. The programming and parameterization of the devices are described in the programming manual. Exact knowledge and understanding of these are an essential prerequisite for installing or modifying the device function or device parameters.

The documentation is intended for all persons who deal with integration and installation planning and who carry out assembly, installation, commissioning and service work on the product.

Make sure that those responsible for planning and integration, system and operation, as well as persons who work independently with the modules, have read and understood the documentation completely.

The documentation must be made accessible to this group of people in a legible condition.

### 1.1 Definitions

The term PSC1 is used as the generic term for all derivatives of the PSC1 product line. If reference is made to a specific derivative in the description, the complete identifier is used.

The term "safe" used in the following refers to categorisation as a safe function for usage up to PL e according to EN ISO 13849-1 or SIL3 according to EN 61508.

The system software "SafePLC2" is used to configure and program the PSC1 modules.

Internally the modules in series PSC1 comprise two independent processing units. These are termed system A and system B in the following.

## 1.2 Reference documents

<i>Description</i>	<i>Reference</i>
Configuration of the PSC1 module with the "SafePLC2" programming system	Programming manual SafePLC2
Validation report on the parameter configuration implemented and the PLC program	Safety-related test with acceptance report
Acceptance for general safety-related applications	Certificate on the type test for safety control according to Machinery directive 2006/42/EC for product modules  PSC1-C-100 PSC1-C-100-MC <sup>(1)</sup> PSC1-C-100-FBx <sup>(2)</sup>  PSC1-E-21-SDM1 PSC1-E-22-SDM1-2 PSC1-E-23-SDM2 PSC1-E-24-SDM2-2  PSC1-E-131-12DI-10DIO PSC1-E-133-12DI-6DIO-4RO PSC1-E-37-14DI-4DO-2RO-RIO PSC1-E-38-14DI-4DO-10DIO-2RO-RIO

Options:

<sup>(1)</sup> Memory Card to store the configuration, the program and the data; see under:

<sup>(2)</sup> For version see: "Optional universal communication interface"

### **Note:**

- Read this manual carefully before you start the installation and commissioning of the PSC1 modules.
- Observing the documentation is a requirement for fault-free operation and the acceptance of claims under warranty.

## 1.3 Abbreviations used

Abbreviation	Meaning
AC	Alternating Current
IL	Instruction List
BGIA (IFA)	Institute for Industrial Safety at the DGUV (German Statutory Accident Prevention Association)
CLK	Here: SSI systems clock
CPU	Central Processing Unit
DC	Direct Current
DIN	Deutsches Institut für Normung
DO	Digital Output
ECFS	EtherCAT Fail Safe; EtherCAT FSoE (Fail Safe over EtherCAT)
EMU EDM	Emergency Monitoring Unit (External Device Monitoring)
EMC	Electromagnetic Compatibility
EN	European Norm
Encoder	Position measuring system (position, angle)
Encoder interfaces	Electrical connection feature for an individual encoder (rotary encoder or proximity switch)
FW	Firmware; software embedded in electronic devices (embedded software)
G.P.	UL rating; also known as "general use"
HISIDE	Output that switches to positive with 24 VDC nominal level
I00..I13	Digital Input
IQIx	Configurable safe digital I/Os; version: Input
IQQx	Configurable safe digital I/Os; version: Output
IPxx	Degree of protection for housing
Ix.y <sup>(1)</sup>	Digital Input
ISO	International Organisation for Standardisation
LED	Light Emitting Diode
LOSIDE	Output that switches to reference potential
n.a.	<b>not applicable</b>
OLC	Operational Limit Control

PAA	Prozessabbild der Ausgänge (Process image of the outputs)
PAE	Prozessabbild der Eingänge (Process image of the inputs)
PES	Programmable electronic control
Pilot duty	UL Rating
Qx.y <sup>(1)</sup>	Digital Output
T0,T1	Pulse outputs
TB(1)	T bus connector (backplane bus)
PELV	Protective Extra Low Voltage
PLC	Programmable Logic Controller
SD bus	Serial diagnostic bus for electronic Schmersal safety switches
SDDC	Safe Device-Device Communication
SELV	Safety Extra Low Voltage
SMMC	Safe Master-Master Communication
SRP/CS	Safety related parts of a control system
SSI	Synchronous Serial Interface
SW	Software; here: safety-related application software
VDE	Verband der Elektrotechnik, Elektronik und Informationstechnik e. V.
Yx.y <sup>(1)</sup>	Auxiliary output

<sup>(1)</sup>    Module address        x = 0 ..... 8  
       Channel address       y = 0 ..... 39

## 2 Safety instructions

### 2.1 Intended use

The devices in the series PSC1-C-100 are programmable safety controllers for providing safety shutdown and safety functions. The devices are intended for usage

- In EMERGENCY STOP systems,
- As a safety component in the context of the EC Machinery directive 2006/42/EC,
- As PES for risk reduction in the context of IEC 61508,
- In safety circuits according to IEC 60204-1 and IEC 60204-32,
- As PES for functional safety in the context of IEC 62061,
- As SRP/CS in the context of EN ISO 13849,
- As a device for providing safety functions according to IEC 61800-5-2,
- As a logic unit for signal conversion and signal processing in a two-hand circuit according to EN 13851.



The devices in series PSC1-C-100 incl. expansion modules are safety components as per Annex IV EC Machinery Directive 2006/42/EC.

They have been developed, designed and manufactured according to the above-mentioned directive, as well as the EC directive 2014/30/EU

Cf. Appendix EC declaration of conformity

### 2.2 Usage in regions with UL/CSA requirement

The PSC1 series has a cULus approval with the following standards:

Basic standard(s):	UL 61010-1, 3rd Edition, May 11, 2012, Revised July 15 2015, CAN/CSAC22.2 No. 61010-1-12, 3rd Edition, Revision dated July 2015
Extended standards:	UL/CSA 61010-2-201: 2014 (First Edition)

## 2.3 General safety instructions



### Safety instructions:

- To prevent injury and damage, only qualified personnel is allowed to work on the device. Qualified personnel are personnel who have electrical engineering training and who are familiar with the applicable rules and standards of electrical engineering.
- The qualified person must familiarise himself with the operating instructions (cf. IEC 364, DIN VDE 0100).
- The qualified person must have, as a minimum, detailed knowledge of national health and safety regulations
- The usage of the devices is to be limited to their intended usage as per the list given above. The values in the data listed in section "3.2. Device characteristic data" are also to be met.
- The content of these installation instructions is limited to the basic function of the devices and their installation. The programming of the devices and re-configuration of the device parameters is further described in the "Programming instructions SafePLC2". Detailed knowledge and understanding of this information are a vital prerequisite for a new installation or the modification of the device function or device parameters.
- Commissioning (i.e. commencing operated as intended) is only allowed on compliance with the EMC directive. The EMC test standards EN55011:2009 + A2:2010 and EN 61000-6-2:2005 are used as the basis.
- For storage and transport, the conditions according to IEC 60068-2-6 in relation to the values stated in "Tech. characteristic data" must be met
- It is imperative the wiring and connection instructions in the section "Installation" are followed.
- The applicable VDE regulations as well as other special safety regulations for the specific application must be followed.
- The monitoring functions configured as well as their parameters and operators must be validated via a validation report.
- The module's implementation is to be agreed with the responsible body (e.g. TÜV or BG).
- Never install or place in operation damaged products. Please report any damage immediately to the transport company.
- Never open the housing and/or make unauthorised modifications.
- Inputs and outputs for standard functions and the digital and analogue data transmitted via communication interface are not allowed to be used for safety-related applications.

### WARNING:

The usage of our devices contrary to the rules and conditions stated here can result in the injury or the death of persons, as well as damage to the devices and machines connected!

This usage will also render void any claim under the warranty or any claim for claim damages against the manufacturer.

## 2.4 Operating and service

Prior to installing and removing the module, or disconnecting the signal wires, the module is to be electrically isolated. For this purpose all electrically live supply wires to the device are to be switched off and it is to be checked that there is no electrical power present on the wires.

During the installation and removal of the module, appropriate measures are to be taken to prevent electrostatic discharges on the external terminals and connections. Contact with these terminals should therefore remain limited to a minimum; prior to and during this work you should be earthed, e.g. using an earthing wrist strap.

## 2.5 Transport/storage

The instructions on transport, storage and correct handling are to be followed.  
The climatic specifications as per the sec. "Technical data" are to be met.

## 3 Device types

The series PSC1-C-100 comprises

- The basic devices PSC1-C-100 optionally with
  - o Integrated communication modules
    - Standard fieldbus PSC1-C-100-FBx<sup>(1)</sup> or
    - Safe fieldbus PSC1-C-100-FB x<sup>(1)</sup>-y<sup>(1)</sup>
  - These options usually have an SD memory card slot on board as a minimum.
  - o Integrated SD memory card slot
    - PSC1-C-100-MC
- The central I/O expansion modules PSC1-E-131-... and PSC1-E-133-...
- The decentral I/O expansion modules PSC1-E-37-... and PSC1-E-38-...
- The central axis expansion modules PSC1-E-21-SDM1, PSC1-E-22-SDM1-2, PSC1-E-23-SDM2 and PSC1-E-24-SDM2-2

### **Base modules**

The series PSC1-C-100 series is a modular safety controller. The device is freely programmable for the safe processing of EMERGENCY STOP buttons, two-hand controls, light barriers, operating mode selector switches, etc. and also drive-related safety functions. For the safety-related signal processing, pre-configured blocks are available for a large number of input devices. The same applies for safety functions for drive monitoring. You will find more details in the programming manual.

In the basic version the device has 14 safe inputs and up to 25/23 safe 2-channel shutdown channels. (4x PP or 2x PN semiconductor outputs, 1x 2-channel relay output, 20x safe switchable inputs/PP semiconductor outputs)

For safe speed and/or position acquisition, 1-encoder solutions and 2-encoder solutions are supported. See "Encoder specifications".

### **Expansion modules**

Central or decentral I/O or axis expansion modules for the PSC1-C-100 series.

A maximum of 8 expansion modules can be connected to a system, of these 6 axis expansion modules can be used.


### **Integrated communication interface**

The communication interface has bidirectional data transmission from and to a higher-level controller using a standard fieldbus or safe standard fieldbus.


<sup>(1)</sup>For version see: "Optional universal communication interface"

## 3.1 Type code



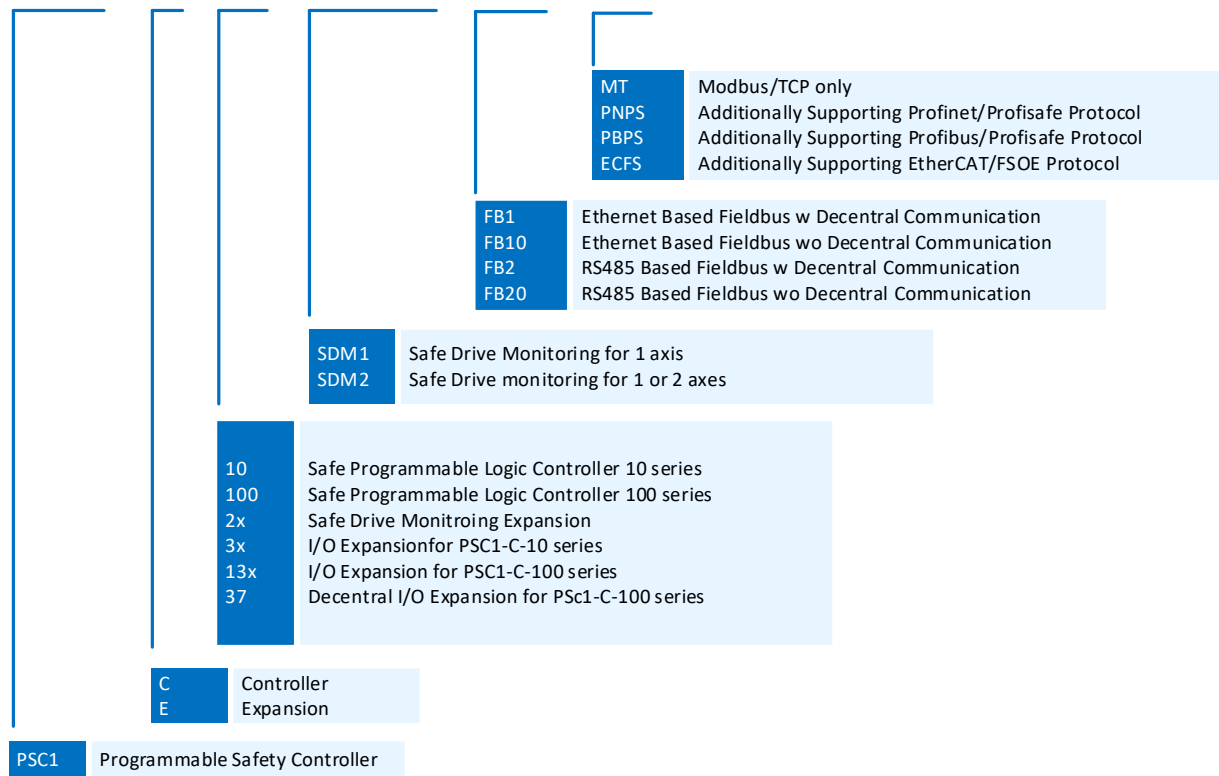



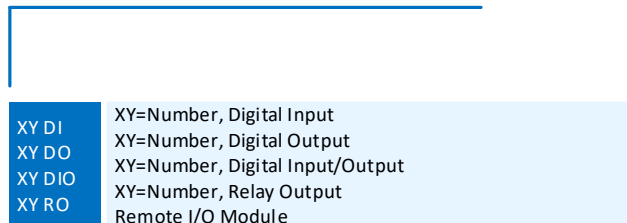


### PSC1 - C - 10 - SDM1 - FB1 - MT



### PSC1 - E - 37 - 14DI - 4DO - 2RO - RIO



## 3.2 Module overview

Basic modules		Expansion modules							
Designation	PSC1-C-100(-FBx)	PSC1-E-131-12DI-10DIO	PSC1-E-133-12DI-6DIO-4RO	PSC1-E-37-14DI-4DO-2RO-RIO	PSC1-E-38-14DI-4DO-10DIO-2RO-RIO	PSC1-E-21-SDM1	PSC1-E-22-SDM1-2**	PSC1-E-23-SDM2	PSC1-E-24-SDM2-2
									
General data									
Max. number of expansion modules	8*	-	-	-	-	6	6	6	6
Safe digital inputs	14	12	12	14	14	12	12	12	12
Safe digital I/O	20	10	6	-	10				
Safe digital outputs pn switching / pp switching	2/4	-	-	2/4	2/4				
Safe analogue inputs	-	-	-	-	-				
Relay outputs (1-channel)	2	-	4	2	2				
Signal outputs	6	2	2	2	4				
Pulse outputs	2	2	2	2	2				
Integrated communication interface	<b>FB1</b> = EtherNet/IP, PROFINET, EtherCAT <b>FB1-PNPS</b> = FB1 + PROFINET + PROFIsafe <b>FB1-ECFS</b> = FB1 + EtherCAT + FSoE <b>FB2</b> = PROFIBUS, CANopen <b>FB2-PBPS</b> = FB2 + PROFIBUS + PROFIsafe	-	-	-	-				
Axis monitoring	-	-	-	-	-	1	1 (expanded)	2	2 (expanded)
Encoder technology	-	-	-	-	-	SSI SIN/COS Incr. TTL Proximity switch	SSI SIN/COS Incr. TTL Proximity switch Resolver Incr. HTL	SSI SIN/COS Incr. TTL Proximity switch	SSI SIN/COS Incr. TTL Proximity switch Resolver Incr. HTL
Technical specifications									
See technical characteristic data for the related module									


---

Options:           \*)   Of these maximum 6 axis modules  
                      \*\*)   Module can be configured for 1-axis drive (any encoder technology) or 2-axis drive (only 1 SSI per axis)

## 3.3 Device characteristic data

### 3.3.1 Base modules

#### 3.3.1.1 PSC1-C-100 (-FBx<sup>(1)</sup>) (-MC)

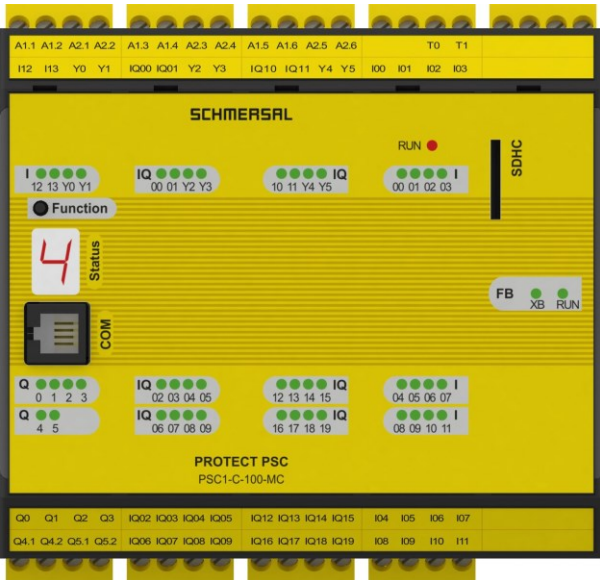Type designation	Device features
	<p>Version of the module with following peripherals:</p> <ul style="list-style-type: none"> <li>14 digital inputs</li> <li>2 pulse outputs</li> <li>20 digital I/Os</li> <li>2 relay outputs (1-channel)</li> <li>2/4 pn or pp switching outputs</li> <li>6 signal outputs</li> <li>1 diagnostics and configuration interface</li> <li>1 function button</li> <li>1 7-segment display</li> <li>1 status LED</li> <li>14 status LEDs for inputs</li> <li>6 status LEDs for signal outputs</li> <li>2 status LEDs for relay outputs</li> <li>4 status LEDs for outputs</li> <li>20 status LEDs for I/Os</li> <li>1 optional: Communication interface incl. memory card slot (-FBx<sup>(1)</sup>)</li> <li>1 optional: Memory card slot (-MC)</li> </ul>

#### Properties of the module:

- Can be expanded to:
  - Max. 126 safe digital inputs,
  - Max. 36 safe digital outputs,
  - Max. 100 safe digital I/O,
  - Max. 17 safe relay outputs (2-channel),
  - Max. 38 signal outputs
  - And/or 12 safe axes
- Logic processing up to PL e according to EN ISO 13849-1 or SIL 3 according to IEC 61508
- Freely programmable modular controller for up to 3000 IL instructions
- Function plan-orientated programming
- Pulse outputs for cross-circuit detection on digital input signals
- External contact monitoring on switchgear connected (EMU)
- Monitored relay outputs for safety-related functions
- Switchable safe outputs pn, pp switching for safety-related functions
- Complete speed and position-related safety functions for drive monitoring as per IEC 61800-5-2 integrated into firmware

- Parameter administration for expansion modules in the base device
- Contact multiplication or contact rating increase by means of external contactors in conjunction with integrated monitoring possible
- Comprehensive diagnostic functions integrated in the firmware
- Coded status indication via 7-segment display and status LEDs on front
- Multi-function button (Confirmation, Start, Reset) can be operated from the front
- Optional: Communication interface incl. memory card slot
  - Standard and safe fieldbus protocols for communication with a higher-level controller
  - Safe cross-communication for the exchange of data between several basic devices
  - Safe remote IO communication for the exchange of data with distributed IO systems
  - Serial diagnostic bus "SD bus"
  - See: Section 3.3.4 Optional universal communication interface
- Optional: Memory card slot (-MC)
- Mounting on DIN rail
- The mechanical layout of the PSC1-C-100 (-FBx) is different to the figure. (See mechanical data)

## 3.3.1.1.1 Tech. characteristic data PSC1-C-100 (-FBx<sup>(1)</sup>)

Safety-related characteristic data				
	PL according to EN ISO 13849		max. PL e	
	PFH / architecture		12.2 * 10 <sup>-9</sup> / KAT 4	
	SIL according to IEC 61508		SIL 3	
	Proof test interval		20 years = max. service life	
General data				
	Max. number of expansion modules		8 *	
	Interface for expansion modules		T-bus connector, can be plugged into DIN rail	
	Number of safe digital inputs		14 (OSSD support)	
	Number of safe digital outputs			
	pn switching** or		2	
	pp switching **		4	
	Number of safe digital I/O		20	
	Number of relay outputs (1-channel)		2	
	Number of safe analogue inputs		-	
	Number of signal outputs		6	
	Number of pulse outputs		2	
	Type of connection		Removable screw terminals	
	Axis monitoring		-	
Encoder interfaces (D-Sub / screw terminal)		-		
Encoder technology (See table Encoder specifications)		-		
Electrical data				
	Supply voltage (tolerance)		24 VDC; 2A (-15%, +20%)	
	Fuse	A1.1	min. 30 VDC; max. 3.15A	
		A1.2	min. 30 VDC; max. 10A	
		A1.3		bypassed
		A1.4		
		A1.5		bypassed
		A1.6		
	Max. power consumption (logic)			
		PSC1-C-100	3.5W	
		PSC1-C-100 (-FBx <sup>(1)</sup> )	6.9W	
	Rated data digital inputs		24 VDC/ 20 mA, type 1 according to ISO 61131-2	
	Rated data digital outputs			
		pn switching	24 VDC/2 A ***	
		pp switching	24 VDC/2 A ***	
		Signal outputs	24 VDC; 250mA	
		Pulse outputs	24 VDC; 250mA	
	Rated data digital I/O			
		0 - 4, 10 - 14	24 VDC/ 0.5 A	
		5 - 9, 15 - 19	24 VDC/2 A ***	
	Rated data relay			
	NO	24 VDC/ 2 A		
	DC13 AC15	230 VAC/2 A		
Rated data analogue inputs		-		
Electrical data (only for UL)				
	Rated data digital outputs			
		pn switching	Temperature rating 30°C	24 VDC; 2A (G.P.)
			Temperature rating 50°C	24 VDC; 1.8A (G.P.)
		pp switching	Temperature rating 30°C	24 VDC; 2A (G.P.)
			Temperature rating 50°C	24 VDC; 1.8A (G.P.)
		Max. cumulative current (pn or pp)		8A
		Auxiliary outputs		24 VDC; 250mA (G.P.)
		Rated data digital I/O		
			0 - 4, 10 - 14	24 VDC; 0.5A (G.P.)
	5 - 9, 15 - 19		Temperature rating 30°C	24 VDC; 2A (G.P.)
			Temperature rating 50°C	24 VDC; 1.8A (G.P.)
	Max. cumulative current I/O		10A	

	Rated data relay	Normally open contact	24 VDC; 2A (Pilot Duty) 120 VAC; 2A (Pilot Duty)
--	------------------	-----------------------	---


Environmental data		
	Temperature	0°C ... +50°C operation -25°C ... +70°C storage, transport
	Degree of protection	IP 20
	Climatic class	3k3 according to DIN 60 721-3
	Minimum, maximum relative humidity (no condensation)	5% - 85%
	EMC	EN 61000-6-2, EN 61000-6-4, EN 61000-6-7, EN 61800-3, EN 61326-3, EN 62061
	Use of operating equipment	2000m
	Overvoltage category	III
	Level of contamination	2
Mechanical data		
	Size (HxDxW [mm])	PSC1-C-100 = 100x115x90 PSC1-C-100-(FBx <sup>(1)</sup> )/MC = 100x115x112.5
	Weight	PSC1-C-100 = 530 g PSC1-C-100-FBx <sup>(1)</sup> /MC = 630 g
	Attachment	Can be snapped to DIN rail
	Number of T-bus connectors	
	Included in the scope of delivery	
	PSC1-C-100	4
	PSC1-C-100-FBx <sup>(1)</sup> /MC	5
	Min. connection cross-section / IL	0.2 mm <sup>2</sup> / 24
	Max. connection cross-section / IL	2.5mm <sup>2</sup> / 12

## Options:

- (\*) Of these maximum 6 axis modules
- (\*\*) pn/pp can be configured via SafePLC2
- (\*\*\*) Derating, see section "Derating of outputs"
- (1) For version see: "Optional universal communication interface"

## 3.3.2 Central expansion modules

### 3.3.2.1 Expansion module PSC1-E-21-SDM1

Type designation	Device features
 <p>The image shows a yellow Schmersal PSC1-E-21-SDM1 expansion module. It features a terminal block at the top with pins labeled I00, I01, I02, and I03. Below this is a 'RUN' indicator with a red LED. There are two sets of status LEDs: the first set is labeled 'I' and '00 01 02 03', and the second set is labeled 'I' and '04 05 06 07'. Below the LEDs is a connector labeled 'Encoder X1'. At the bottom, there is another terminal block with pins labeled I04, I05, I06, I07, I08, I09, I10, and I11. The module is labeled 'PROTECT PSC PSC1-E-21-SDM1'.</p>	<p>Version of the module with following peripherals:</p> <ul style="list-style-type: none"> <li>1 axis</li> <li>3 encoder interfaces (*)</li> <li>12 digital inputs</li> <li>1 status LED</li> <li>12 status LEDs for inputs</li> </ul>

#### Properties of the module:

- Movement monitoring on an axis up to PL e according to EN ISO 13849-1 or SIL 3 as per IEC 61508
  - Velocity monitoring
  - Speed monitoring
  - Standstill monitoring
  - Direction of rotation monitoring
  - Safe increment
  - Emergency stop monitoring
  - Position monitoring
  - Position range monitoring
  - Movement range monitoring
  - Destination position monitoring
- Parameter administration for expansion modules in the basic device
- Comprehensive diagnostic functions integrated
- Mounting on DIN rail

## 3.3.2.1.1 Tech. characteristic data PSC1-E-21-SDM1

Safety-related characteristic data		
	PL according to EN ISO 13849	PL e
	PFH <sup>(1)</sup> /architecture	3 * 10 <sup>-9</sup> / KAT 4
	SIL according to IEC 61508	SIL 3
	Proof test interval	20 years = max. service life
General data		
	Max. number of expansion modules	-
	Interface for expansion modules	T-bus connector, can be plugged into DIN rail
	Number of safe digital inputs	12 (OSSD support)
	Number of safe digital outputs	-
	Number of safe digital I/O	-
	Number of relay outputs (1-channel)	-
	Number of safe analogue inputs	-
	Number of signal outputs	-
	Number of pulse outputs	-
	Type of connection	Removable screw terminals
	Axis monitoring	1
	Encoder interfaces (D-Sub / screw terminal)	1 / 2 (*)
	Encoder technology (See table Encoder specifications)	SSI, SinCos, TTL, proximity switch
Electrical data		
	Supply voltage (tolerance)	-
	Power consumption (logic)	-
	Rated data digital inputs	24 VDC/20 mA, type 1 according to IEC 61131-2
	Rated data digital outputs	-
	Rated data relay	-
	Rated data analogue inputs	-
	Rated data pulse outputs	-
	Rated data auxiliary outputs	-
Environmental data		
	Temperature	0°C ... +50°C operation -25°C ... +70°C storage, transport
	Degree of protection	IP 20
	Climatic class	3k3 according to DIN 60 721-3
	Minimum, maximum relative humidity (no condensation)	5% - 85%
	EMC	EN 61000-6-2, EN 61000-6-4, EN 61000-6-7, EN 61800-3, EN 61326-3, EN 62061
	Use of operating equipment	2000m
	Overvoltage category	III
	Level of contamination	2
Mechanical data		
	Size (HxDxW [mm])	PSC1-E-21-SDM1 = 100x115x22.5
	Weight	PSC1-E-21-SDM1 = 210 g
	Attachment	Can be snapped to DIN rail
	Number of T-bus connectors (included in the scope of delivery)	1
	Max. connection cross-section / IL	0.2 mm <sup>2</sup> / 24
	Min. connection cross-section / IL	2.5 mm <sup>2</sup> / 12


Options:

(\*)Maximum 2 encoders/axis

<sup>(1)</sup>Value only applies for expansion module. For an overall assessment according to EN ISO 13849, series connection with the related basic device must be used

$$\Rightarrow PFH_{Logic} = PFH_{Basic} + PFH_{Expansion}$$

## 3.3.2.2 Expansion module PSC1-E-22-SDM1-2

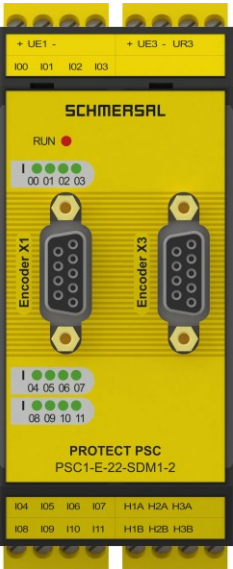Type designation	Device features
	<p>Version of the module with following peripherals:</p> <ul style="list-style-type: none"> <li>1 expanded axis</li> <li>5 encoder interfaces (*)</li> <li>12 digital inputs</li> <li>1 status LED</li> <li>12 status LEDs for inputs</li> </ul>

### Properties of the module:

- Movement monitoring on an axis up to PL e according to EN ISO 13849-1 or SIL 3 as per IEC 61508
  - Velocity monitoring
  - Speed monitoring
  - Standstill monitoring
  - Direction of rotation monitoring
  - Safe increment
  - Emergency stop monitoring
  - Position monitoring
  - Position range monitoring
  - Movement range monitoring
  - Destination position monitoring
- Parameter administration for expansion modules in the basic device
- Comprehensive diagnostic functions integrated
- Mounting on DIN rail
- Expanded functionality:
  - Permits the connection of 2 rotary encoders per axis (SSI, Sin/Cos, TTL, proximity switch)
  - 2nd encoder interface additionally supports HTL (200 kHz), Sin/Cos high-resolution and resolver

## 3.3.2.2.1 Tech. characteristic data PSC1-E-22-SDM1-2

Safety-related characteristic data		
	PL according to EN ISO 13849	PL e
	PFH <sup>(1)</sup> /architecture	3 * 10 <sup>-9</sup> / KAT 4
	SIL according to IEC 61508	SIL 3
	Proof test interval	20 years = max. service life
General data		
	Max. number of expansion modules	-
	Interface for expansion modules	T-bus connector, can be plugged into DIN rail
	Number of safe digital inputs	12 (OSSD support)
	Number of safe digital outputs	-
	Number of safe digital I/O	-
	Number of relay outputs (1-channel)	-
	Number of safe analogue inputs	-
	Number of signal outputs	-
	Number of pulse outputs	-
	Type of connection	Removable screw terminals
	Axis monitoring	1
	Encoder interfaces (D-Sub / screw terminal)	2 / 3 (*)
	Encoder technology (See table Encoder specifications)	1. Encoder: SSI, SinCos, TTL, proximity switch, 2. Encoder: additionally, HTL (200 kHz), SinCos (HiRes), resolver
Electrical data		
	Supply voltage (tolerance)	-
	Power consumption (logic)	-
	Rated data digital inputs	24 VDC; 20 mA, type 1 according to IEC 61131-2
	Rated data digital outputs	-
	Rated data relay	-
	Rated data analogue inputs	-
	Rated data pulse outputs	-
	Rated data auxiliary outputs	-
Environmental data		
	Temperature	0°C ... +50°C operation -25°C ... +70°C storage, transport
	Degree of protection	IP 20
	Climatic class	3k3 according to DIN 60 721-3
	Minimum, maximum relative humidity (no condensation)	5% - 85%
	EMC	EN 61000-6-2, EN 61000-6-4, EN 61000-6-7, EN 61800-3, EN 61326-3, EN 62061
	Use of operating equipment	2000m
	Overvoltage category	III
	Level of contamination	2
Mechanical data		
	Size (HxDxW [mm])	PSC1-E-22-SDM1-2 = 100x115x45
	Weight	PSC1-E-22-SDM1-2 = 390 g
	Attachment	Can be snapped to DIN rail
	Number of T-bus connectors (included in the scope of delivery)	2
	Max. connection cross-section / IL	0.2 mm <sup>2</sup> / 24
	Min. connection cross-section / IL	2.5 mm <sup>2</sup> / 12

Options:


(\*)Maximum 2 encoders/axis

<sup>(1)</sup>Value only applies for expansion module. For an overall assessment according to EN ISO 13849,

series connection with the related basic device must be used

=> PFH<sub>Logic</sub> = PFH<sub>Basic</sub> + PFH<sub>Expansion</sub>

## 3.3.2.3 Expansion module PSC1-E-23-SDM2

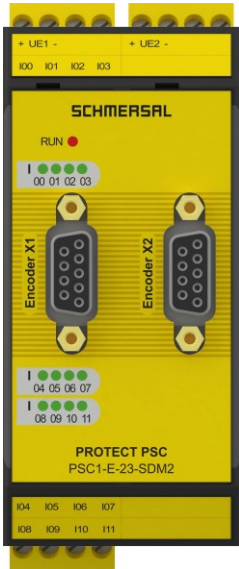Type designation	Device features
	<p>Version of the module with following peripherals:</p> <ul style="list-style-type: none"> <li>2 axes</li> <li>4 encoder interfaces (*)</li> <li>12 digital inputs</li> <li>1 status LED</li> <li>12 status LEDs for inputs</li> </ul>

### Properties of the module:

- Movement monitoring on an axis up to PL e according to EN ISO 13849-1 or SIL 3 as per IEC 61508
  - Velocity monitoring
  - Speed monitoring
  - Standstill monitoring
  - Direction of rotation monitoring
  - Safe increment
  - Emergency stop monitoring
  - Position monitoring
  - Position range monitoring
  - Movement range monitoring
  - Destination position monitoring
- Parameter administration for expansion modules in the basic device
- Comprehensive diagnostic functions integrated
- Mounting on DIN rail

## 3.3.2.3.1 Tech. characteristic data PSC1-E-23-SDM2

Safety-related characteristic data		
	PL according to EN ISO 13849	PL e
	PFH <sup>(3)</sup> /architecture	3 * 10 <sup>-9</sup> <sup>(1)</sup> / KAT 4 6.5 * 10 <sup>-9</sup> <sup>(2)</sup> / KAT 4
	SIL according to IEC 61508	SIL 3
	Proof test interval	20 years = max. service life
General data		
	Max. number of expansion modules	-
	Interface for expansion modules	T-bus connector, can be plugged into DIN rail
	Number of safe digital inputs	12 (OSSD support)
	Number of safe digital outputs	-
	Number of safe digital I/O	-
	Number of relay outputs (1-channel)	-
	Number of safe analogue inputs	-
	Number of signal outputs	-
	Number of pulse outputs	-
	Type of connection	Removable screw terminals
	Axis monitoring	2
	Encoder interfaces (D-Sub / screw terminal)	2 / 2 (*)
	Encoder technology (See table Encoder specifications)	SSI, SinCos, TTL, proximity switch
Electrical data		
	Supply voltage (tolerance)	-
	Power consumption (logic)	-
	Rated data digital inputs	24 VDC; 20 mA, type 1 according to IEC 61131-2
	Rated data digital outputs	-
	Rated data relay	-
	Rated data analogue inputs	-
	Rated data pulse outputs	-
	Rated data auxiliary outputs	-
Environmental data		
	Temperature	0°C ... +50°C operation -25°C ... +70°C storage, transport
	Degree of protection	IP 20
	Climatic class	3k3 according to DIN 60 721-3
	Minimum, maximum relative humidity (no condensation)	5% - 85%
	EMC	EN 61000-6-2, EN 61000-6-4, EN 61000-6-7, EN 61800-3, EN 61326-3, EN 62061
	Use of operating equipment	2000m
	Overvoltage category	III
	Level of contamination	2
Mechanical data		
	Size (HxDxW [mm])	PSC1-E-23-SDM2 = 100x115x45
	Weight	PSC1-E-23-SDM2 = 390 g
	Attachment	Can be snapped to DIN rail
	Number of T-bus connectors (included in the scope of delivery)	2
	Min. connection cross-section / IL	0.2 mm <sup>2</sup> / 24
	Max. connection cross-section / IL	2.5 mm <sup>2</sup> / 12

Options:

(\*)Maximum 2 encoders/axis


(1) 1 axis

(2) 2 axes

(3)Value only applies for expansion module. For an overall assessment according to EN 13849, a series connection with the related basic device must be used

=> PFH<sub>Logic</sub> = PFH<sub>Basic</sub> + PFH<sub>Expansion</sub>

## 3.3.2.4 Expansion module PSC1-E-24-SDM2-2

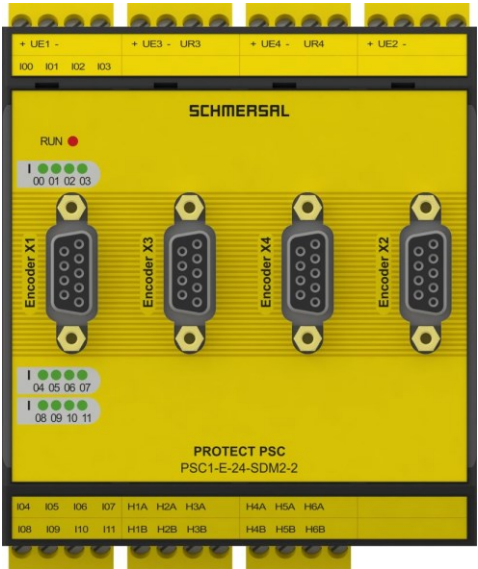Type designation	Device features
	<p>Version of the module with following peripherals:</p> <ul style="list-style-type: none"> <li>2 expanded axes</li> <li>8 encoder interfaces (*)</li> <li>12 digital inputs</li> <li>1 status LED</li> <li>12 status LEDs for inputs</li> </ul>

### Properties of the module:

- Movement monitoring on an axis up to PL e according to EN ISO 13849-1 or SIL 3 as per IEC 61508
  - Velocity monitoring
  - Speed monitoring
  - Standstill monitoring
  - Direction of rotation monitoring
  - Safe increment
  - Emergency stop monitoring
  - Position monitoring
  - Position range monitoring
  - Movement range monitoring
  - Destination position monitoring
- Parameter administration for expansion modules in the basic device
- Comprehensive diagnostic functions integrated
- Mounting on DIN rail
- Expanded functionality:
  - Permits the connection of 2 rotary encoders per axis (SSI, Sin/Cos, TTL, proximity switch)
  - encoder interface additionally supports HTL (200 kHz), Sin/Cos high-resolution and resolver

## 3.3.2.4.1 Tech. characteristic data PSC1-E-24-SDM2-2

Safety-related characteristic data		
	PL according to EN ISO 13849	PL e
	PFH <sup>(1)</sup> /architecture	6,5 * 10 <sup>-9</sup> / KAT 4
	SIL according to IEC 61508	SIL 3
	Proof test interval	20 years = max. service life
General data		
	Max. number of expansion modules	-
	Interface for expansion modules	T-bus connector, can be plugged into DIN rail
	Number of safe digital inputs	12 (OSSD support)
	Number of safe digital outputs	-
	Number of safe digital I/O	-
	Number of relay outputs (1-channel)	-
	Number of safe analogue inputs	-
	Number of signal outputs	-
	Number of pulse outputs	-
	Type of connection	Removable screw terminals
	Axis monitoring	2
	Encoder interfaces (D-Sub / screw terminal)	4 / 4 (*)
	Encoder technology (See table Encoder specifications)	1. Encoder: SSI, SinCos, TTL, proximity switch, 2. Encoder: additionally, HTL (200 kHz), SinCos (HiRes), resolver
Electrical data		
	Supply voltage (tolerance)	-
	Power consumption (logic)	-
	Rated data digital inputs	24 VDC; 20 mA, type 1 according to IEC 61131-2
	Rated data digital outputs	-
	Rated data relay	-
	Rated data analogue inputs	-
	Rated data pulse outputs	-
	Rated data auxiliary outputs	-
Environmental data		
	Temperature	0°C ... +50°C operation -25°C ... +70°C storage, transport
	Degree of protection	IP 20
	Climatic class	3k3 according to DIN 60 721-3
	Minimum, maximum relative humidity (no condensation)	5% - 85%
	EMC	EN 61000-6-2, EN 61000-6-4, EN 61000-6-7, EN 61800-3, EN 61326-3, EN 62061
	Use of operating equipment	2000m
	Overvoltage category	III
	Level of contamination	2
Mechanical data		
	Size (HxDxW [mm])	PSC1-E-24-SDM2-2 = 100x115x90
	Weight	PSC1-E-24-SDM2-2 = 520 g
	Attachment	Can be snapped to DIN rail
	Number of T-bus connectors (included in the scope of delivery)	4
	Min. connection cross-section / IL	0.2 mm <sup>2</sup> / 24
	Max. connection cross-section / IL	2.5 mm <sup>2</sup> / 12



Options:

(\*)Maximum 2 encoders/axis

<sup>(1)</sup>Value only applies for expansion module. For an overall assessment according to EN 13849, a series connection with the related basic device must be used

$$\Rightarrow PFH_{Logic} = PFH_{Basic} + PFH_{Expansion}$$

## 3.3.2.5 Expansion modules PSC1-E-131 and PSC1-E-133

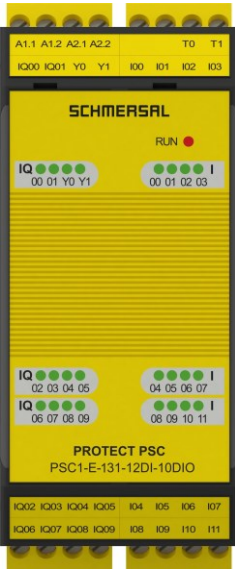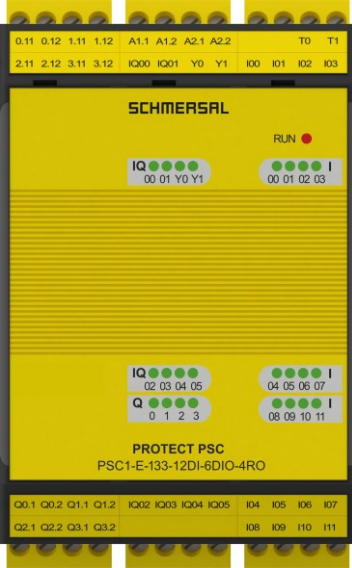Type designation	Device features
	<p>Version of the module with following peripherals:</p> <p>PSC1-E-131/133</p> <ul style="list-style-type: none"> <li>12 digital inputs</li> <li>10/6 digital I/O</li> <li>2 pulse outputs</li> <li>2 signal outputs</li> <li>0/4 relay outputs (1-channel)</li> <li>12 status LEDs for inputs</li> <li>0/4 status LEDs for relay outputs <sup>(1)</sup></li> <li>10/6 status LEDs for I/O</li> <li>2 status LEDs for signalling outputs</li> </ul>
	

### Properties of the module

- 12 safe inputs, OSSD support
- 10 safe I/O - can be configured as input or output
  - PSC1-E-133 with a total of 4 relay outputs (1- channel) and 6 I/O
- Pulse outputs for cross-circuit detection on digital input signals
- External contact monitoring on switchgear connected (EMU)
- Contact multiplication or contact rating increase by means of external contactors in conjunction with integrated monitoring possible
- Comprehensive diagnostic functions integrated in the firmware
- Power supply via basic module
- Mounting on DIN rail

<sup>(1)</sup> Please observe notes in section 5.7.7

## 3.3.2.5.1 Tech. characteristic data: PSC1-E-131 and PSC1-E-133

Safety-related characteristic data				
	PL according to EN ISO 13849		PL e	
	PFH <sup>(1)</sup> /architecture		9.2 * 10 <sup>-9</sup> /KAT 4 + on PSC1-E-133 1-channel per relay 2 * 10 <sup>-8</sup> (KAT 1) 2-channel per relay 1 * 10 <sup>-9</sup> (KAT 4)	
	SIL according to EN 61508		SIL 3	
	Proof test interval		20 years = max. service life	
General data				
	Max. number of expansion modules		-	
	Interface for expansion modules		T-bus connector, can be plugged into DIN rail	
	Number of safe digital inputs		12 (OSSD support)	
	Number of safe digital outputs		-	
	Number of safe digital I/O		-	
		PSC1-E-131	10	
		PSC1-E-133	6	
	Number of relay outputs (1-channel) <sup>(2)</sup>		-	
		PSC1-E-131	-	
		PSC1-E-133	4	
	Number of safe analogue inputs		-	
	Number of signal outputs		2	
	Number of pulse outputs		2	
	Type of connection		Removable screw terminals	
	Axis monitoring		-	
Encoder interfaces (D-Sub / screw terminals)		-		
Encoder technology (See table Encoder specifications)		-		
Electrical data				
	Supply voltage (tolerance)		24 VDC; 2A (-15%, +20%)	
	Fuse	A1.1	30 VDC/ 10 A	
	Max. power consumption (logic)		3 W	
	Rated data digital inputs		24 VDC / 20 mA, type 1 according to EN61131-2	
	Rated data digital outputs		-	
		Signal outputs	24 VDC; 250mA	
		Pulse outputs	24 VDC; 250mA	
		Digital I/O 00 – 04	24 VDC; 0.5A	
		05 – 09	24 VDC; 2A ***	
	Rated data relay		-	
		NO DC13	24 VDC; 2A	
		AC15	230 VAC; 2A	
		NC DC13 (readback contact)	24 VDC; 2A	
	Rated data analogue inputs		-	
Electrical data (only for UL)				
	Rated data digital outputs		-	
		Auxiliary outputs	24 VDC; 250mA (G.P.)	
		Digital I/O 00 – 04	24 VDC; 0.5A (G.P.)	
		05 – 09	Temperature rating 30°C	24 VDC; 2A (G.P.)
			Temperature rating 50°C	24 VDC; 1.8A (G.P.)
		Max. cumulative current	10A	
	Rated data relay		-	
		Normally open contact	24 VDC; 2A (Pilot Duty) 120 VAC; 2A (Pilot Duty)	
	Normally closed (readback contact)	24 VDC; 2A (Pilot Duty)		
Environmental data				
	Temperature		0°C ... +50°C operation -25°C ... +70°C storage, transport	
	Degree of protection		IP 20	
	Climatic class		3k3 according to DIN 60 721-3	
	Minimum, maximum relative humidity (no condensation)		5% - 85%	
	EMC		EN 61000-6-2, EN 61000-6-4, EN 61000-6-7, EN 61800-3, EN 61326-3, EN 62061	
	Use of operating equipment		2000m	
	Overvoltage category		III	
	Level of contamination		2	


Mechanical data			
	Size (HxDxW [mm])		PSC1-E-131 = 100x115x45 PSC1-E-133 = 100x115x67.5
	Weight		PSC1-E-131 = 300 g PSC1-E-133 = 400 g
	Attachment		Can be snapped to DIN rail
	Number of T-bus connector		Included in the scope of delivery
		PSC1-E-131	2
		PSC1-E-133	3
	Min. connection cross-section / IL		0.2 mm <sup>2</sup> / 24
	Max. connection cross-section / IL		2.5 mm <sup>2</sup> / 12

## Options:

- \*\*\* Derating, see section "Derating of outputs"
- 1) Value only applies for expansion module. For an overall assessment according to EN 13849 a series connection with the related basic device is to be used  
=>  $PFH_{Logic} = PFH_{Basic} + PFH_{Expansion}$
- (2) Please observe note in 5.7.7

## 3.3.3 Decentral expansion module

### 3.3.3.1 PSC1-E-37/38

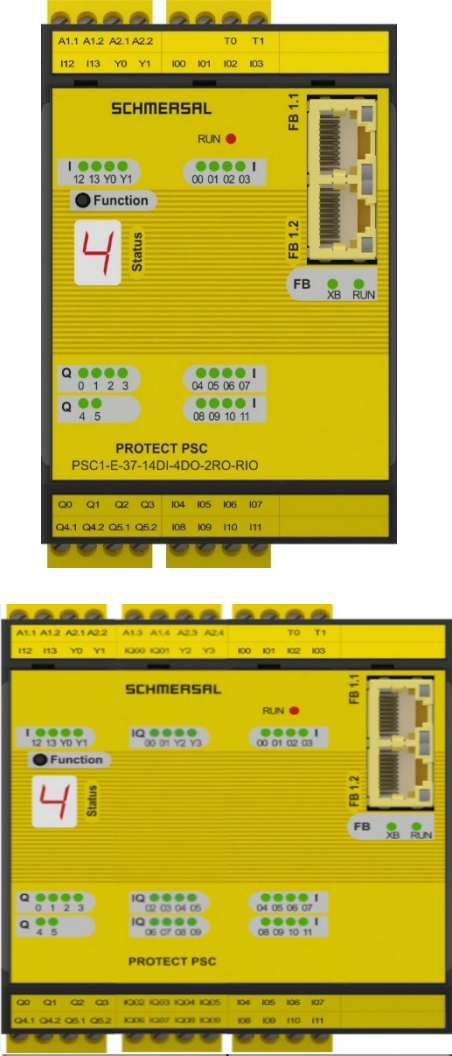Type designation	Device features
	<p>Version of the module with following peripherals:</p> <ul style="list-style-type: none"> <li>14 digital inputs</li> <li>10 digital I/O (E-38)</li> <li>2 pulse outputs</li> <li>2 relay outputs (1-channel)</li> <li>2/4 signalling outputs (E-37/38)</li> <li>2/4 pn or pp switching-outputs</li> <li>2 signal outputs</li> <li>1 7-segment display</li> <li>1 status LED</li> <li>14 status LED for inputs</li> <li>10 status LED for I/O (E-38)</li> <li>2 status LED for relay outputs</li> <li>4 status LED for outputs</li> <li>2/4 status LED for signalling-outp. (E-37/38)</li> </ul>

#### Properties of the module:

- 14 safe inputs, OSSD support
- Cross-circuit monitoring
- Contact multiplication or contact rating increase by means of external contactors in conjunction with integrated monitoring possible
- Comprehensive diagnostic functions integrated in the firmware
- Mounting on DIN rail

## 3.3.3.1.1 Tech. characteristic data: PSC1-E-37/38

Safety-related characteristic data				
	PL according to EN ISO 13849		PL e	
	PFH <sup>(1)</sup> /architecture		12.6 * 10 <sup>-9</sup> / KAT 4	
	SIL according to EN 61508		SIL 3	
	Proof test interval		20 years = max. service life	
General data				
	Connection		RJ45 (SDDC)	
	Number of safe digital inputs		14 (OSSD support)	
	Number of safe digital outputs			
	pn switching **		2	
	pp switching **		4	
	Number of safe digital I/O			
		PSC1-E-37	-	
		PSC1-E-38	10	
	Number of relay outputs (1-channel)		2	
	Number of safe analogue inputs		-	
	Number of signal outputs		2	
	Number of pulse outputs		2	
	Type of connection		Removable screw terminals	
	Axis monitoring		-	
Encoder interfaces (D-Sub / screw terminal)		-		
Encoder technology (See table Encoder specifications)		-		
Electrical data				
	Supply voltage (tolerance)		24 VDC; 2A (-15%, +20%)	
	Fuse	A1.1	min. 30 VDC; max. 3.15A	
		A1.2	min. 30 VDC; max. 10A	
	Max. power consumption (logic)			
		PSC1-E-37	4,2W	
		PSC1-E-38	5,2W	
	Rated data digital inputs		24 VDC / 20 mA, type 1 according to EN61131-2	
	Rated data digital outputs			
		pn switching		24 VDC; 2A ***
		pp switching		24 VDC; 2A ***
		Digital I/O		
			0-4	24 VDC; 0,5A
			5-9	24 VDC; 2A ***
		Signal outputs		24 VDC; 250mA
	Pulse outputs		24 VDC; 250mA	
	Rated data relay			
	NO	DC13	24 VDC; 2A	
		AC15	230 VAC; 2A	
Rated data analogue inputs		-		
Electrical data (only for UL)				
	Rated data digital outputs			
		pn switching	Temperature rating 30°C	24 VDC; 2A (G.P.)
			Temperature rating 50°C	24 VDC; 1.8A (G.P.)
		pp switching	Temperature rating 30°C	24 VDC; 2A (G.P.)
			Temperature rating 50°C	24 VDC; 1.8A (G.P.)
		Max. cumulative current (pn or pp)		8A
		Digital I/O		
			0-4	24 VDC; 0,5A (G.P.)
			5-9	24 VDC; 2A (G.P.)
	Auxiliary outputs		24 VDC; 250mA (G.P.)	
	Rated data relay	Normally open contact		24 VDC; 2A (Pilot Duty) 120 VAC; 2A (Pilot Duty)

Environmental data		
	Temperature	0°C ... +50°C operation -25°C ... +70°C storage, transport
	Degree of protection	IP 20
	Climatic class	3k3 according to DIN 60 721-3
	Minimum, maximum relative humidity (no condensation)	5% - 85%
	EMC	EN 61000-6-2, EN 61000-6-4, EN 61000-6-7, EN 61800-3, EN 61326-3, EN 62061
	Use of operating equipment	2000m
	Overvoltage category	III
	Level of contamination	2
Mechanical data		
	Size (HxDxW [mm])	
		PSC1-E-37
		100x115x67,5
		PSC1-E-38
		100x115x90
	Weight	
		PSC1-E-37
		400g
		PSC1-E-38
		520g
	Attachment	Can be snapped to DIN rail
	Min. connection cross-section / IL	0.2 mm² / 24
	Max. connection cross-section / IL	2.5 mm² / 12

## Options:

- \*\* pn/pp can be configured via SafePLC2
- \*\*\* Derating, see section "Derating of outputs"

<sup>1)</sup>Value only applies for expansion module. For an overall assessment according to EN 13849, a series connection with the related basic device must be used

$$\Rightarrow PFH_{Logic} = PFH_{Basic} + PFH_{Expansion}$$

## Note:

The network connections between the remote modules and to the base module must be at least in CAT5(e). The use of double shielded twisted pair cables is recommended. If switches must be used, mixed operation with fieldbuses should be avoided.

## 3.3.4 Optional universal communication interface

<b>Version</b>	<b>Device features</b>
-FB1	Decentral SDDC and SMMC interface (2x RJ 45) Communication interface for decentral slave and master modules Fieldbus interface (2x RJ 45) Standard and safety fieldbus Memory Card (microSD) Storage medium for safety-related user program
-FB10	Fieldbus interface (2x RJ 45) Standard and safety fieldbus Memory Card (microSD) Storage medium for safety-related user program
-FB2	Decentral SDDC and SMMC interface (2x RJ 45) Communication interface for decentral slave and master modules Fieldbus interface (Sub-D) Standard and safety fieldbus Memory Card (microSD) Storage medium for safety-related user program
-FB20	Fieldbus interface (Sub-D) Standard and safety fieldbus Memory Card (microSD) Storage medium for safety-related user program

### ***Properties of the universal communication interface:***

- Optional version of the communication interface for the PSC1 series
- The different versions can be combined. See "Possible combinations".
- For more detailed information, please refer to the installation manuals for the related fieldbus modules.

### **Note:**

For SDDC connections please also observe notes in section 3.2.3.1.1.

## 3.3.4.1 Tech. characteristic data: Optional universal communication interface

Safety-related characteristic data		
	PL according to EN ISO 13849	n.a.
	PFH / architecture	n.a.
	SIL according to EN 61508	n.a.
	Proof test interval	n.a.
General data		
	Decentral communication interfaces (not FB10/20)	2x RJ 45*
	Fieldbus interfaces	
	-FB1	2x RJ 45**
	-FB2	1x Sub-D***
	Memory Card (safety program)	1x microSD (front side)
	SD bus	Connector (with screw terminals)
	Status LEDs	4
	Fieldbus address rotary switches	
	-FB2	2
Electrical data		
	Power consumption (SD bus)	3.6 W
Environmental data		
	Temperature	0° ... +50° C operating temp.; -25C° ... +70C° storage, transport
	Degree of protection	IP 20
	Climatic class	3k3 according to DIN 60 721
	EMC	Corresponding to EN 55011 and EN 61000-6-2
Mechanical data		
	Size (HxDxW [mm])	100x115x22.5
	Attachment	Can be snapped to DIN rail
	Number of T-bus	Included in the items supplied
	Min. connection cross-section / IL	0.2 mm <sup>2</sup> / 24
	Max. connection cross-section / IL	2.5 mm <sup>2</sup> / 12

### Options

- \* Optionally for SDDC or SMMC
- \*\* Available fieldbuses EtherNet/IP, PROFINET and EtherCAT
- \*\*\* Available fieldbuses PROFIBUS, CANopen

## 3.4 Derating outputs

Maximum current carrying capacity based on temperature.

This "derating" must be considered for all 2A outputs (IO board and REL board)!

At an ambient temperature of **up to 30°C** the 2A outputs may be fully loaded.

**From** an ambient temperature of **30°C** to a maximum of 50°C, the 2A outputs may only be loaded up to a maximum of 1.8A and the total current may not exceed 10A.

## 3.5 Marking

The type plate is attached to the left side wall of the module and contains the following information:

### 3.5.1 Type plate

- Type designation
- Part number/item number
- Serial number
- Hardware release identifier
- Software release identifier
- Safety category
- Properties of the power supply
- Properties of the inputs
- Properties of the outputs
- Date of manufacture (A=2015, B=2016, ... digits indicate week / year in plain text)
- UL relevant data

 Date: 3C9/2017  
 Product No.: 103008452      Serial No. 123456  
 MAC: 14-C3-C2-01-XX-XX  
 HW-Release: 11-10-10-11-07      FW-Rel.COM 01-05-02  
 FW-Release: 04-00-00-05      FW-Rel.COM: 01-03-01  
  
 Type: **PSC1-C-100-FB1**  
 NORM:                      **SIL 3: IEC 61508 / IEC 62061**  
                                  **Cat. 4 / PL e: EN ISO 13849-1**  
 Power:                      A1.1 - A1.7: 24 VDC / -15%...+20% / 0...50°C  
                                  A1.1 / .2 / .3+4 ... .5+6 / .7: 2 A / 9 A / 10 A / 0,25 A  
 INPUT:                      I00...I13 (Digital): 24 VDC  
 OUTPUT:                    Q0...Q3 (Digital): 24 VDC / 2 A  
                                  IQx0...IQx4 (DIGITAL): 24 VDC / 0,5 A  
                                  IQx5...IQx9 (DIGITAL): 24 VDC / 2 A  
                                  Q4...Q5 (Relay): 240 VAC / 24 VDC / 2 A  
                                  Y0...Y5 (Auxiliary): 24 VDC / 0,25 A  

  
**LISTED**  
**E304506**  
**IND. CONT. EQ.**

Main supply: 24 V~, SELV/PELV;  
 Power consumption: 24 V~ / 2 A; OUTPUT (general use):  
 - Digital: Q0-Q4 | 24 V~ / 2 A, max. total current: 8 A;  
 - Digital: IQx0-IQx4 | 24 V~ / 0,5 A; x0-x9: max. total current 10 A  
 - Digital: IQx5-IQx9 | 24 V~ / 2 A;  
 - Auxiliary: 24 V~ / 250 mA;  
 - Relay NO (plot duty): 24 V~ / 2 A; 120 V~ / 2 A


K.A. Schmersal GmbH & Co. KG, DE-42279 Wuppertal  
 Mödinghofe 30 www.schmersal.com Read manual before installation!

Type plate PSC1-C-100-FB1

## 3.5.2 Items supplied

### ***Included in the items supplied:***

- PSC1 module:
- Connectors for all signal terminals not including encoder connection

### ***Not included in the items supplied:***

- Programming adapter (order designation: PSC1-A-90-PROG-CABLE)
- SafePLC2 software package (order designation: PSC1-A-91-SAFEPLC2) consisting of:
  - Licence dongle

### **Note:**


Installation and programming manual, as well as the configuration software SafePLC2 can be found at [products.schmersal.com](https://products.schmersal.com)

## 4 Safety-related features


### 4.1 General layout, safety-related architecture and characteristic data

The internal layout of the PSC1 series comprises two separate channels with mutual result comparison. High-quality diagnostics are undertaken in each of the two channels for fault detection.

The architecture and principle of operation of the layout corresponds to category 4 in EN ISO 13849-1.

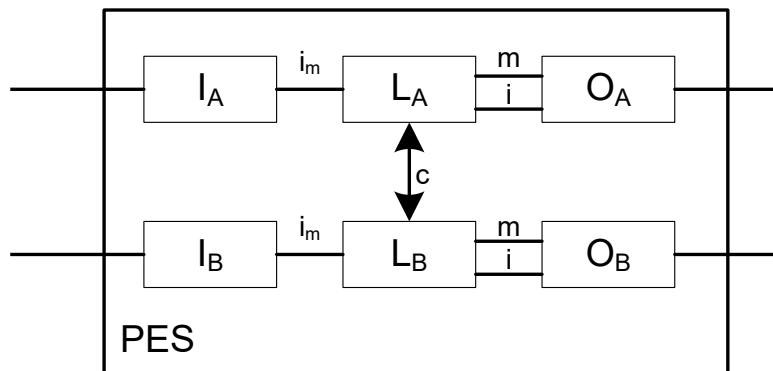

The overall architecture therefore has the following layout:

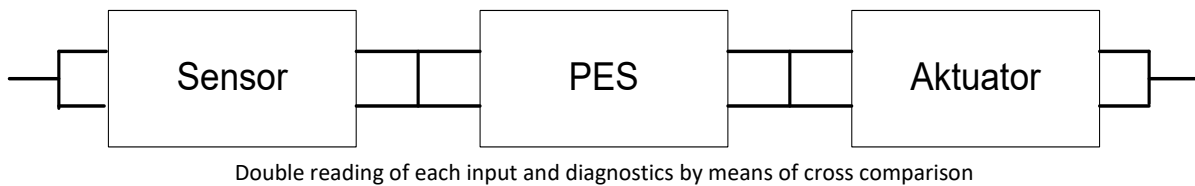

You will find the specific safety-related characteristic data for the related modules in the tech. characteristic data in section 3.

For the safety-related assessment of overall systems, the characteristic data stated in section 3 can be used for the PES sub-system (e.g. PL e and PFH value according to table for verification as per EN ISO 13849)


Only to be considered when using safety remote I/O communication (SDDC) for data exchange with distributed I/O systems and for master – master communication (SMMC):

In conjunction with the expansion modules the layout is more complex.

Along with the structures of the expansion modules, the bus communication is also to be taken into account here. The safety-related equivalent circuit / architecture is to be determined in relation to the application-related layout.


**Specifically, a differentiation must be made between the following cases:**

- a) Axis module with safety function related to one axis or use of safe inputs on an expansion module and shutdown channel via outputs on the basic module

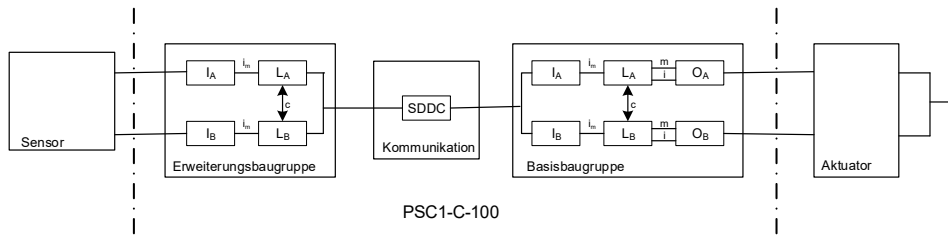


$$PFH_{PSC1-C-100} = PFH_{PSC1-C-100} + PFH_{PSC1-C-100\_IN} + PFH_{SDDC}$$

- b) 1..N axis modules with safety functions for functionality across axes (e.g. X/Y range protection) or use of safe inputs on several expansion modules with action on a single safety function and shutdown channel via outputs on the basic module

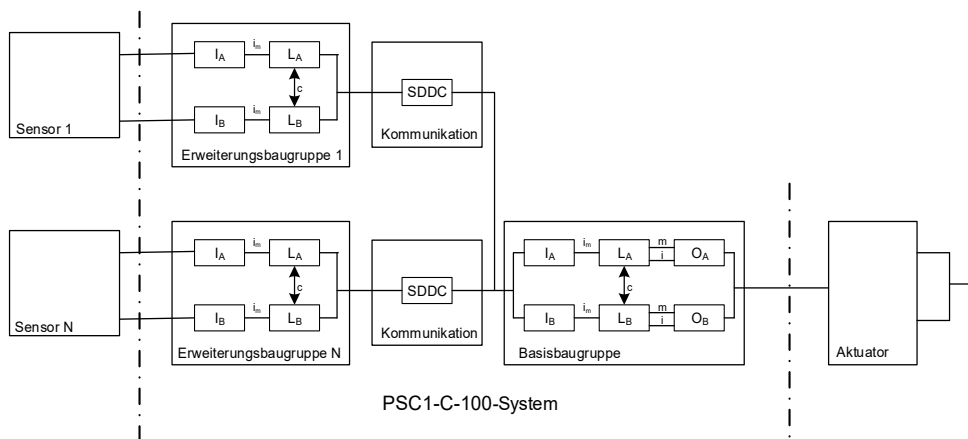


$$PFH_{PSC1-C-100} = PFH_{PSC1-C-100} + N * PFH_{PSC1-C-100\_IN} + N * PFH_{SDDC}$$

- c) Inputs on basic module and shutdown channel via outputs on an expansion module

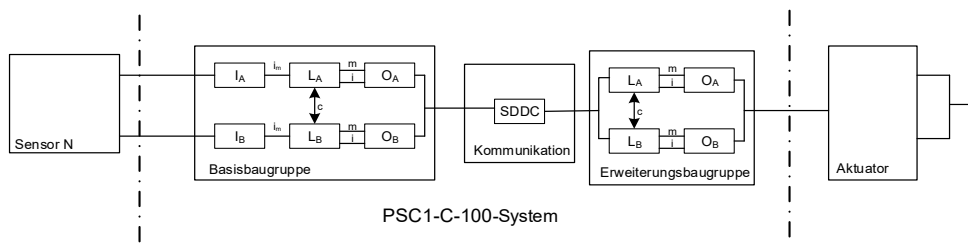


$$PFH_{PSC1-C-100} = PFH_{PSC1-C-100} + PFH_{PSC1-C-100\_OUT} + PFH_{SDDC}$$

- d) Axis module with safety function related to one axis or usage of safe inputs on an expansion module and shutdown channel via outputs on an expansion module

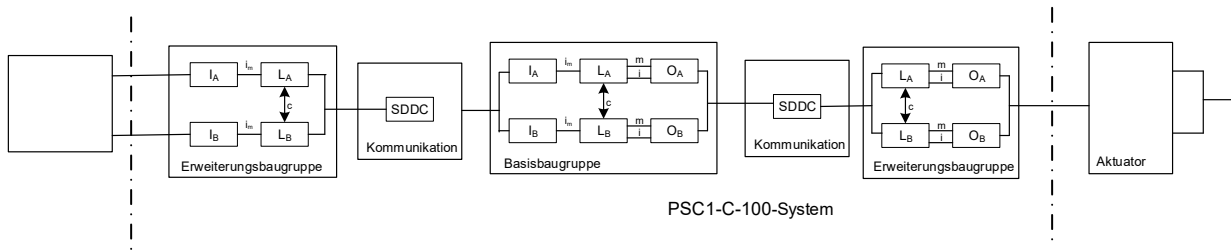

$$PFH_{PSC1-C-100} = PFH_{PSC1-C-100} + PFH_{PSC1-C-100\_IN} + PFH_{PSC1-C-100\_OUT} + 2 * PFH_{SDDC}$$

- e) 1..N axis modules with safety functions for functionality across axes (e.g. X/Y range protection) or usage of safe inputs on several expansion modules with action on a single safety function and shutdown channel via outputs on an expansion module

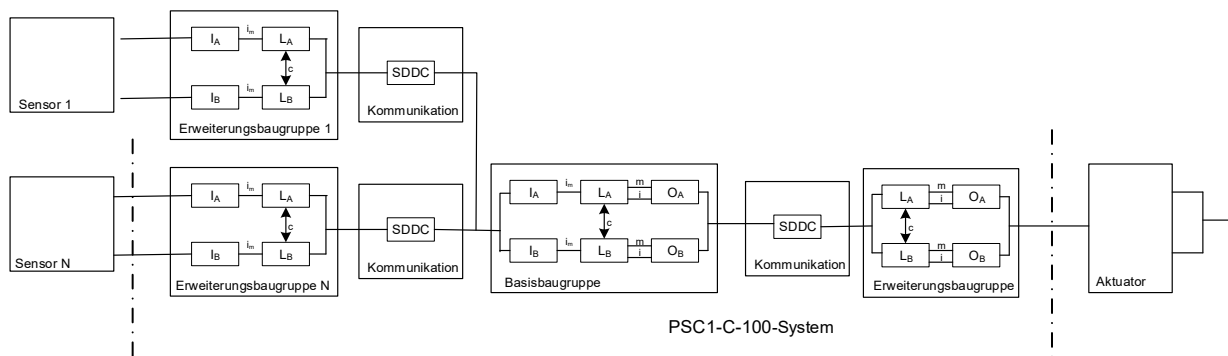

$$PFH_{PSC1-C-100} = PFH_{PSC1-C-100} + N * PFH_{PSC1-C-100\_IN} + PFH_{PSC1-C-100\_OUT} + (N+1) * PFH_{SDDC}$$

To determine the  $PFH_{PSC1-C-100}$  for the PSC1-C-100 system, the characteristic data for the sub-systems  $PFH_{PSC1-C-100}$ ,  $PFH_{PSC1-C-100\_IN}$ ,  $PFH_{PSC1-C-100\_OUT}$  and  $PFH_{SDDC}$  stated in section 3 are to be used.

## Characteristic data:

<b>Max. achievable safety class</b>	<ul style="list-style-type: none"> <li>• SIL 3 as per IEC 61508</li> <li>• Category 4 as per EN945-1</li> <li>• Performance Level e as per EN ISO 13849-1</li> </ul>
<b>System structure</b>	2-channel with diagnostics (1oo2) according to IEC 61508 Architecture category 4 according to EN ISO 13849
<b>Design of the operating mode</b>	"High demand" as per IEC 61508
<b>Probability of a dangerous failure per hour (PFH value)</b>	Specific values as per tables "Safety-related characteristic data"
<b>Proof test interval (EN61508)</b>	20 years, after that the module must be replaced



## Safety instructions:

- You will find the specific safety-related characteristic data for the related modules in the tech. characteristic data in section 3.
- On the usage of several sensors with different functions (e.g. access door position indication + speed acquisition) for a safety function (e.g. safely limited speed with access door open), these are to be considered as connected in series for the safety-related assessment of the overall system. On this topic see example calculation in the appendix.
- The safety regulations and EMC directives must be followed.
- In relation to the fault exclusions assumed, reference is made to the tables in D in the annex of EN ISO 13849-2.
- For the safety-related assessment of overall systems, the characteristic data stated in section 3 can be used for the PES sub-system (e.g. PL e and PFH value according to table for verification as per EN ISO 13849)

The examples shown in the following and their characteristic architecture are definitive for the allocation to a category according to EN ISO 13849-1.

## ***The resulting maximum possible performance levels according to EN ISO 13849 are also dependent on the following external component factors:***

- Structure (single or redundant)
- Detection of common cause failures (CCF)
- Diagnostic coverage on demand ( $DC_{avg}$ )
- Mean time to the dangerous failure of a channel ( $MTTF_D$ )


## 4.2 Safety-related characteristic data and circuitry for sensors connected

The PSC1 modules have completely redundant signal processing paths for each safety input. In addition, measures for obtaining the highest possible DC values are implemented.


### 4.2.1 Digital sensors

The digital inputs are completely redundant. The details for the categorisation, the DC and the achievable PL or SIL are listed in the following.


#### 4.2.1.1 Characteristics of the sensors / input elements

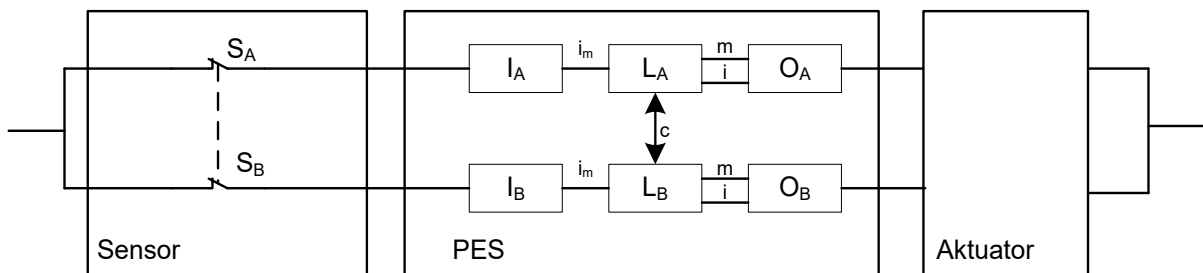

Dual-channel input element in parallel circuit (cat. 4, fault tolerance 1) with high DC due to signal processing in two channels and diagnostics using cross comparison in the PES

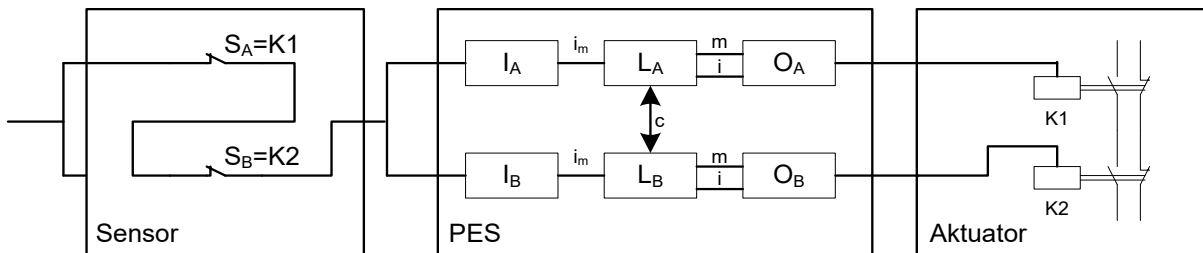

Dual-channel input element in series circuit (cat. 4, fault tolerance 1) with low to medium DC due to signal processing in two channels and diagnostics using cyclic testing

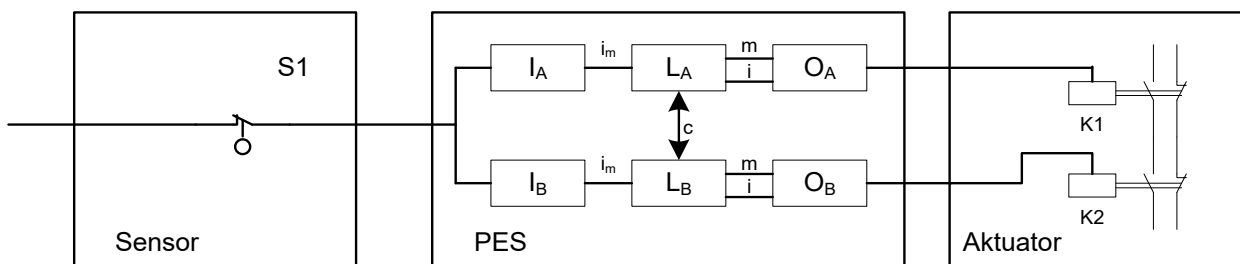

Single-channel input element and dual-channel processing with low to medium DC due to signal processing in two channels and diagnostics using cyclic testing, PL / SIL dependent on fault exclusions allowed and test rate for the input element.

## 4.2.1.2 DC digital sensors/inputs

The PSC1 modules provide wide-ranging diagnostic functions for the input sub-system. These are designed as continuous, or optional (cross-circuit monitoring using pulse detection, cross comparison, 2-channel or multiple-channel sensor with/without time monitoring, startup test).

### ***Continuously active diagnostic functions:***

#### **Cross comparison:**

The inputs on the PSC1 modules are in principle designed internally as dual-channel. The status of the input signals is continuously cross compared. Only with a high signal in both input sub-systems is the high status of the input detected, if the signal level varies between the two channels, the input is set to low status.

#### **Dynamic test on the switching thresholds in the input sub-system:**

The switching thresholds for the detection of the high level are tested cyclically with a high rate. If the defined threshold is dropped below, a module alarm is triggered.

#### **Dynamic test on the ability of the input sub-system to switch:**

The ability of the input sub-system to switch to the low level is tested cyclically on all inputs with the exception of I04—I07, with a high rate. If the defined threshold is dropped below, a module alarm is triggered.

### ***Diagnostic functions that can be activated by configuring parameters:***

#### **Cross-circuit test:**

The PSC1 modules have pulse signal outputs on which a unique signature is superimposed. On the usage of the cross-circuit test, the switching elements for the digital sensors / input elements are supplied with an auxiliary voltage via the pulse signal outputs on the PSC1 module. In this way the signature is superimposed on the sensors' / input elements' high signal level and checked by the PSC1 module. Short-circuits and cross-circuits to the high signal can be detected by means of the signature check. With alternating usage of the pulse signals for multiple contacts, parallel signal wires or with neighbouring terminal assignment, cross-circuits between the related input signals are detected.

#### **Sensors / input elements with 2-pole or multiple pole contacts without time monitoring:**

The sensors/input elements can be assigned to several contacts. These therefore correspond to at least 2-channel elements. A high level on the sensor/input element requires the logical series connection of both contacts.

Example 1:

Input element with 2 normally closed contacts: High level if both contacts are closed

Example 2:

Input element with 1 normally closed contact and 1 normally open contact: High level if normally open contact actuated and normally closed contact not actuated.

#### **Sensors / input elements with 2-pole or multiple pole contacts with time monitoring:**

Same check as before, however with the additional monitoring of the input signals for consistency of the defined level relationships within a time window of 3 s. If the levels differ for a period >3 s, a module alarm is triggered.

**Start-up testing:**

Each time the safety module is switched on (=PSC1 module), the input element must be tested in the low signal status direction (= defined safe status), e.g. actuation of the emergency stop button or a door lock after system start.

***Operative / organisational tests:***

Beyond the diagnostic measures on the PSC1 modules stated above, cyclic testing can be undertaken in the application. These tests can be used in the assessment of the DC.

**Note:**

The operative/organisational tests can also be used for a combination of hardware inputs and functional inputs (input information transmitted via standard fieldbus). The exclusive usage of functional inputs is however excluded in this respect (combination of two or more functional inputs)

The PSC1 modules therefore provide wide-ranging diagnostic functions for the input sub-system. These are designed as continuous, or optional (cross-circuit monitoring using pulse detection).

*For the safety-related assessment of the overall system, it is therefore possible in principle to use the following diagnostics for the input sensors:*

Characteristics of the input element	Tests that can be configured / operative tests				DC	Definition of the measure	Comment
	Cross-circuit test	With time monitoring	Start test	Cyclic test in operation			
Single-channel			O	O	>60	Cyclic test stimulus by dynamic change of input signals	An adequately high test rate must be ensured
	X				90	Cyclic test stimulus by dynamic change of input signals	Only effective if pulse allocation active
	X		O	O	90-99	Cyclic test stimulus by dynamic change of input signals	DC dependent on frequency of the start / cyclic test DC = 90 test only at intervals > 4 weeks DC = 99 test at least 1 x day/ or 100-times demand rate
Dual-channel					90	Cross monitoring of input signals with dynamic test if short circuits are not detectable (for multiple inputs/outputs)	With short-circuit fault exclusion up to DC=99 possible
			O	O	90-99	Cyclic test stimulus by dynamic change of input signals	DC dependent on frequency of the start / cyclic test
	X				99	Cross comparison of input signals with immediate and intermediate results in the logic (L) and program execution monitoring in relation to timing and logic, and detection of static failures and short-circuits (with multiple inputs/outputs)	Only effective if pulse allocation active
		X			99	Plausibility check, e.g. usage of normally open contacts and normally closed contacts = antivalent signal comparison of input elements	Only effective in conjunction with activated time monitoring function for input element

Options:

X: Diagnostic measure activated

O: At least 1 diagnostic measure activated



## **Safety instructions:**

- For a safety-related assessment of the sensor sub-system, the information from the manufacturer (MTTF<sub>D</sub>, PFH figures etc.) is to be used.
- The DC values stated in the table should be used conservatively and compliance with the boundary conditions (see "Comments" in table) ensured.
- Fault exclusions are allowed according to the applicable standards. The boundary conditions listed are to be ensured over the long-term.
- If several sensor systems are necessary for the correct function of an individual safety function, their partial values are to be combined correctly according to the method selected.

## 4.2.1.3 Classification of the safe digital inputs

### 4.2.1.3.1 Digital inputs I00 ... I13

Digital inputs	Performance Level that can be achieved	Remark
I00 ... I03 I08 ... I13	PL e	Suitable for all types of input elements, with / without pulses, achievable PL dependent on $MTTF_d$ of the input element as well as fault exclusions in the external cabling
I04 ... I07	PL e	Single-channel with pulses: <ul style="list-style-type: none"> <li>- Predominantly high level required (<math>T_{High} &gt; 100 * T_{Low}</math>)</li> <li>- At least one demand/day due to application</li> <li>- Fault detection on demand</li> </ul>
	PL d	Single-channel without pulses: <ul style="list-style-type: none"> <li>- Fault exclusion short-circuit between the signals and to VCC</li> <li>- Fault detection on demand</li> </ul>
	PL e	Dual-channel: <ul style="list-style-type: none"> <li>- At least one demand/day due to application</li> <li>- Fault detection on demand</li> </ul>

## 4.2.1.3.2 Digital inputs I/O (IQIx)

Digital inputs	Achievable Performance Level	Remark
IQIx		Without pulse, single-channel static signal -> Auxiliary input
	PL e	Without pulse, dual-channel static signal - At least one demand/day due to application - Fault detection only on demand
	PL d	Without pulse, dual-channel static signal - Less than one demand/day due to application
	PL e	Single-channel with pulses - Predominantly high level required ( $T_{High} > 100 * T_{Low}$ ) - At least one demand/day due to application - Fault detection only on demand
	PL d	Single-channel with pulses - Less than one demand/day
	PL e	Dual-channel with pulse 1 and pulse 2


### **Note:**

The achievable PL for a combination of hardware inputs and functional inputs is dependent on the operative/organisational tests selected and the independence of the two channels in the system layout. An application-related analysis is required to determine the PL.

## 4.2.1.4 Connection examples, digital sensors/safety switch

Attention! Identifiers for "Xxy" terminal blocks, e.g. X14, are not printed on the terminal blocks. They are used in Section **Fehler! Verweisquelle konnte nicht gefunden werden. Fehler! Verweisquelle konnte nicht gefunden werden.** to find the individual terminals more quickly, e.g. "I00".


### 4.2.1.4.1 Single-channel sensor, without cross-circuit testing

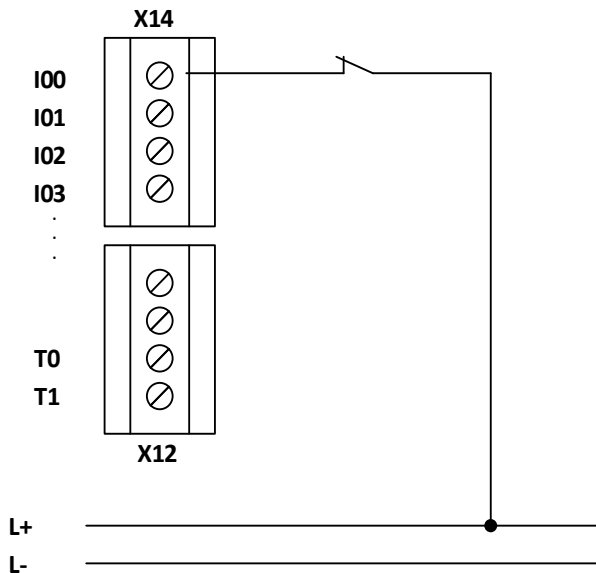

Single-channel sensor, without cross-circuit testing

The single-channel sensor is connected to the PSC1 without test pulses, and without cross-circuit testing. This design is not recommended for safety applications. Max. PL b according to EN ISO 13849-1 can be achieved.

### 4.2.1.4.2 Single-channel sensor with cross-circuit testing

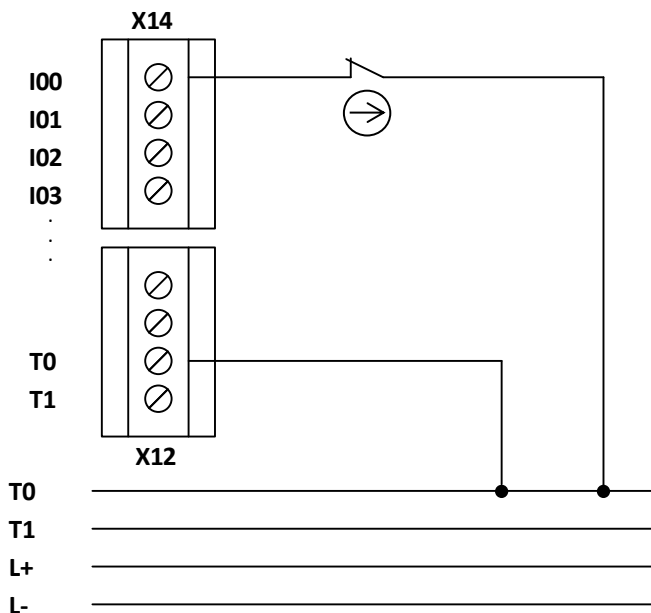

Single-channel sensor with test pulses

On the usage of a single-channel sensor with test pulses, one connection is connected to the test pulse output T0 or T1 of the PSC1. The pulse assignment must then also be carried out in the SafePLC2.

***The use of a single-channel sensor with test pulses detects:***

Short-circuit to the supply voltage DC 24 V

Short-circuit to DC 0 V

Cable break (interruption of power is safe state! )

Caution is required, on the other hand, if there is a cable short-circuit between the two connections for the sensor, as this will not be detected! A short-circuit between T0 and I00 is also not detected.

Due to the single-channel character of the switching element / sensor, a fault exclusion is required for its failure. This exclusion is allowed on the usage of positively opening switches with correct positive actuation.

The series connection of 2 switching elements with corresponding fault exclusion for a double fault is the same as this application (occurrence of two faults at the same time). This could represent, e.g. the safety outputs on an electronic monitoring device (light curtain, safety mat) with internal dual-channel shutdown.

On the usage of a suitable switching element and careful wiring of the sensor, PL d according to EN ISO 13849-1 can be achieved. In special cases, i.e. in conjunction with suitable switching elements and permissible fault exclusions, PL e according to EN ISO 13849-1 can be achieved.



**Safety instructions:**

- PL d or higher according to EN ISO 13849-1 is achieved if a short-circuit between the input and related pulse output as well as a short-circuit between the sensor connections can be excluded. Here, it must be noted that in the event of a fault, the switch must be positive opening according to EN 60947-5-1. In addition, the sensor must be triggered at regular intervals and the safety function demanded. Fault exclusions can be obtained as per EN ISO 13849-2 Table D8. With single-channel use of the inputs, the safety level that can be achieved is limited to SIL 2 or PL d, if there is no demand for the safety function at regular intervals.
- The connection in series of 2 switch elements with fault exclusion for a double fault requires a check for suitability according to the safety level required for this element. Reference is made to the applicable stipulation in the EC Machinery Directive 2006/42/EC.
- With single-channel sensors, in principle the safety-related usage of the inputs is only intended in conjunction with the pulse outputs.


## 4.2.1.4.3 Dual-channel sensor without time monitoring and without cross-circuit testing

Faults are detected as a minimum on demand. The DC is medium and can be changed to the high category by using cyclic tests (start tests, operative/organisational tests) depending on the test frequency.


Only normally closed contacts may be used for safety applications.

PL d according to EN ISO 13849-1 can be achieved when using sensors/switching elements with fault exclusion for the failure of the switching contacts to open. This exclusion is allowed on the usage of positively opening switches with correct positive actuation. It is also allowed to use sensors with self-monitoring output contacts.

PL e according to EN ISO 13849-1 can be achieved with use of various sensors/input elements with an adequately high  $MTTF_d$  in conjunction with plausibility monitoring of the timing and an adequately high change in switching state = dynamic testing.

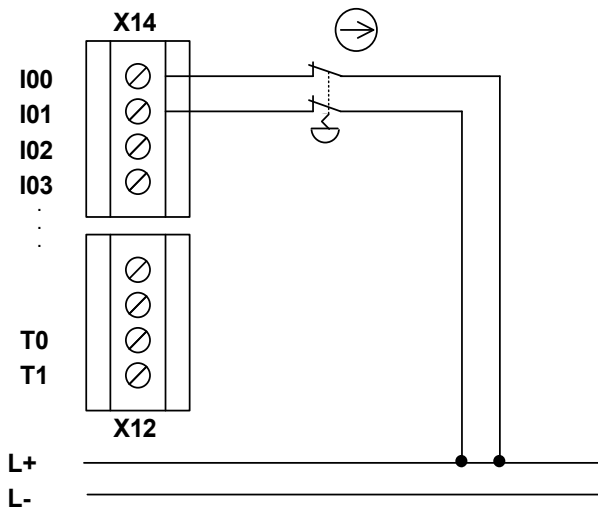

Homogeneous dual-channel sensor without test pulses, with positive opening

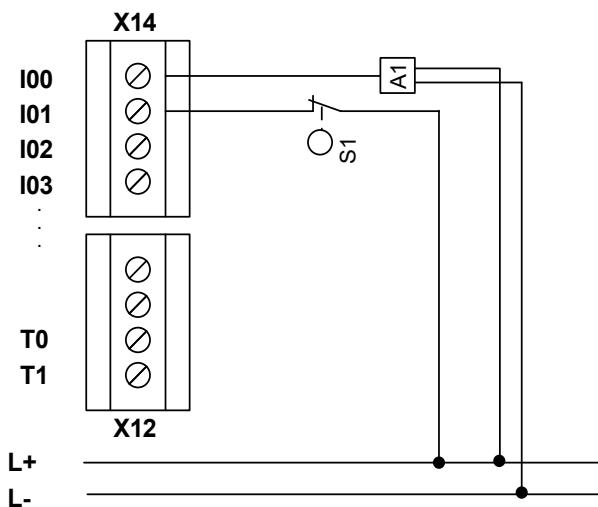

Diverse dual-channel input element, without test pulses

### **Safety instructions:**


- PL d or higher according to EN ISO 13849-1 is achieved on the usage of switching elements / sensors with positively opening contacts or positive actuation according to EN 60947-5-1. When using sensors with non positive break contacts, the "Universal Input Module" macro (group) must be used in SafePLC2.
- The usage of devices with switching elements for which a fault exclusion for a double fault can be assumed for the safety level required is allowed. Reference is made to the applicable stipulation in the EC Machinery Directive 2006/42/EC.

## 4.2.1.4.4 Dual-channel sensor with time monitoring and cross-circuit testing

By using two independent test pulse signals on the homogeneous sensor, all cross-circuits and connections to DC 24 V and DC 0 V can be detected.

**PL d or higher according to EN ISO 13849-1 can be achieved on:**

- The usage of sensors / switching elements with positive actuation.
- The usage of 2 sensors / switching elements with independent actuation
- Ditto. However with actuation via a common actuating device in conjunction with a fault exclusion for this device.

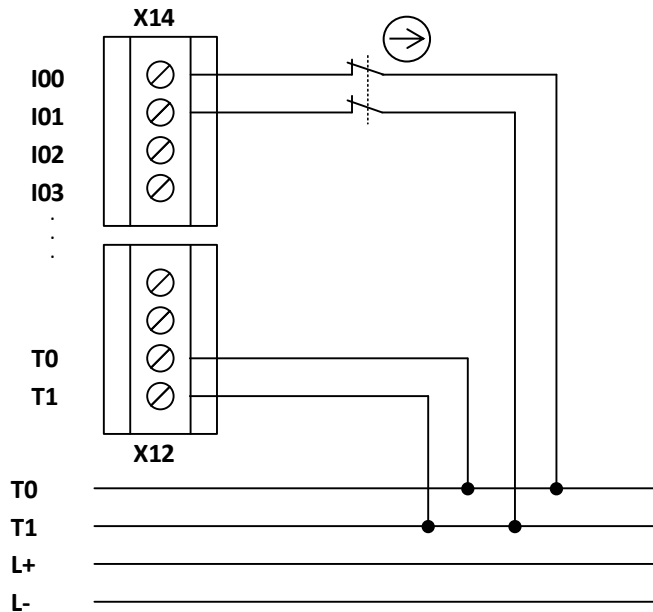

Homogeneous dual-channel sensor with test pulses



### **Safety instructions:**

- PL d or higher according to EN ISO 13849-1 is achieved on the usage of switching elements / sensors with positive actuation
- When using sensors with non positive break contacts or two independent sensors with independent actuation, the "Universal input module" macro (group) must be used in SafePLC2.
- On the usage of common elements in the actuating chain, a fault exclusion is required for these elements. The related restrictions and criteria according to EN ISO 13849-1 are to be met here.

## 4.2.1.5 Overview of achievable PL for digital safety inputs

Type of sensor / input element	Input	Tests that can be configured / operative tests				Achievable PL according to EN ISO 13849-1	Fault exclusion for input element	Condition for input element
		Cross-circuit test	With time monitoring	Start test	Cyclic test in operation			
Single-channel	I00..I13					b		Input element proven in operation
				O	O	d	All faults on the input element Short-circuit on the input/signal wire	MTTF <sub>d</sub> = high Connection in the switch cabinet or protected laying
	I00..I04 I08..I13					e	All faults on the input element Short-circuit on the input/signal wire	Input element corresponds at least to Plr Connection in the switch cabinet or protected laying
	All	X				d	Stuck Short-circuit on the input/signal wire	Predominantly high level required ( $T_{High} > 100 * T_{Low}$ ). Positive opening, MTTF <sub>d</sub> = high Connection in the switch cabinet or protected laying
		X		O	O	e	All faults on the input element Short-circuit on the input/signal wire	Input element corresponds at least to Plr Connection in the switch cabinet or protected laying MTTF <sub>d</sub> = high
	Two-channel parallel					d	Short-circuit between input/signal wire	Connection in the switch cabinet or protected laying MTTF <sub>d</sub> = medium
		X				e		MTTF <sub>d</sub> = high
Two-channel parallel	All		X			e	Short-circuit between input/signal wire (only with same switching elements = 2xNO or 2xNC)	Connection in the switch cabinet or protected laying  MTTF <sub>d</sub> = high

Options:

X: Diagnostic measure activated

O: At least 1 diagnostic measure activated

Type of sensor / input element	Input	Tests that can be configured / operative tests				Achievable PL according to EN ISO 13849-1	Fault exclusion for input element	Condition for input element
		Cross-circuit test	With time monitoring	Start test	Cyclic test in operation			
Dual-channel serial	I00..I04 I08..I13					d	Short-circuit on the input/signal wire Stuck / positive opening	Connection in the switch cabinet or protected laying MTTF <sub>d</sub> = medium
				O	O	e	Short-circuit on the input/signal wire	Connection in the switch cabinet or protected laying MTTF <sub>d</sub> = high
	All			O	O	d	Short-circuit on the input/signal wire	Connection in the switch cabinet or protected laying MTTF <sub>d</sub> = medium
		X		O	O	e		MTTF <sub>d</sub> = high

Options:


- X: Diagnostic measure activated  
O: At least 1 diagnostic measure activated

## 4.2.2 Sensors for speed and/or position acquisition


### 4.2.2.1 General safety-related layout of sensor interface for position and/or speed

Optionally, the expansion modules in the PSC1-C100 series have one (PSC1-E-21-SDM1, PSC1-E-23-SDM2) or two encoder interfaces (PSC1-E-22-SDM1-2, PSC1-E-24-SDM2-2) per axis.

Different safety levels can be achieved depending on the encoder type and encoder combination. The safety assessment for the related sub-system is as follows:

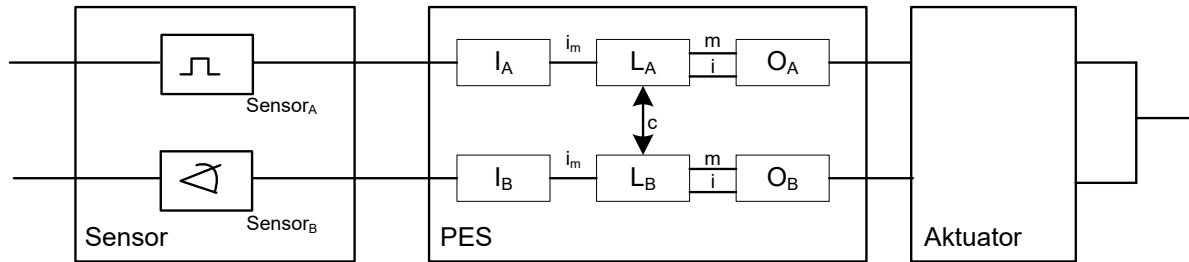

Dual-channel sensor system with separate signal processing in two channels, diagnostics by means of cross comparison in the PES

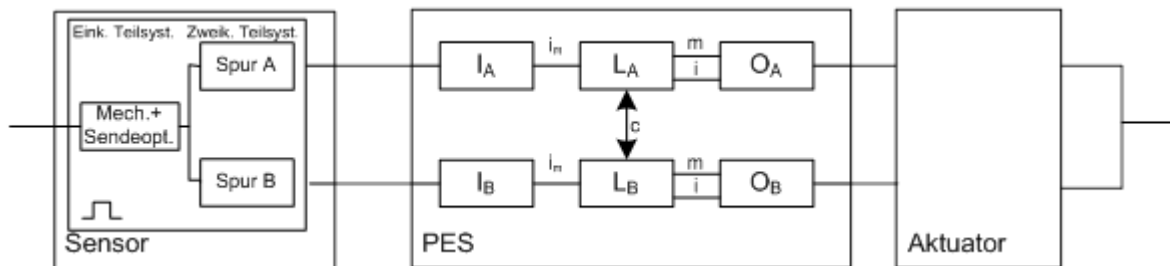

Sensor system with single and dual-channel sub-system (example incremental encoder). Diagnostics by means of separate signal processing in two channels and cross comparison in the PES as well as further specific diagnostics.

## 4.2.2.2 General diagnostic measures for encoder interface

For fault detection in the sensor system, a series of diagnostic measures is implemented in the PSC1 series depending on the encoder type selected and their combination. The measures are activated automatically with the selection of the encoder type.

In principle, the diagnostic measures can be classified in relation to their nature and effectiveness as per the table below:

### *Diagnostics for sensors for position and/or speed acquisition:*

Measure	DC	Comment	Usage
Cross comparison of input signals with immediate and intermediate results in the logic (L) and program execution monitoring in relation to timing and logic, and detection of static failures and short-circuits (with multiple inputs/outputs)	99	Only for use on: - Dual-channel sensor systems (2 separate sensors), - The dual-channel sub-system for single-channel sensors (incremental encoders) - Diagnostics for the single and dual-channel sub-system comprising specially suited sensor systems (SIN/COS encoders, resolvers) - Dynamic operation / no standstill monitoring	Monitoring of 2-channel sensor systems and the related sub-system in sensors for dynamic operation Not to be used for standstill monitoring!
Cross monitoring of input signals without dynamic test	80-95%	DC is dependent on the frequency of the dynamic state, i.e. standstill or movement and on the quality of the monitoring measure (80 - 90% for incremental encoders, 95% for SIN/COS encoders)	Monitoring of dual-channel sensor systems and the related sub-system comprising sensors for non-dynamic operation. To be used in particular for standstill monitoring!
Monitoring some characteristics of the sensor (response time, range of analog signals, e.g. electrical resistance, capacitance)	60	Diagnostics of specific features of sensors, can only be used for speed and position sensors according to section 4.3	Monitoring of the single-channel sub-system comprising single-channel sensor systems

## 4.2.2.3 Encoder types and their combinations, diagnostic characteristic data

The following cases must be considered for use of the axis monitoring modules:

- PSC1-E-21-SDM1:
  - 1 independent axis:
- PSC1-E-22-SDM1-2:
  - 1 axis with 2 encoders (so-called extended axis)
- PSC1-E-23-SDM2:
  - 1 axis with 2 encoders (so-called extended axis)  
SafePLC2: Axis counter = 1
  - 2 independent axes:
    - SafePLC2: Axis counter = 2
- PSC1-E-24-SDM2-2:
  - 2 axes each with 2 encoders (so-called extended axes)

Encoder A	Encoder B	Safe velocity	Safe direction	Safe absolute position	Fault exclusion	DC		
						1-channel sub-system	2-channel sub-system dynamic	2-channel sub-system non-dynamic (Stand-still monitoring)
1 x Proxi	1 x Proxi	X			actuator ***)	n.a.	99%	80-90%
Inkremental	NC	X			Mech. Encoder mounting *) Code disc mounting **)	60%	99%	80-90%
Inkremental	Inkremental	X	X			n.a.	99%	95%
Inkremental	1 x Proxi	X				n.a.	99%	90-95%
Inkremental	2 x Zähler Proxi 90°	X	X			n.a.	99%	90-95%
Inkremental	SIN/COS	X	X			n.a.	99%	99%
Inkremental	HTL	X	X			n.a.	99%	90-95%
Inkremental	Resolver	X	X			n.a.	99%	99%
Inkremental	SSI	X	X	X		n.a.	99%	90-95%
SIN/COS	NC	X	X		Mech. Encoder mounting *) Code disc mounting **)	60% / 90% *) **)	99%	90-95%
SIN/COS	Inkremental	X	X			n.a.	99%	95-99%
SIN/COS	1 x Proxi	X	X			n.a.	99%	90-95%
SIN/COS	2 x Zähler Proxi 90°	X	X			n.a.	99%	95-99%
SIN/COS	HTL	X	X			n.a.	99%	95-99%
SIN/COS	Resolver	X	X			n.a.	99%	99%
SIN/COS	SSI	X	X	X		n.a.	99%	95-99%
SSI	2 x Zähler Proxi 90°	X	X	X		n.a.	99%	90-95%
SSI	SIN/COS	X	X	X		n.a.	99%	95-99%

Enkoder A	Enkoder B	Safe velocity	Safe direction	Safe absolute position	Fault exclusion	DC		
						1-channel sub-system	2-channel sub-system dynamic	2-channel sub-system non-dynamic (Stand-still monitoring)
SSI	Resolver	X	X	X		n.a.	99%	95-99%
SSI	SSI	X	X	X		n.a.	99%	90-95%
NC	SIN/COS	X	X		Mech. Encoder mounting <sup>*)</sup> Code disc mounting <sup>**)</sup>	60% / 90% <sup>*) **)</sup>	99%	90-95%
NC	Resolver	X	X		Mech. Encoder mounting <sup>*)</sup> Code disc mounting <sup>**)</sup>	60 / 90% <sup>*) **)</sup>	99%	90-95%
NC	HTL	X			Mech. Encoder mounting <sup>*)</sup> Code disc mounting <sup>**)</sup>	60%	99%	80-90%
2 x Counter Proxy 90°	SSI	X	X	X		n.a.	99%	90-95%

A fault exclusion can be made for the mechanical connection with the note "... only positive connections are permitted for the shaft-hub connection of the encoder axis. Alternatively, other connection forms can be used if they meet the safety requirements. For their reliability in relation to the desired level of safety, comprehensible evidence must be provided in any case (e.g. oversizing with a form-fitting shaft-hub connection). The corresponding information on fault exclusion in the standard EN / IEC 61800-5-2, Appendix D.3.16 (Table D.8) must be observed. "

With SIN/COS encoders suitable for safety applications a DC of 90% can be assumed for the single channel transmit LED.

\*\*) The code disk / shaft connection and the sensor body must be analysed in detail. For a possible fault exclusion, the relevant information in the standard EN / IEC 61800-5-2, Appendix D.3.16 (table D.8) must be observed.

\*\*\*) For the speed measurement using the Proxy, the actuator and the fastening of the Proxy must be analyzed with regard to their reliability. The relevant information in standard EN / IEC 61800-5-2, Appendix D.3.16 (Table D.8) must be applied accordingly to exclude a possible fault.

Other single-channel parts for which the 60% apply:

Power supply

Code disk attachment

Mechanics of the opto-receiver (not SIN/COS)

Code disk

## 4.2.2.4 Specific diagnostic measures in relation to the encoder type used

	Encoder type	Supply voltage monitoring	Differential level monitoring	SIN/COS plausibility monitoring	Input signal level monitoring	Monitoring of the permissible quadrants	Monitoring of the count signal separately for track A/B	Monitoring of the reference signal / measured signal transmission ratio	Reference signal frequency monitoring	Reference signal voltage monitoring	Measured signal form factor analysis	Plausibility test, position signal versus speed	Clk frequency monitoring
Interface X 1/2, X23	Incremental	X	X				X						
	SIN/COS	X		X									
	SSI	X	X										
	Proximity switch 2 x count input	X											
	Proximity switch 1 x count input	X											
Interface X 3/4	Incremental	X	X		X		X						
	HTL		X		X								
	Resolver			X		X		X	X	X	X		
	SIN_COS	X		X		X <sup>(1)</sup>							
	SSI	X	X									X	X

Options:

<sup>(1)</sup> Only in the high-resolution mode

## 4.2.2.5 Safety-related shutdown thresholds, encoder systems for position and speed acquisition

As a basic measure, plausibility tests between the two measurement channels A and B for speed and position on the PSC1 module are undertaken with the actual values for position and speed and tested against configured thresholds.

The **incremental shutdown threshold** describes the position deviation that can be tolerated between the two acquisition channels A and B in the measurement section unit.

The **speed shutdown threshold** describes the speed deviation that can be tolerated between the two acquisition channels A and B.


Diagnostic functions are available in the SCOPE dialogue box in the parameter configuration tool to determine the optimal parameter values for the application.

### Note:

Speed and acceleration are acquired values with a minimum digital resolution. This situation limits the lowest speed or acceleration that can be acquired and defines the digital step width for the entries.


### Speed resolution:

The speed is acquired to a frequency of 500 Hz or 500 steps/s using the frequency measurement method, below that using a time measurement method. This situation produces the curve shown below for the acquisition error:

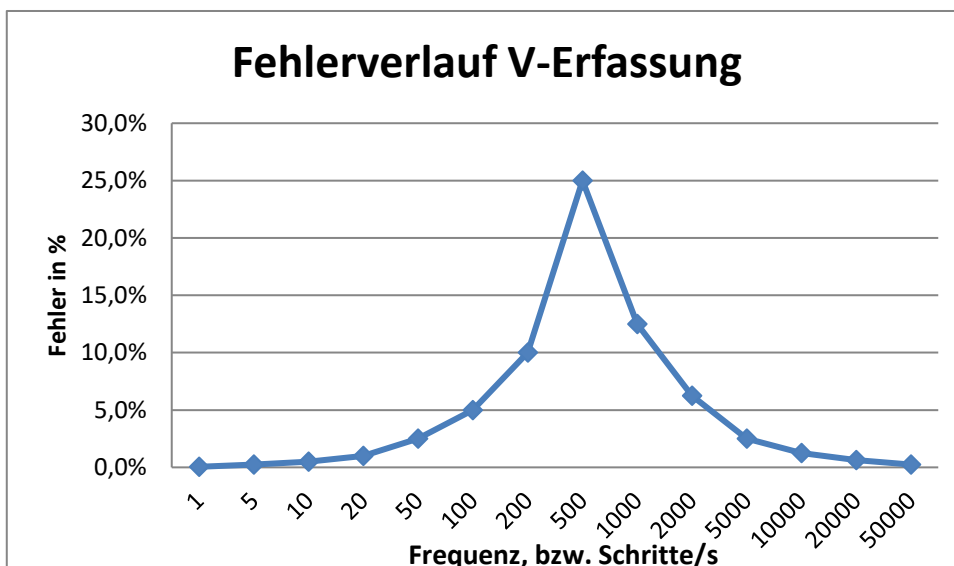


### Acceleration resolution

The digital resolution of the acceleration is limited by the maximum gate time of 256 ms and the resolution of the encoders. The graph below shows the lowest acceleration that can be measured as a function of the resolution in rev/min, mm/s<sup>2</sup> and m/s<sup>2</sup>.

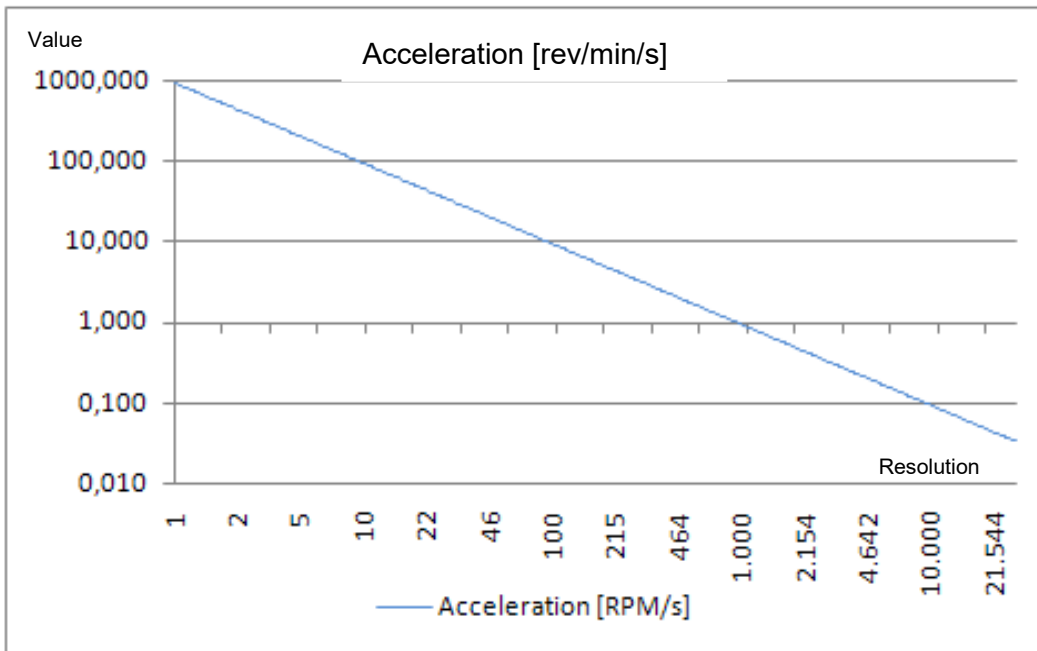

Graph of acceleration resolution, rotary (values in rev/min/s)

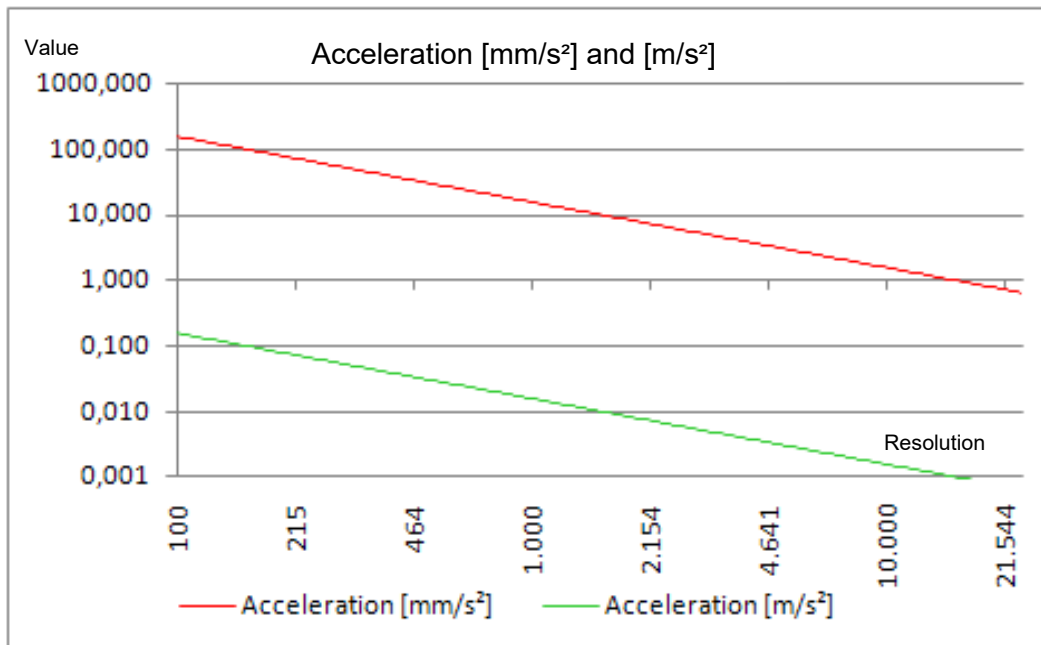

Graph of acceleration resolution, linear (values in mm/s² and m/s²)

## **Safety instructions:**

- The error can be optimised by the suitable selection of the sensor resolution for the related application.
- For applications with limited resolution and/or time variance in the sampled signal, the functionality of the monitoring functions used can be improved by the usage of a mean value filter. Digital interference from the sensors is "smoothed" by the mean value filter. However, this is achieved at the cost of an increased response time for the overall system.
- The filter time can be set to between 0 and 64 in steps of 8. The dimension is "ms". To determine the response time of the overall system, the filter times must be added to the response times stated for the PSC1 system (see section 11).

## **Safety instructions:**

- For a safety-related assessment of the sensor sub-system, the information from the manufacturer (MTTF<sub>D</sub>, PFH figures etc.) must be used.
- If specific diagnostics are required by the manufacturer to safeguard the safety-related characteristic values stated, these must be checked as per the above table "Specific diagnostic measures for position and speed sensors" in relation to the specific encoders. If in doubt, clarification by the manufacturer is required.
- The DC values stated in the table should be used conservatively and compliance with the boundary conditions (see "Comments" in table) ensured.
- To determine the DC for safety functions with standstill monitoring, among other aspects it is necessary to estimate the frequency of the dynamic state. As a general figure a DC of 90% can be assumed.
- Fault exclusions are allowed according to the applicable standards. The boundary conditions listed are to be ensured over the long-term.
- If several sensor systems are necessary for the correct function of an individual safety function, their partial values are to be combined correctly according to the method selected. This statement also applies to a combination of digital and analogue sensors (e.g. safely limited speed with safety door open = door contact + encoder for speed acquisition)
- By means of the suitable selection of the resolution of the sensor system, an adequately low tolerance in relation to the shutdown thresholds for the individual safety functions is to be ensured.
- On the usage of the encoder input filter, the increase in the response time is to be taken into account during the assessment of the safety-related function.

## 4.2.2.6 Safety-related assessment of the encoder types and their combination

Due to the monitoring functions implemented in the PSC1 series, in applications with encoder systems there are initially no special requirements on the internal layout of the encoder electronics, i.e. as a rule standard encoders can be used.

In general, a safety-related assessment of the overall arrangement is to be undertaken. During this process the information from the manufacturer of the encoder (PFH, MTTF) as well as the DC from the tables in 4.2.2 are to be used.

On the usage of individual encoders, as a minimum a fault exclusion is required for the mechanical actuation chain as well as the single-channel part taking into account the applicable specifications from EN ISO 13849-1. The information in 4.2.2 must also be followed.

PL d and higher according to EN ISO 13849-1 is in general achieved with a combination of two encoders with essentially different technology and separate mechanical attachment.

The usage of a compact encoder with internal dual-channel layout with different technology is just as suitable for applications up to PL e according to EN ISO 13849-1, however taking into account the specific fault exclusions required and their admissibility. As a rule encoders with proven safety-related properties should be used for this purpose; their safety level should correspond as a minimum to the level required.



### **Safety instructions:**

- The usage of standard encoders or a combination of standard encoders is permissible. A safety-related assessment is required for the overall arrangement comprising encoders, other sensors/switching elements for triggering the safety function, the PSC1 module and the shutdown channel. To determine the safety level achieved, among other data the information from the manufacturer (PFH, MTTF) and the DC as per the specifications in 4.2.2 is to be used.
- On the usage of only one encoder, the fault exclusion shaft fracture / fault in the mechanical encoder connection is required. For this purpose suitable measures are to be taken, e.g. positive locking of the encoder connection using a slot and key or locking pin. The applicable information from the manufacturer as well as EN ISO 13849-1 in relation to the requirement and admissibility of the fault exclusion must be followed.
- Preferably, only encoders with proven safety-related properties may be used as individual encoders. This encoder's safety level must correspond as a minimum to the safety level required for the overall arrangement. The instructions from the manufacturer in relation to diagnostic measures, mechanical connection and measures for the supply of power are to be followed.
- SIN/COS encoders: the internal layout of the sensor system must be designed such that the output signals for both tracks are generated independently of each other and common cause failures are excluded. In addition, the mechanical layout is to be verified, e.g. fastening of the code disc to the shaft. Preferably, encoders with proven safety-related properties are to be used.

- When using compact encoders with a dual-channel internal layout, e.g. SSI + incremental/SinCos, the instructions from the manufacturer in relation to the safety-related properties of diagnostic measures, mechanical connection and measures for the supply of power must be followed. The encoder's safety level must correspond as a minimum to the safety level required for the overall arrangement. Preferably, encoders with proven safety-related properties are to be used.

***In general the following faults in the external encoder system are detected by the PSC1 module:***

- Short-circuits between the safety-related signal wires
- Open circuit in the safety-related signal wires
- Stuck at 0 or 1 on one or all safety-related signal wires

Further specific diagnostics for the detection of faults in the external encoder system are allocated to each encoder type. The related diagnostic measures are listed in the following for the individual encoder types together with the limiting parameters




## **Safety instructions:**

- The diagnostic measures have of course tolerances as a consequence of measurement inaccuracies. These tolerances are to be taken into account during the safety-related assessment.
- The limits for the related diagnostic measures can be configured to some extent, or are fixed. The resulting diagnostic coverages are to be assessed for the related application and included in the overall safety-related assessment.


## 4.3 Safety-related characteristic data and circuitry for the outputs

The PSC1 modules have safe outputs of a different type. In the circuitry the related characteristic as per the description below is to be taken into account.


### 4.3.1 Characteristics of the output elements

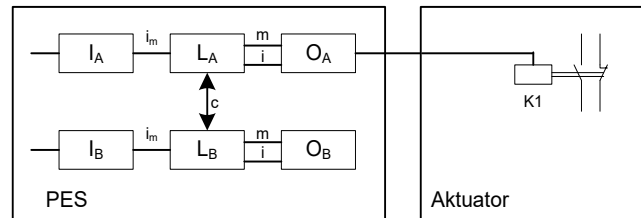


Single-channel output PSC1 and single-channel actuator without diagnostics

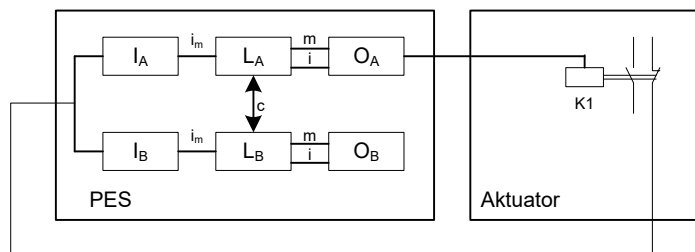


Single-channel output PSC1 and single-channel actuator with diagnostics

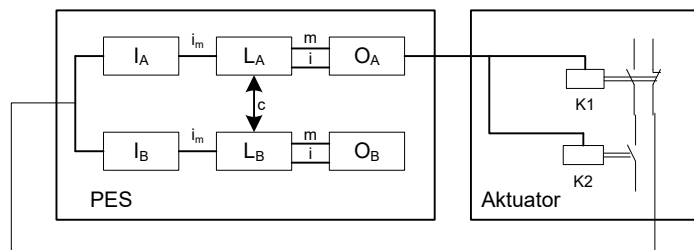


Single-channel output PSC1 (Q 4/5, Q0/2\_P, Q1/3\_N) and dual-channel actuator with at least single-channel diagnostics

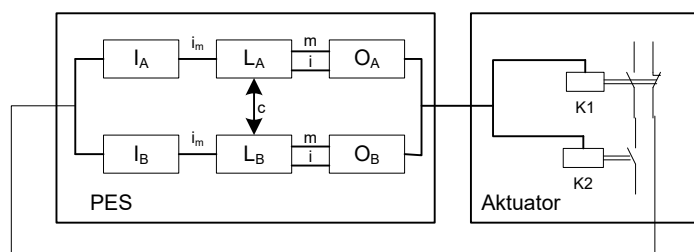


Single-channel output PSC1 with internal dual-channel processing (IQQx) and dual-channel actuator with at least single-channel diagnostics

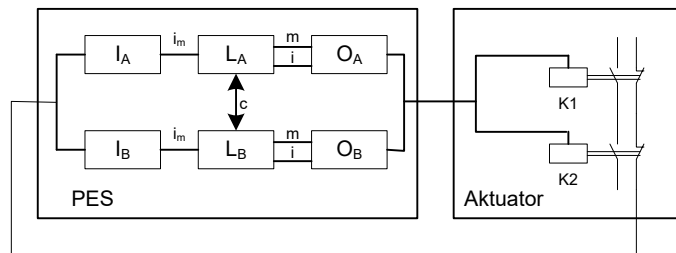

Single-channel output PSC1 with internal dual-channel processing (IQQx) and dual-channel actuator with dual-channel diagnostics

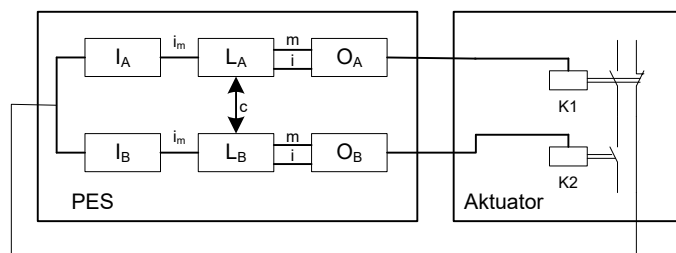

Dual-channel output PSC1 and dual-channel actuator with diagnostics

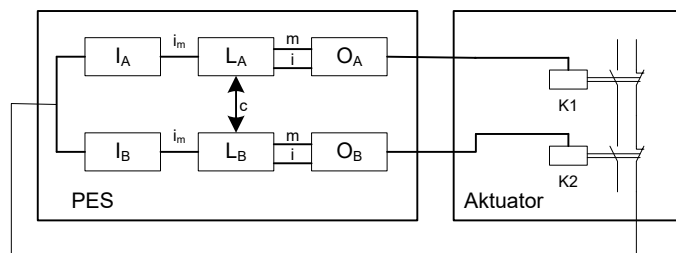

Dual-channel output PSC1 and dual-channel actuator with dual-channel diagnostics

## 4.3.2 Diagnostics in the shutdown circuit

The shutdown circuits have diagnostic functions with a fixed implementation and diagnostic functions that can be configured. Certain diagnostic functions also include the external part of the shutdown circuit. The various DC values are dependent on the usage of these diagnostic functions.

### 4.3.2.1 Diagnostic functions

#### ***Diagnostic functions with fixed implementation:***

##### **Crosswise readback of the outputs:**

All safety outputs are read back in the complementary channel. Faults in the internal shutdown circuit in the PSC1 module are therefore detected with DC = high.

##### **Testing the shutdown capability for Q4 and Q5 (only operation of the relay), Q0, Q1, Q2, Q3:**

The shutdown capability of these outputs is tested cyclically. The failure of the ability to shut down is detected unambiguously.

#### ***Diagnostic functions that can be configured:***

Readback of the actuator status via auxiliary contacts, position indicators etc.:

The actual status of the actuator is acquired and compared with the required status by reading back suitable auxiliary contacts or position indicators. In this way a deviation is detected unambiguously.

#### **Note:**

The DC is dependent on single-channel or dual-channel diagnostics as well as the switching frequency.

##### **Testing the shutdown capability for IQQx and Q0 - Q3:**

The shutdown capability of these outputs is tested cyclically after the activation of the function. The failure of the ability to shut down is detected unambiguously.

## 4.3.2.2 Overview of DC in relation to selected diagnostic functions

Measure	DC	Comment	Usage
Monitoring of outputs by one channel without dynamic test	0-90%	DC dependent on the switching frequency  When using elements for increasing the switching rating (external relays or contactors), only effective in conjunction with readback function for the switching contacts	Monitoring of electromechanical, pneumatic or hydraulic actuators / outputs
Redundant shutdown path with monitoring of one of the drive elements	90%	When using elements for increasing the switching rating (external relays or contactors), only effective in conjunction with readback function for the switching contacts	Monitoring of outputs with direct function as safety circuit or monitoring of safety circuits with elements for increasing the switching rating or pneumatic/hydraulic control valves in conjunction with readback function for their switching status
Cross comparison of output signals with immediate and intermediate results in the logic (L) and program execution monitoring in relation to timing and logic, and detection of static failures and short-circuits (with multiple inputs/outputs)	99%	When using elements for increasing the switching rating (external relays or contactors), only effective in conjunction with readback function for the switching contacts  For applications with frequent demand for the safety shutdown, testing should be at short intervals, e.g. at the start of the shift, 1 x per week. However, a test should be undertaken cyclically at least 1 x per year.	Monitoring of outputs with direct function as safety circuit or monitoring of safety circuits with elements for increasing the switching rating or pneumatic/hydraulic control valves in conjunction with readback function for their switching status


## 4.3.3 Permissible capacitive and inductive load on safe outputs

The safe outputs on the PSC1 are of an OSSD character. I.e. the outputs are shut down cyclically to test the shutdown capability and the status read back.

The test on the shutdown capability is undertaken based on the following criteria / functions:

- After the shutdown of the output, the output voltage is allowed to be max. 5.6 V
- The permissible voltage must be reached at the latest after 400  $\mu$ s
- If the permissible voltage is reached, the test is considered successful, the output is re-activated without any further delay
- If the permissible voltage has still not been reached after 400  $\mu$ s, an alarm is triggered and all safe outputs (second channel for safe outputs!) are deactivated

The illustration below shows the ideal (green) and typical (red) curves.

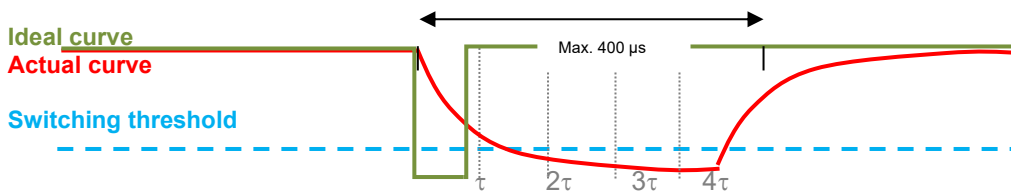

To determine the maximum permissible capacitance or inductance, the time constant  $\tau$  of the actual RC or RL element on the output is to be considered.

This RC or RL element defines the actual discharge curve:

The voltage of max. 5.6 V is reliably achieved after 3  $\tau$ .

**Therefore:**

$$3 \tau \leq 350 \mu\text{s}$$

$$\tau \leq 100 \mu\text{s}$$

**With the relationship**

$$\tau = RC = \frac{L}{R}$$

**The max. capacitive or inductive load that can be used in conjunction with the related ohmic load can be determined:**

$$C_{\max} = \frac{\tau}{R} = \frac{10^{-4}}{R}$$

or

$$L_{\max} = \tau * R = 10^{-4} * R$$

Typical values for the capacitance C are C=20 nF and for the series inductance L = 100 mH

## 4.3.4 Digital outputs

The modules

- PSC1-C-100
- PSC1-E-131-..., PSC1-E-133-..., PSC1-E-37-..., PSC1-E-38-...

each have identical outputs.

**The PSC1 series provides different types of outputs that can be connected, either separately or in groups.**

Output	Architecture according to EN ISO 13849-1	Remark
Combination of 2 relays Q4 – Q5	4	Complete shutdown channel corresponding to category 4 according to EN ISO 13849-1
Q4,Q5, Qx.0.y-Qx.3.y	Not safe	Only functional
Q0_P and Q1_N	4	Complete shutdown channel corresponding to category 4 according to EN ISO 13849-1
Q0_P	Not safe	Only functional
Q1_N	Not safe	Only functional
Q2_P and Q3_N	4	Complete shutdown channel corresponding to category 4 according to EN ISO 13849-1
Q2_P	Not safe	Only functional
Q3_N	Not safe	Only functional
Q0 – Q3	4	Complete shutdown channel corresponding to category 4 according to EN ISO 13849-1
Y0	Not safe	Signal output
Y1	Not safe	Signal output

The Qx\_P, Qx\_N and Qx outputs are subjected to a plausibility test in all operating states. In the switched-on state, all outputs are tested for correct function using a cyclic test pulse. For this purpose, the output is switched to the corresponding inverse value for a test duration  $TT < 300 \mu s$  as a maximum, i.e. a P output is briefly switched to 0 VDC potential and an M output is briefly switched to 24 VDC potential.

The relay outputs are monitored for plausibility during each switching operation. The relay outputs must be switched cyclically and therefore tested to retain the safety function. The switching/test cycle is to be defined dependent on the application.

### **Note:**

When using PSC1-E-33 module please observe note in section 5.7.7.

## **Safety instructions:**

- For applications with frequent demand for the safety shutdown, testing should be at short intervals, e.g. at the start of the shift, 1 x per week. However, a test should be undertaken cyclically at least 1 x per year.
- The test function for the outputs is undertaken for group operation and individual operation. The signal outputs are not tested.
- The high-side (Qx\_P) and low-side (Qx\_N) outputs are not allowed to be used individually for safety tasks. Usage for safety tasks is only permissible in the combination high-side / low-side.
- Mixed operation of the relay contacts is not allowed!
- Mixed operation: A hazardous touch voltage potential may not be mixed with a safety extra-low voltage.

### **Example:**

**INCORRECT:** 230 V AC are switched via Q4.1 + Q4.2 and 24 V DC are switched via Q5.1 + Q5.2.

**CORRECT:** 230 V AC are switched via Q4.1 + Q4.2 and Q5.1 + Q5.2  
or 24 V DC are switched via Q4.1 + Q4.2 and Q5.1 + Q5.2.

### **The outputs can be loaded as follows:**

Output	Voltage	Current
Relay Qx	24 VDC	2.0 A (DC13, Pilot Duty)
Relay Qx	230 VAC	2.0 A (AC15)
	120 VAC	2.0 A (Pilot Duty)
Yx	24 VDC	250 mA
Qx_P	24 VDC	2 A
Qx_N	GNDEXT	2 A
Qx	24 VDC	2A

## **Safety instructions:**

- For safety-related applications, only external switching elements with a minimum holding current of > 1.2mA may be used.
- For safety-related applications, in connection with the combination p- / n-switching outputs only external switching elements
  - with a load resistance  $\geq 100 \Omega$  with a minimum holding current of > 2mA  
or
  - with a load resistance < 100  $\Omega$  with a holding power > 0.4 mW

can be used.

### **Note:**


If the auxiliary outputs are used for control purposes, it must be ensured that after a POR of the control, the auxiliary outputs are in an undefined state in the start-up phase.

## 4.3.4.1 Example circuits, basic outputs


Attention! Identifiers for "Xxy" terminal blocks e.g. X21 are not printed on the terminal blocks. They are used in Section **Fehler! Verweisquelle konnte nicht gefunden werden. Fehler! Verweisquelle konnte nicht gefunden werden.** to find the individual terminals more quickly, e.g. "Q0\_P".

### 4.3.4.1.1 Single-channel switching relay or semiconductor output without testing

For interfacing to multiple phase applications or if higher current is required, external contactors can be used. With single-channel connection without external testing it is to be noted that sticking of one or more external contacts will not be detected by the PSC1-C-100-x module. The example circuit in the following is only suitable for safety applications to a limited extent; a maximum of PL b according to EN ISO 13849-1 can be achieved!

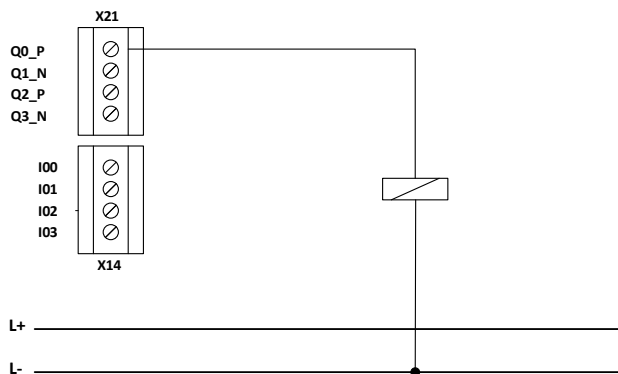

Single-channel switching P output.

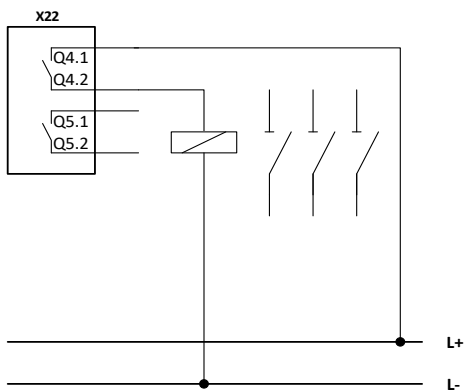

Single-channel switching relay output.



#### **Safety instructions:**

- Not recommended for safety applications! On this topic, see also the information in EN ISO 13849-1 on usage and the fault exclusions necessary.


## 4.3.4.1.2 Single-channel switching relay or semiconductor output with external device for increasing the switching rating and testing

On the usage of an external device for increasing the switching rating, or downstream electromechanical, pneumatic or hydraulic components, a device for testing the complete chain and a signalling/warning device on the detection of a fault are required to achieve PL c or higher.

In particular, positively driven auxiliary contacts are required for electromechanical devices, or valve position signal contacts are required for hydraulic or pneumatic components.

The signalling/warning device must immediately make clear the hazardous situation to the operator.

The achievable PL is heavily dependent on the test rate, a maximum of PL d according to EN ISO 13849-1 can be achieved!

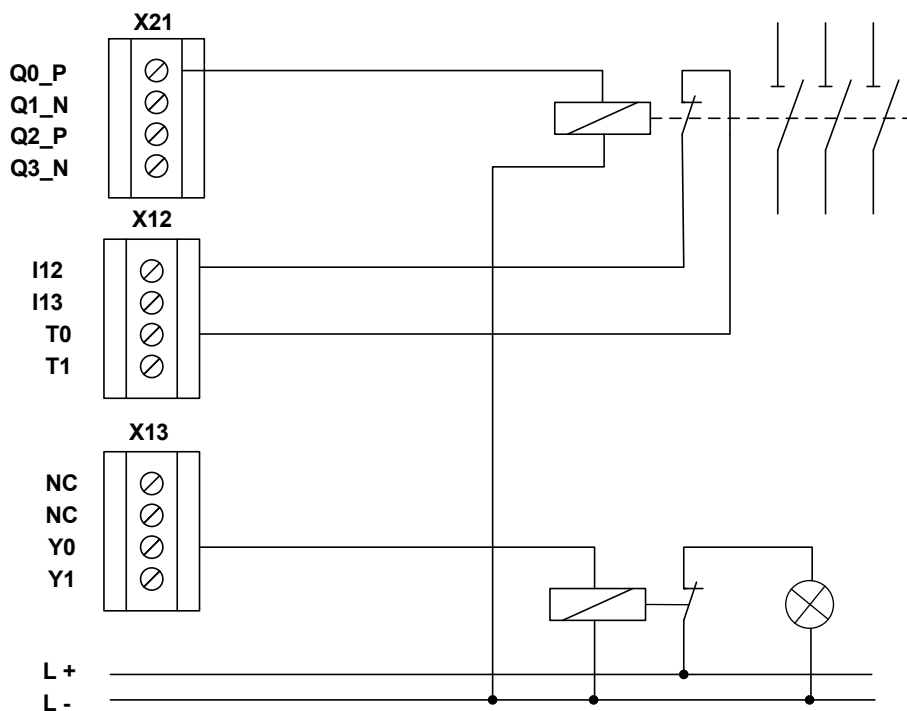

Single-channel switching relay output with testing




### **Safety instructions:**

- Only recommended to a limited extent for safety applications! On this topic, see also the information in EN ISO 13849-1 on usage and the fault exclusions necessary.
- For PL c or higher a test rate  $> 100 \cdot$  demand rate is required
- For PL c and higher, a signalling/warning device is required that immediately makes clear the hazardous situation to the operator


## 4.3.4.1.3 Single-channel switching relay or semiconductor output with dual-channel external circuit with testing

For safety applications from PL c according to EN ISO 13849-1, it is recommended or required that two external shutdown elements are operated. In addition, a device for testing the complete chain and a signalling/warning device on the detection of a fault are required to achieve PL c or higher – see comments in 4.3.4.1.2.

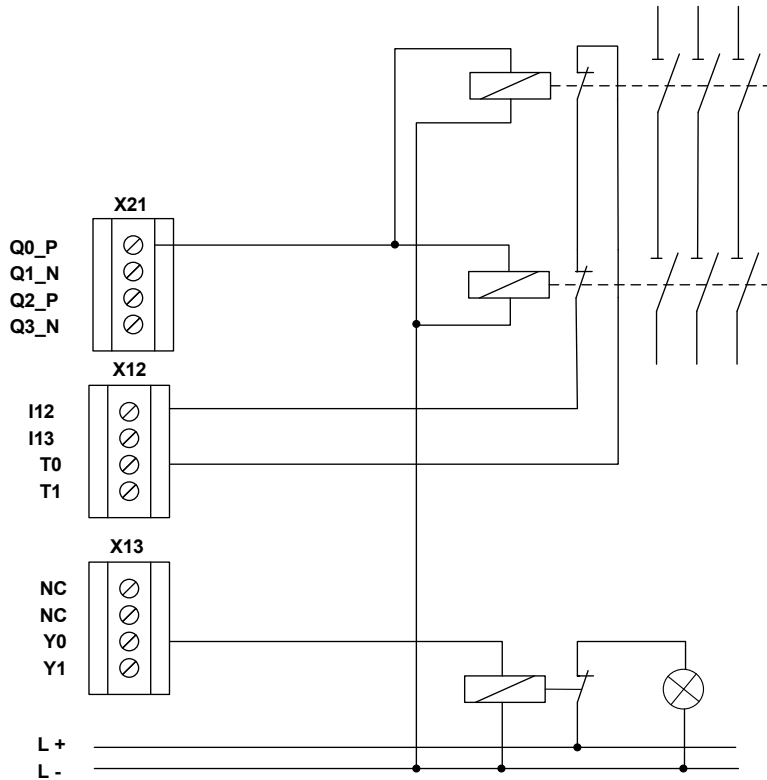

Single-channel switching output Q0\_P with dual-channel external circuit and monitoring on input 12 as collective feedback

The two external monitoring contacts are connected in series, supplied with pulse signal T0 and read via input 12. Input 12 was used as the readback input, however it is also possible to use any another input.

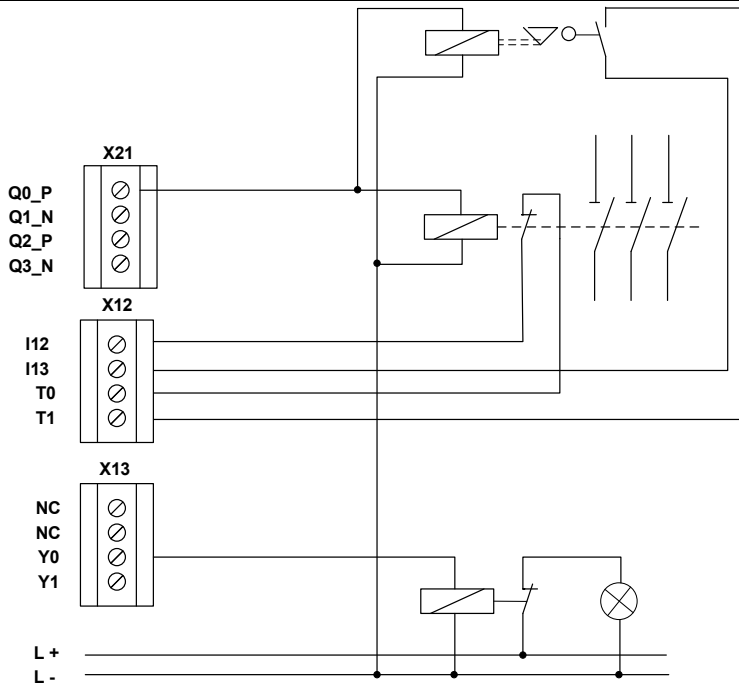


Single-channel switching output Q0\_P with dual-channel external circuit as combination of electromechanical element and hydraulic/pneumatic valve monitoring on two inputs

## **Safety instructions:**

- Only recommended to a limited extent for safety applications! On this topic, see also the information in EN ISO 13849-1 on usage and the fault exclusions necessary.
- For PL c and higher a signalling/warning device is required that immediately makes clear the hazardous situation to the operator
- With increased requirements, it must be noted that at least 1 switching process must take place every 24 hours to test the switching ability of the external contactor.

## 4.3.4.1.4 Dual-channel switching relay output with external monitoring - collective feedback

For safety applications from PL d according to EN ISO 13849-1, two relays are used in the PSC1-C-100 module and two external contactors.

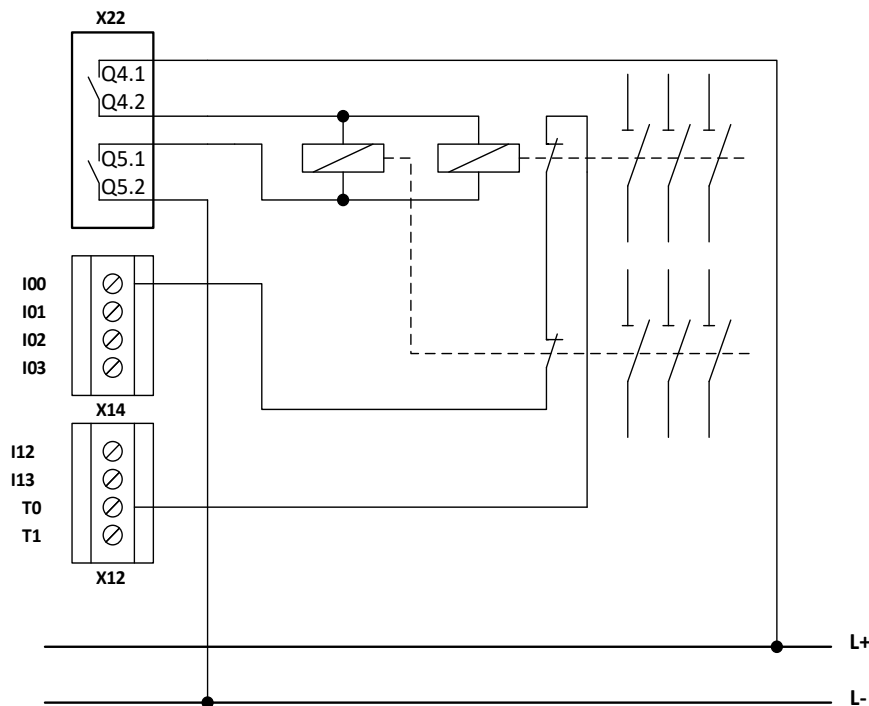

Dual-channel switching relay output with external monitoring – collective feedback


The two external monitoring contacts are connected in series, supplied with pulse signal T0 and read by I00 (configured as EMU input). With increased requirements, it must be noted that at least 1 switching process must take place at least every 24 hours.

### **Safety instructions:**

- An adequately high test rate is required to achieve PL e according to EN ISO 13849-1.
- For applications with frequent demand for the safety shutdown, testing should be at short intervals, e.g. at the start of the shift, 1 x per week. However, a test should be undertaken cyclically at least 1 x per year.


## 4.3.4.1.5 Dual-channel output with relay output and semiconductor output – external control circuit with monitoring

For safety applications from PL d and higher according to EN ISO 13849-1. The external circuit is operated using two channels via one relay output and one semiconductor output. Each of the two external shutdown paths is monitored. An adequately high test rate as well as  $MTTF_d$  = high for the external circuit are required for PL e according to EN ISO 13849-1.

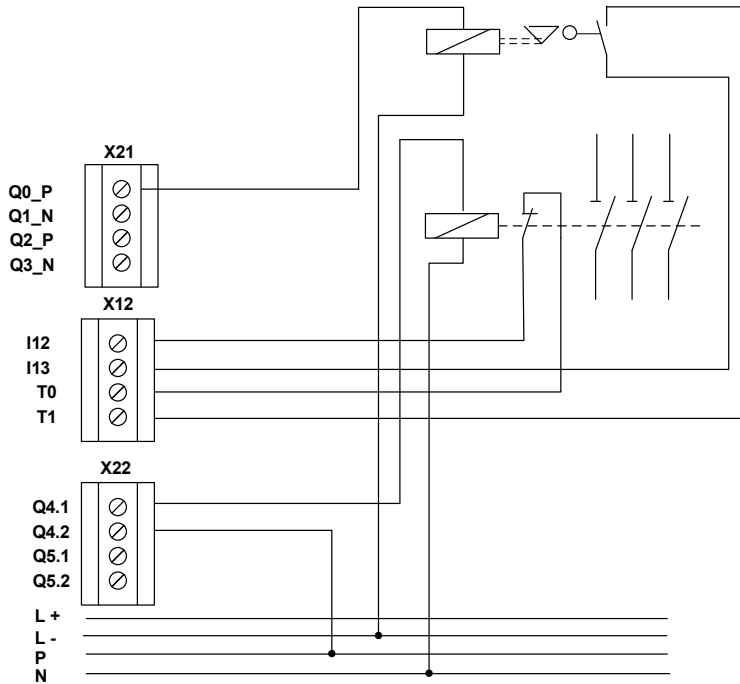

## 4.3.4.1.6 Dual-channel output with relay output - external control circuit in PL e


For safety applications from PL d and higher according to EN ISO 13849-1. The external circuit is operated using two channels via the relay outputs. An adequately high test rate as well as PL e for the external circuit are required for PL e according to EN ISO 13849-1.

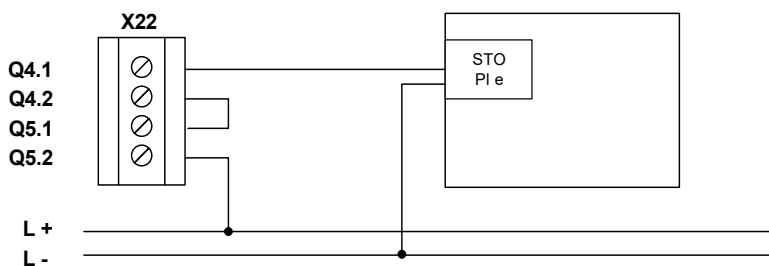

Dual-channel output with relay output - external control circuit in PL e

## 4.3.4.1.7 Dual-channel output with semiconductor output and external control circuit in PL e


For safety applications from PL d and higher according to EN ISO 13849-1. The external circuit is operated using two channels via semiconductor outputs. PL e is required for the external circuit for PL e according to EN ISO 13849-1.

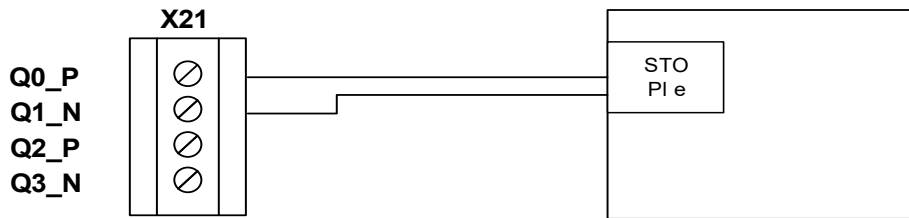

Dual-channel output with semiconductor output and external control circuit in PL e

## 4.3.4.1.8 Connecting a signal output

The semiconductor outputs implemented in the PSC1-C-100 module can be used for functional applications. The outputs are not pulsed.

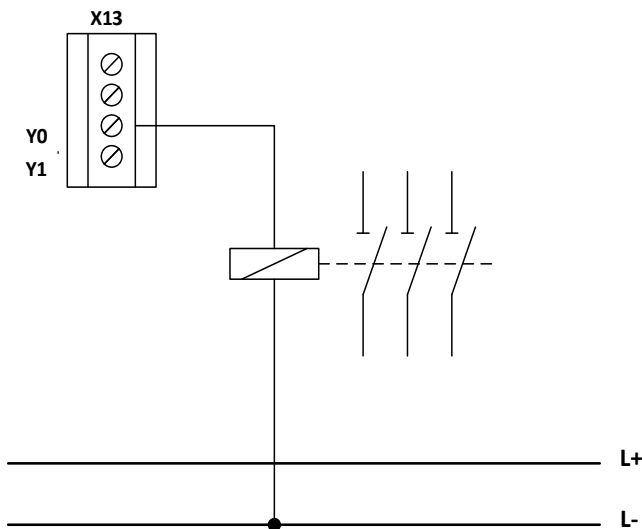

Connecting a signal output

Applications with auxiliary outputs are not allowed for safety applications!

## 4.3.5 Digital outputs I/O (IQQx)

The modules PSC1-C-100, PSC1-E-131-... and PSC1-E-133-... have a different number of configurable safe digital I/Os (see section 3.1 Module overview). Configured as an output, this connection acts as a safe digital pp switching output (IQQx).

### 4.3.5.1 Classification of the I/O (IQQx) when used as an output

Classification	Achievable PL according to EN ISO 13849-1	Remark
Static single-channel <sup>(2)</sup>	PL c	Fault detection and fault reaction as per sec. 2
Static dual-channel <sup>(2)</sup>	PL d	Same group <sup>(1)</sup> : <ul style="list-style-type: none"> <li>- Operation delayed at PLC level</li> <li>- Fault assumption short-circuit on both outputs</li> </ul> Different group <sup>(1)</sup> : <ul style="list-style-type: none"> <li>- No further requirement necessary</li> </ul>
	PL e	Different group <sup>(1)</sup> required
Dynamic single-channel <sup>(2)</sup>	PL e	No further requirement necessary
Dynamic dual-channel <sup>(2)</sup>		

#### **Note:**

- <sup>1)</sup> Group 1:           IQQ00 ... IQQ05  
Group 2:           IQQ06 ... IQQ09


- <sup>2)</sup> Static:            No pulse test on the output  
Dynamic:          Pulse test on the output with  $t_{Test} \leq 500 \mu s$

## 4.3.5.2 Example circuits for safe digital outputs I/O (IQQx)

Attention! Identifiers for "Xxy" terminal blocks e.g. X12 are not printed on the terminal blocks. They are used in Section **Fehler! Verweisquelle konnte nicht gefunden werden. Fehler! Verweisquelle konnte nicht gefunden werden.** to find the individual terminals more quickly, e.g. "IQQ00".

### 4.3.5.2.1 Single-channel circuit without testing

When using a dual-channel output (IQQx) in conjunction with a single-channel external circuit without external testing, it must be noted that sticking of one or more external contacts will not be detected by the PSC1-C-100-x module. The example circuit in the following is only suitable for safety applications to a limited extent; a maximum of PL b according to EN ISO 13849-1 can be achieved!

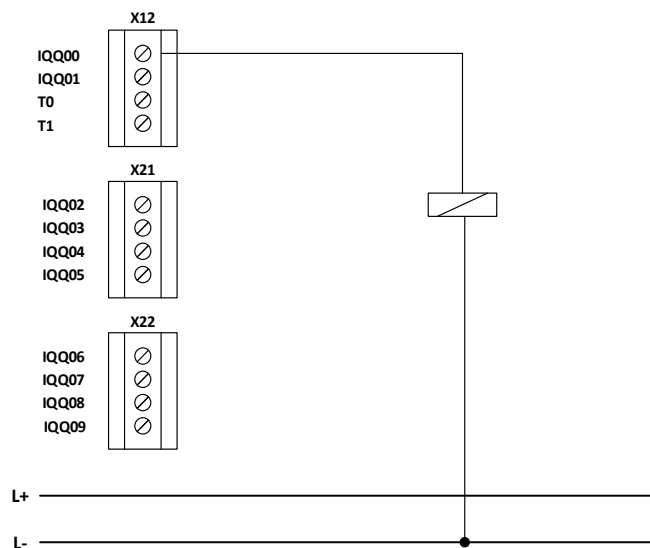

Dual-channel output with single-channel circuit without testing




### **Safety instructions:**

- Not recommended for safety applications! On this topic, see also the information in EN ISO 13849-1 on usage and the fault exclusions necessary.

## 4.3.5.2.2 Single-channel circuit with testing

When using a dual-channel output (IQQx) in conjunction with a single-channel external circuit with testing. In particular, positively driven auxiliary contacts are required for electromechanical devices, or valve position signal contacts are required for this purpose for hydraulic or pneumatic components. A signalling/warning device for the indication of the failure is required. The signalling/warning device must immediately make clear the hazardous situation to the operator.

The achievable PL is heavily dependent on the test rate, a maximum of PL d according to EN ISO 13849-1 can be achieved!

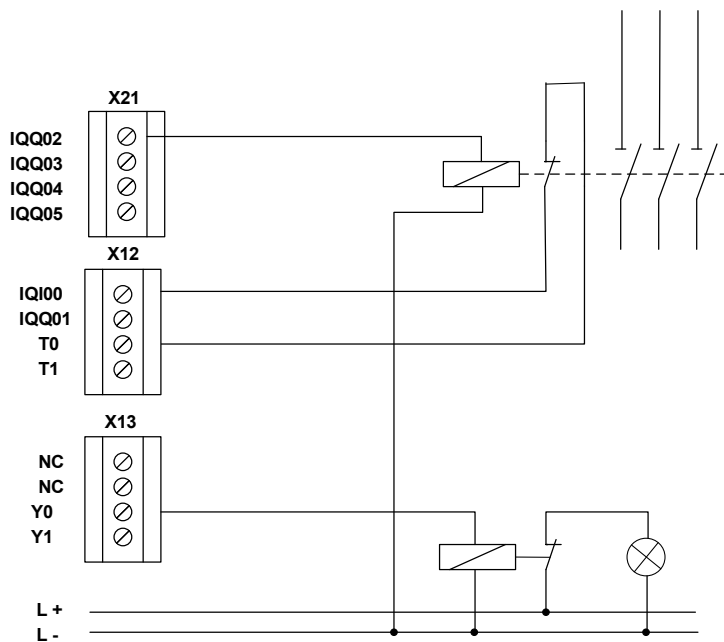


Dual-channel output with single-channel circuit with testing

### **Safety instructions:**

- Only recommended to a limited extent for safety applications! On this topic, see also the information in EN ISO 13849-1 on usage and the fault exclusions necessary.
- For PL c or higher, a test rate  $> 100 \cdot \text{demand rate}$  is required.  
Alternatively, testing of the safety function can now also be carried out immediately upon request, if the total time required to detect the failure and to transfer the machine to a safe state (usually the machine is stopped) is shorter than the time required to reach the hazard.
- For PL c and higher, a signalling/warning device is required that immediately makes clear the hazardous situation to the operator

## 4.3.5.2.3 Circuit with safe shutdown circuit

For safety applications from PL c and higher according to EN ISO 13849-1. The external circuit is operated directly using a dual-channel output. The achievable PL according to EN ISO 13849-1 is dependent on the usage of dynamic testing (see 4.3.2.1 DC) as well as the PL for the downstream device.

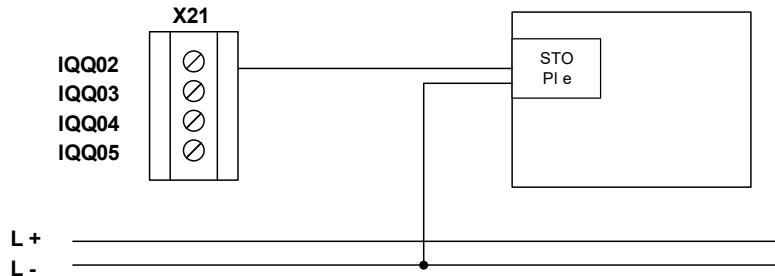


Dual-channel output in conjunction with device with tested shutdown

## 4.3.5.2.4 Circuit with dual-channel shutdown circuit

Suitable for PL d or higher according to EN ISO 13849-1. Use of a dual-channel output IQQx in conjunction with a dual-channel external circuit with testing. In particular, positively driven auxiliary contacts are required for electromechanical devices, or valve position signal contacts are required for this purpose for hydraulic or pneumatic components.

The achievable PL is dependent on the dynamic testing as well as the  $MTTF_D$  for the external circuit. A maximum of PL e according to EN ISO 13849-1 can be achieved!

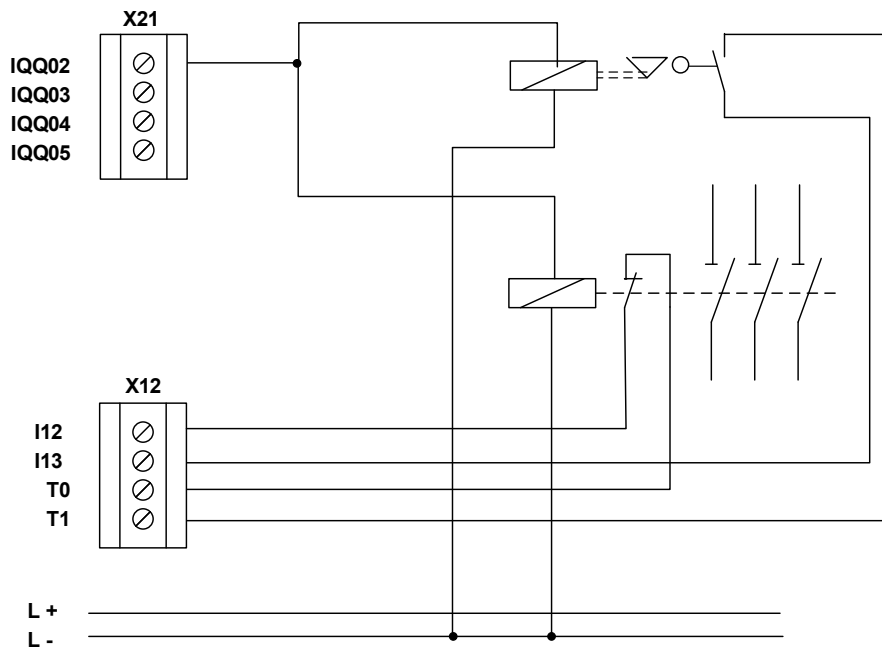


Dual-channel output in conjunction with dual-channel shutdown circuit with testing

## 4.3.5.2.5 Redundant dual-channel output


Suitable for PL d or higher according to EN ISO 13849-1. Use of two outputs IQQx in conjunction with a dual-channel external circuit.

### 4.3.5.2.5.1 Dual-channel circuit in same group

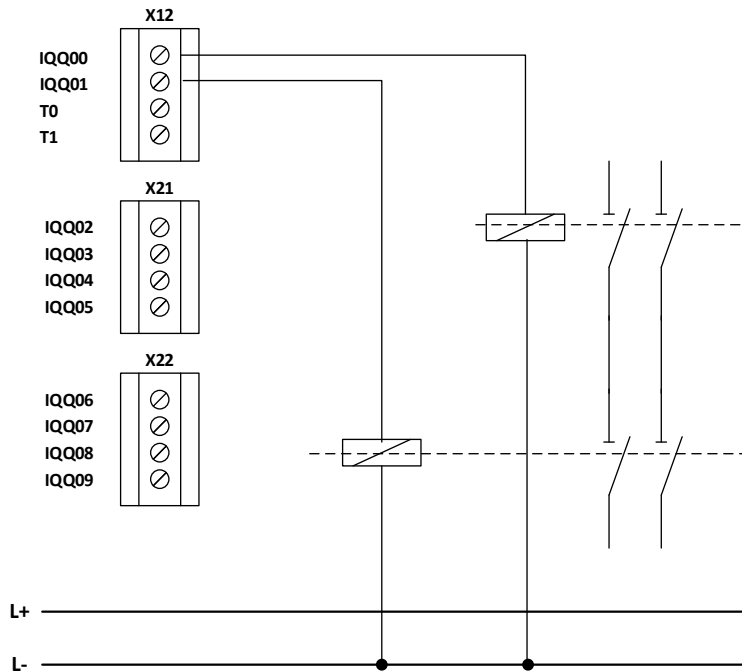

Redundant dual-channel outputs in same group in conjunction with dual-channel shutdown circuit

### 4.3.5.2.5.2 Dual-channel circuit in different groups

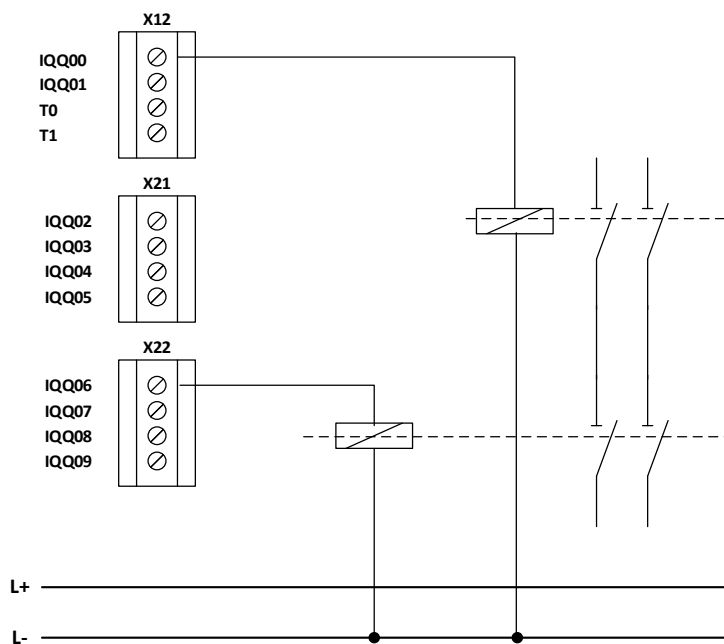

Redundant dual-channel outputs in different groups in conjunction with dual-channel shutdown circuit



## **Safety instructions:**

- For the safety-related assessment of the output sub-system, the data from the manufacturer (MTTFD, FIT figures, B10d value, etc.) must be used when using external elements in the shutdown circuit, e.g. for increasing the switching rating.
- The DC values stated in the table should be used conservatively and compliance with the boundary conditions (see "Comments" in table) ensured.
- Fault exclusions are allowed according to the applicable standards. The boundary conditions listed are to be ensured over the long-term.
- When using elements for increasing the switching rating in safety circuits, the function of these elements must be monitored using suitable readback contacts, etc. (see example circuits). Suitable readback contacts are contacts that are forced to switch with the contacts in the shutdown circuit.
- The switching ability of the external switching amplifier must be checked cyclically. The interval between two tests is to be defined to suit the requirement based on the application and safeguarded by means of suitable measures. Suitable measures can be of an organisational (switching off and on at the start of the shift etc.) or technical (automatic, cyclic switching) nature.

## 4.3.5.3 Overview of achievable PL for digital safety outputs

Output PSC1	Actuator / external shutdown circuit	Category according to EN ISO 13849-1	DC		MTTF <sub>D</sub> actuator	Achievable PL according to EN ISO 13849-1	Boundary condition	Fault exclusion
Single-channel without dynamic output test Qx Q0_P, Q1_N, Q2_P, Q3_N IQQx	Single-channel Contactor, valve, brake etc. without direct feedback for diagnostics	Cat. B	0 %		Medium	B	Contactors and downstream actuators suitably designed for safety application	
	Single-channel Contactor, valve, brake etc. with monitored, positively driven auxiliary contact	Cat. 2	60-90%	Dependent on switching frequency	Medium	B	Signal output required for warning if malfunction detected  Contactors and downstream actuators suitably designed for safety application	
					High	C	As before	
						D	As before DC = 90% due to adequately high test rate in relation to the application	
Single-channel without dynamic output test Qx or Single-channel Q0_P, Q1_N, Q2_P, Q3_N	Dual-channel Contactor, valve, brake etc. with direct feedback for diagnostics in at least one channel or Actuator operated with single channel with safety function cat. 3 (e.g. STO)	Cat. 2	90%	Monitoring only in one external shutdown circuit	Medium	c	Signal output required for warning if malfunction detected  Contactors and downstream actuators suitably designed for safety application	Short-circuit on external operation
					High	d		
Single-channel without dynamic output test IQQ00 ..IQQ09	Dual-channel Contactor, valve, brake etc. with direct feedback for diagnostics in at least one channel or Actuator operated with single channel with safety function cat. 3 (e.g. STO)	Cat. 3	90 %	Monitoring only in one external shutdown circuit	Medium or high	d	Contactors and downstream actuators suitably designed for safety application	Short-circuit on external operation
Single-channel with dynamic output test IQQ00 ..IQQ09	Dual-channel Contactor, valve, brake etc. with direct feedback for diagnostics in both channels or Actuator with safety function cat. 4 (e.g. STO)	Cat. 4	99%	Monitoring in both external shutdown circuits	High	e	Contactors and downstream actuators suitably designed for safety application Monitoring electromechanical components by means of positively driven switches, position monitoring on switching valves etc.	

Output PSC1	Actuator / external shutdown circuit	Category according to EN ISO 13849-1	DC		MTTF <sub>D</sub> actuator	Achievable PL according to EN ISO 13849-1	Boundary condition	Fault exclusion
Dual-channel without dynamic output test Q0/Q1, Q2/Q3  2 x IQQ00 ..IQQ09	Dual-channel Contactor, valve, brake etc. with direct feedback for diagnostics in at least one channel or Actuator with safety function cat. 4 (e.g. STO)	Cat. 3	90%	Monitoring in both external shutdown circuits	Medium or high	d	Contactor and downstream actuators suitably designed for safety application  Monitoring electromechanical components by means of positively driven switches, position monitoring on switching valves etc.  Outputs IQQ0...19 1 x from different groups (groups of 6/4 contiguous IQQ ports, e.g. IQQ0...5, IQQ6...9)  or  Operation delayed at PLC level	Short-circuit on external operation
Dual-channel Q0/Q1, Q2/Q3  or  Dual-channel with dynamic output test Q0_P and Q1_N, Q2_P and Q3_N  2 x IQQ00 ..IQQ09	Dual-channel Contactor, valve, brake etc. with direct feedback for diagnostics in both channels or Actuator with safety function cat. 4 (e.g. STO)	Cat. 4	99%	Monitoring in both external shutdown circuits	High	e	Contactor and downstream actuators suitably designed for safety application  Monitoring electromechanical components by means of positively driven switches, position monitoring on switching valves etc.  For applications with frequent demand for the safety shutdown, testing should be at short intervals, e.g. at the start of the shift, 1 x per week. However, a test should be undertaken cyclically at least 1 x per year.	Short-circuit on external operation in both channels

## **Note:**

When using PSC1-E-33 module please observe note in section 5.7.7.

## 5 Connection and installation

### 5.1 General installation instructions

It is imperative you follow the safety instructions during installation!

#### ***Degree of protection IP20***

Lay all signal wires for connection to the digital inputs and contact monitoring separately.

Under all circumstances, separate voltages of 230 VAC (120VAC cULus) from low-voltage wires if these voltages are used in relation to the application .

The length of the cables for the digital inputs and outputs should in general not exceed **30 m**.

If the cable length exceeds a value of 30 m, suitable measures are to be taken to exclude inadmissible overvoltage faults. Suitable measures are, for instance, lightning protection for wires outdoors, overvoltage protection for the installation indoors, protected cable laying.

#### **cULus only:**

The cable length of 30 m must not be exceeded.

#### ***Measures for electromagnetic compatibility (EMC)***

The PSC1 module is intended to be used with drives and meets the EMC requirements stated above. In addition, it is a prerequisite that the electromagnetic compatibility of the overall system is safeguarded using customary measures.

## **Safety instructions:**

- It must be ensured that the power supply wires for the PSC1 and "switching wires" for the power converter are laid separately.
- Signal wires and power wires for the power converter must be laid in separate cable ducts. The distance between the cable ducts should be at least 10 mm.
- Only screened wires are to be used to connect the position and speed sensors. The cables for the transmission of the signals must be suitable for the RS-485 standard (twisted pairs).
- The screen is to be connected correctly to the 9-pin SUB-D connectors for the position and speed acquisition sensors. Only metal or metallised connectors are allowed.
- The screen at the sensor end must be laid according to customary methods.
- Attention is to be paid to the correct installation in relation to EMC of the power converter technology in the area of the PSC1 module. Particular attention should be paid to cable routing and the connection of the screen for the motor cable and the connection of brake resistor. Here it is imperative the installation guidelines from the manufacturer of the power converter are followed.
- All contactors in the area of the converter must be equipped with an appropriate suppressor circuit.
- **All contactors or comparable switching amplifiers must be equipped with appropriate protective circuitry (e.g. free-wheeling diodes).**
- Suitable measures for protection against overvoltage are to be taken.

## **Used symbols according to UL 61010-1**



The temperature at the connection terminals can be over 60 ° C. Suitable cable types must be used from this temperature.

## 5.2 Installation and mounting PSC1 module

The module is only installed in switch cabinets that meet degree of protection IP54 as a minimum.

The modules must be fastened vertically on a DIN rail

The ventilation slots must be kept adequately clear to ensure the circulation of air inside the module.

A free space of 30 mm must be provided at the top and bottom of the device. A stringing together of expansion modules is permitted. A distance of 20 mm must be maintained to adjacent devices that can generate waste heat.

### **cULus only:**

Indoor use only.

## 5.3 Mounting backplane bus

The backplane bus comprises a 5-pin connector with spring contacts. As standard, all 5 contacts are used on the connectors.

### **Remark:**

Expansion modules do not have a dedicated power supply unit and rely on the backplane bus for a DC supply. Basic modules (PSC1-C-100 (-FBx)) have a more powerful power supply unit and always provide a supply on the backplane bus.

### ***There is currently only one type of backplane bus connector:***

- **PSC1-A-80-CON-TBUS-POWER:**  
Standard version (all contacts are available)

(Colour may differ from backplane bus connectors shown in **Fehler! Verweisquelle konnte nicht gefunden werden.**)

### ***Usage of the backplane bus connector PSC1-A-80-CON-TBUS-POWER:***


The backplane connector **PSC1-A-80-CON-TBUS-POWER** can only be installed in conjunction with expansion modules without a dedicated supply of power. It is not possible to connect several standalone modules.

## 5.3.1 Arrangement examples

### 5.3.1.1 PSC1-C-100-FBx + PSC1-E-23-SDM2

**PSC1-C-100-FBx**


**PSC1-E-23-SDM2**

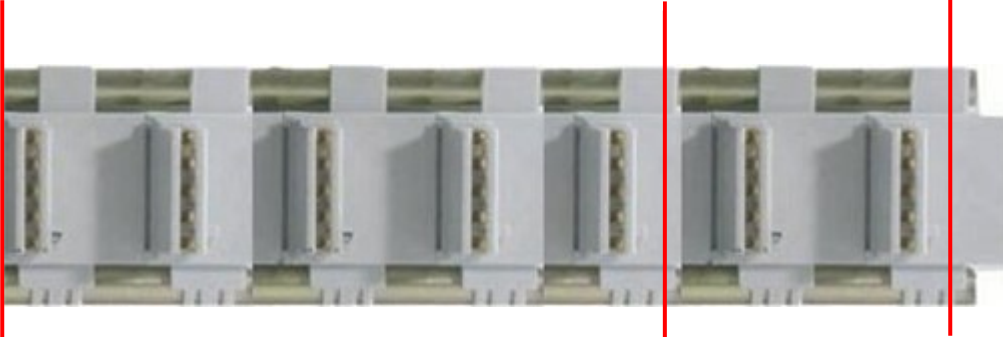

### 5.3.1.2 PSC1-C-100 + PSC1-E-24-SDM2-2

**PSC1-C-100**

**PSC1-E-24-SDM2-2**

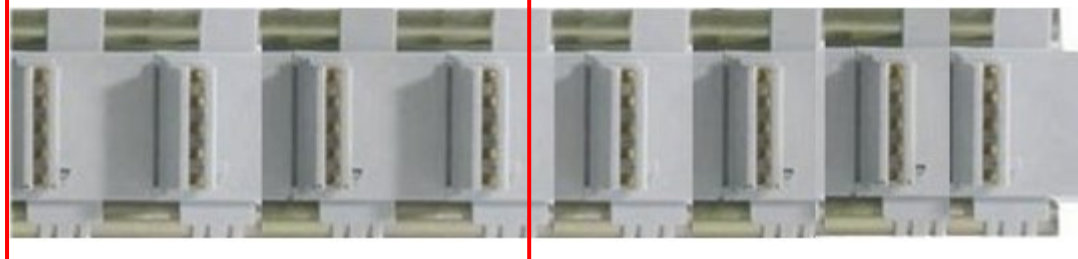


## 5.4 Mounting the modules

The modules are mounted on standard C rails using a snap-action catch


### 5.4.1 5.4.1 Mounting on C rail

The devices are fitted to the rail from above at an angle and snapped downward. They are removed using a screwdriver that is inserted in the slot on the catch protruding from the bottom of the device and then moved upward.

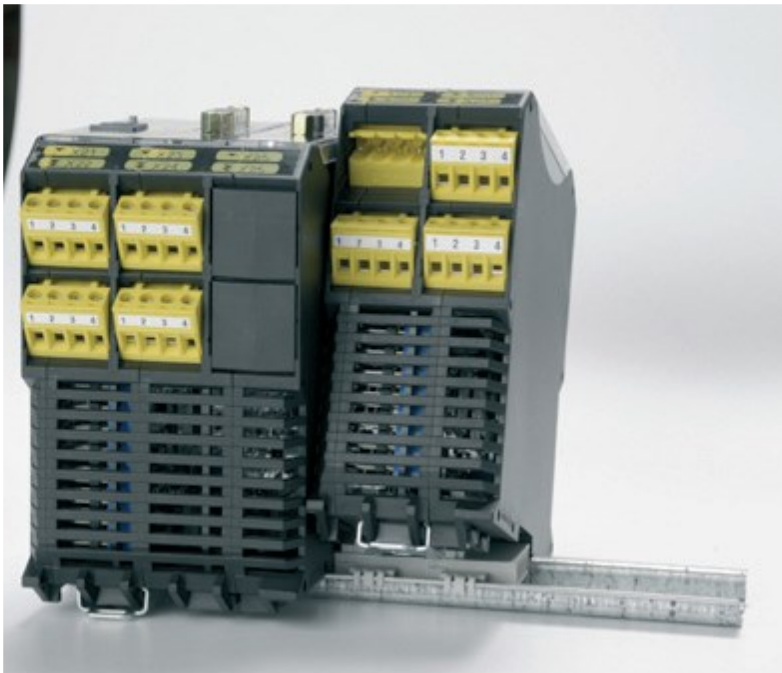

## 5.4.2 Mounting on backplane bus

The device can be installed after mounting the backplane bus. For this purpose the module is fitted to the connector at an angle from above and snapped to the C rail

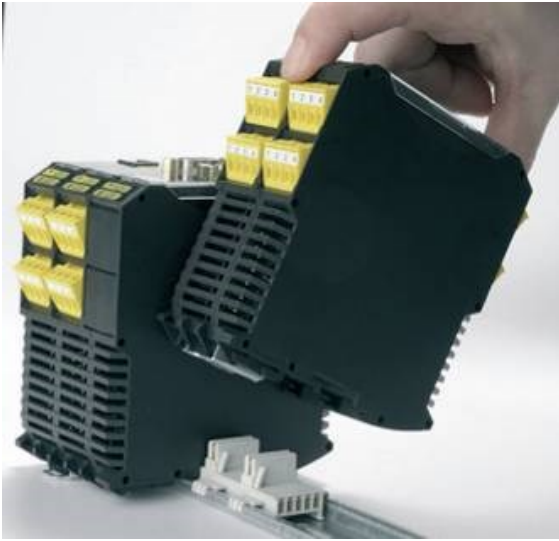

Fit module at an angle from above...



...and snap down onto the C rail


The backplane connection can be retrofitted. In this way the system configuration can be expanded with additional modules.



Snap backplane bus element to C rail and insert in the mating piece by pushing to the side

## 5.5 Installation and configuration of master ↔ master (SMMC) and master ↔ slave (SDDC)

The **SMMC** communication allows to safely exchange 2 bytes of data between up to four\*1 master devices.

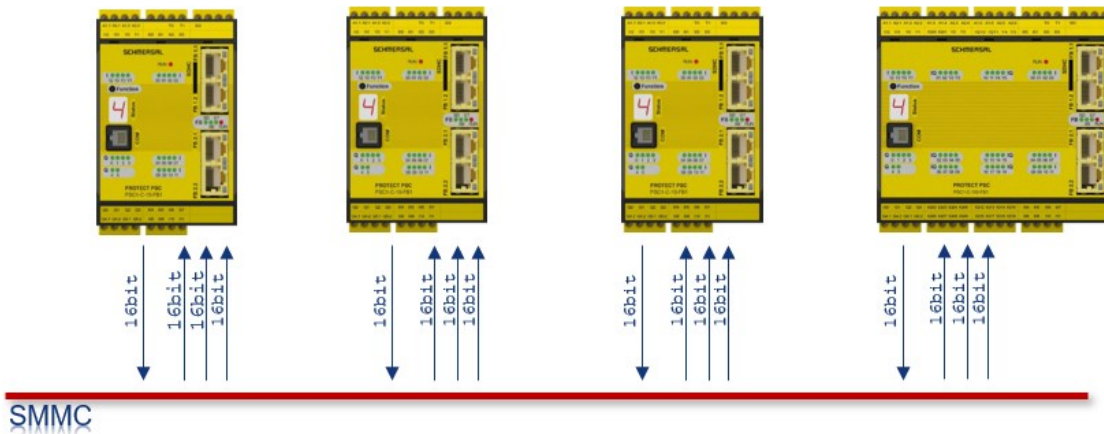

Communication takes place without the master for the co-ordination of the data. As such there is always an exchange of data between available bus users.

Due to this principle of operation, an incomplete or disconnected network can operate in sections without changing the configuration.

To be able to coordinate several masters with different cycle times, an SMMC cycle time is configured in the parameters; this cycle time must be maintained by all bus users.

This cycle time is the smallest common multiple of the cycle time of the individual bus users.


### **Note:**

\*A maximum of **three** PSC1-C-10-xx-FBx can be connected.

Data exchange between the master and extension modules uses **SDDC**. Either central via the backplane bus connector or decentral via Ethernet.


## 5.5.1 SMMC/SDDC topology rules

Expansion modules must be directly connected to the associated master.

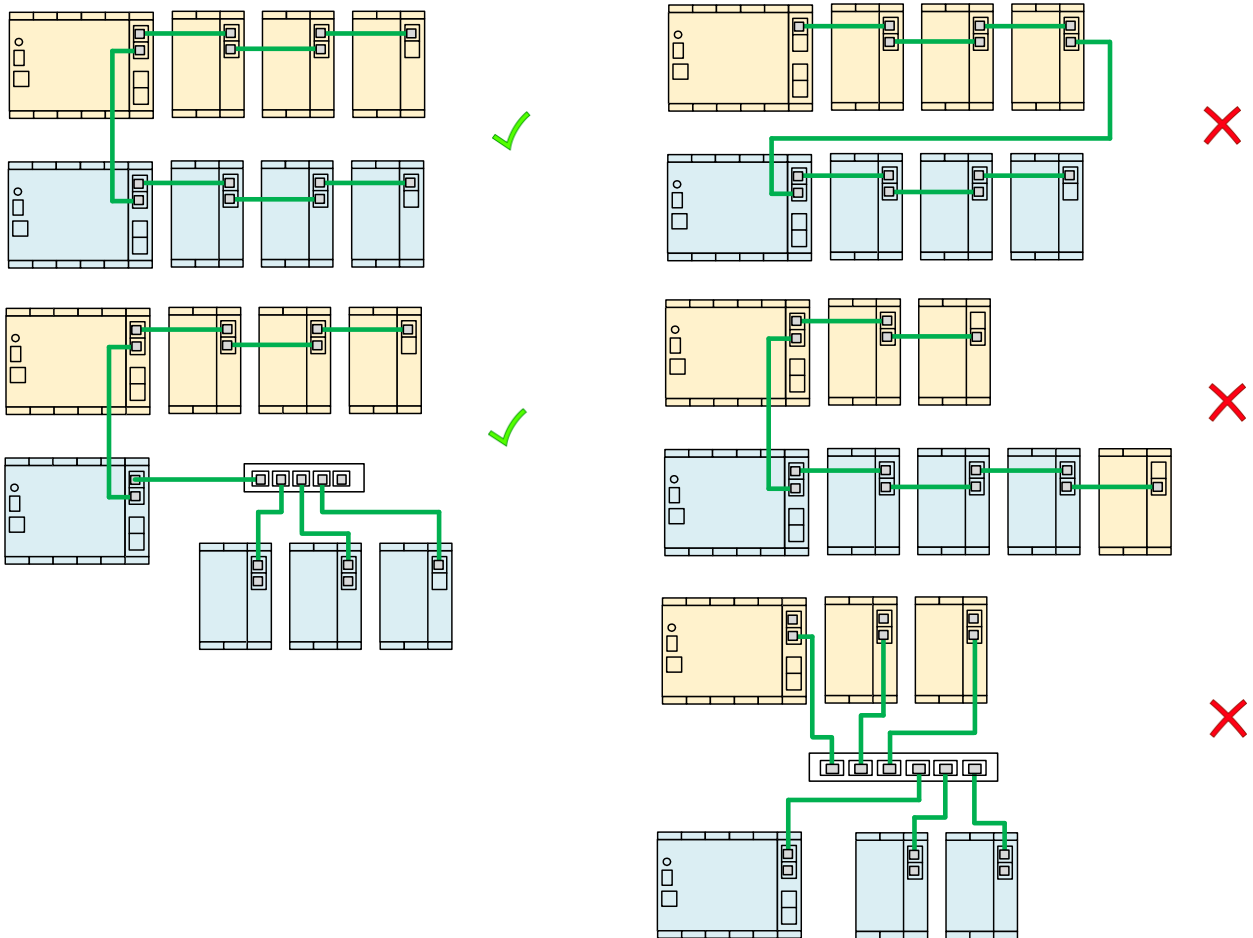

If switches are used, they should be used solely for the SDDC or SMMC signals. Due to the short cycle time of the SMMC/SDDC communication, it is also recommended to - if possible - deactivate all functions generating additional data traffic (like e.g. Spanning Tree Protocol (STP)).


## 5.5.2 Exemplary schematic diagram of a network topology

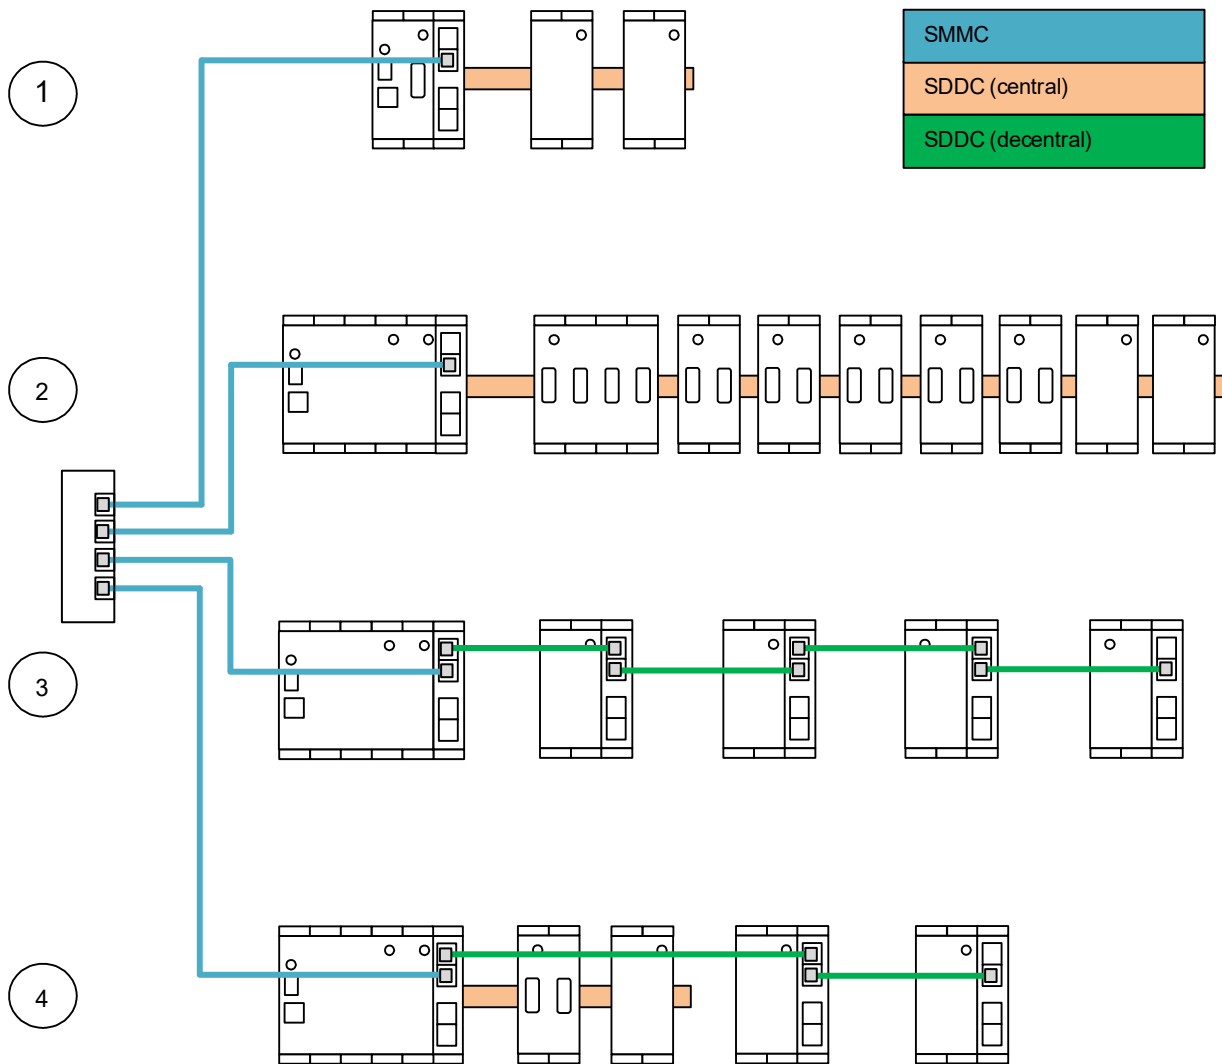

1	<p>Communication of a PSC1-C-10 with</p> <ul style="list-style-type: none"> <li>• Central expansion modules via SDDC backplane bus</li> <li>• SMMC Ethernet</li> </ul>
2	<p>Communication of a PSC1-C-100 with</p> <ul style="list-style-type: none"> <li>• Central expansion modules via SDDC backplane bus</li> <li>• SMMC Ethernet</li> </ul>
3	<p>Communication of a PSC1-C-100 with</p> <ul style="list-style-type: none"> <li>• Decentral expansion module via SDDC Ethernet</li> <li>• SMMC Ethernet</li> </ul>
4	<p>Communication of a PSC1-C-100 with</p> <ul style="list-style-type: none"> <li>• Decentral expansion modules via SDDC Ethernet</li> <li>• Central expansion modules via SDDC backplane bus</li> <li>• SMMC Ethernet</li> </ul>


## 5.5.3 Use of serial number 0 for decentralised SDDC communication


In decentralised communication, devices are uniquely distinguished by their serial number. This is entered accordingly in SafePLC2 during configuration.

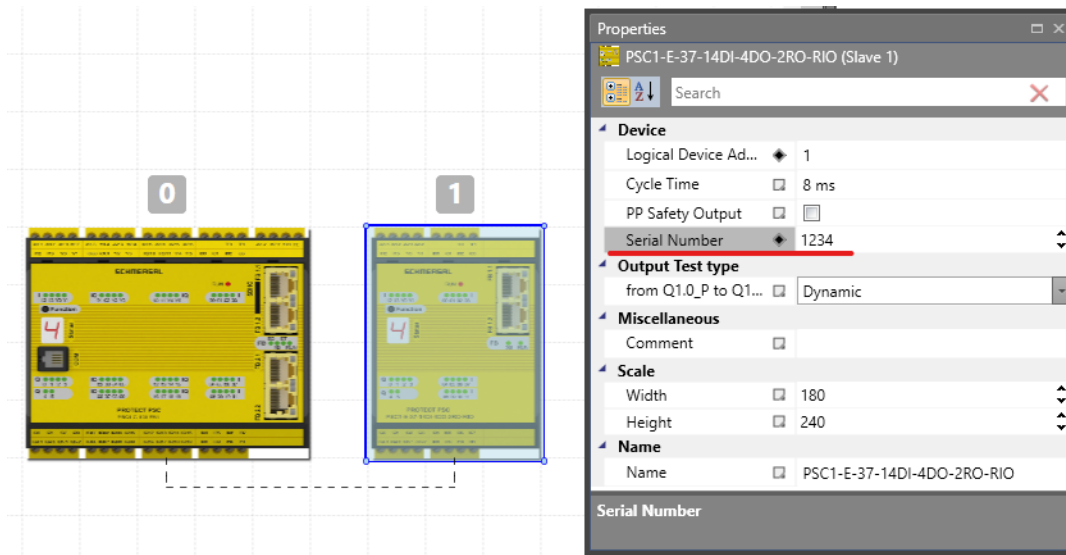

**Projecting with unique serial numbers offers the highest level of safety against incorrect connection of the modules and is therefore highly recommended.**

If using unique numbers is not practicable or desired, SafePLC2 allows the serial number 0 to be used as a placeholder for decentralised SDDC communication. The devices are then distinguished only via the rotary address switch on the back (see also chapter 5.6)


 By disregarding the serial number, not all errors in the Ethernet wiring are recognized. This can cause to unintended cross-communication between different parts of the machine, which can lead to potentially dangerous situations and thus to danger to life and limb - but also to damage to the connected peripherals!

 The safety functions must be validated after every change to the (Ethernet) device wiring! In addition, a corresponding note should be included in the operating instructions for the machine.


Examples of undetected wiring errors:

*With configured SMMC communication*

Projected

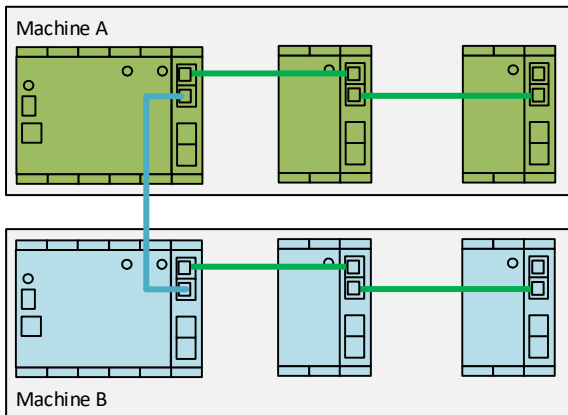


Installed

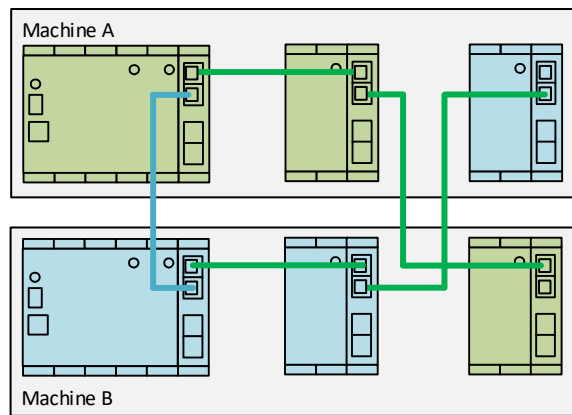


By disregarding the serial number, incorrect wiring **cannot** be recognised by the safety controller.

*With only decentralised extensions (SDDC)*

Projected

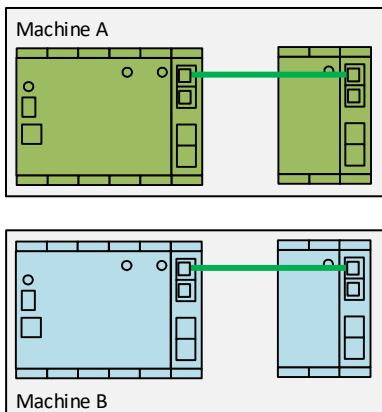

Installed

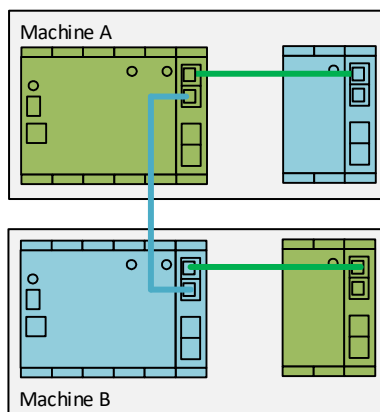

If two machines that are meant running separately are connected to each other via the SMMC connection, not evaluating the serial numbers can lead to incorrect assignment of the decentralised extensions **across** machines.

## 5.6 Installation of I/O expansion


### Note:

Max. eight PSC1-E-13x respectively PSC1-E-3x-RIO modules can be operated using a basic device. The PSC1-E-2x modules are limited to a number of six.


### 5.6.1 Physical address configuration for the slave modules (central/decentral)

The bus address must be set on the respective modules with the aid of the address switch.

The address is set on the rear panel depending on the slot (mounting position) of the module.

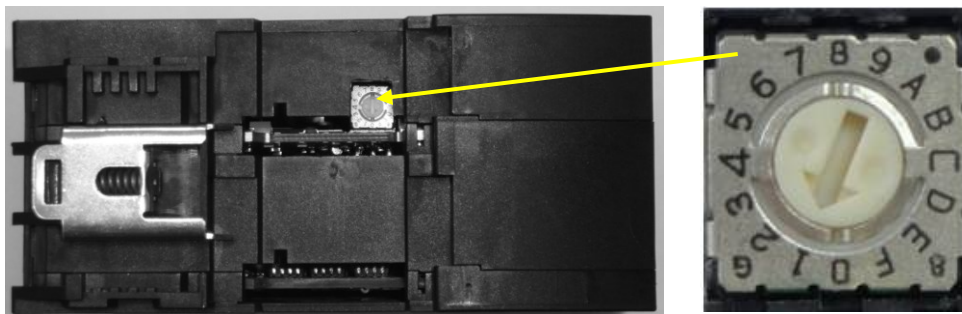

Address displayed in SafePLC2:

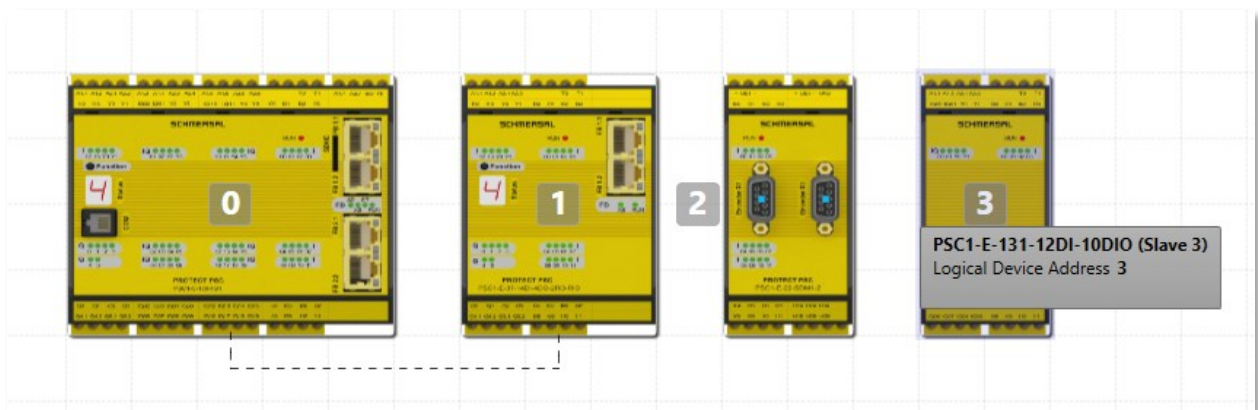


### Note:

- Address range on the PSC1-E-2x module is 1...6.
- Address range on the PSC1-E-13x/PSC1-E-3x-RIO module is 1...8.
- Address "0" is reserved for the basic device.
- Factory setting of all expansion modules: 1

## 5.7 Terminal assignment

Attention! Identifiers for "Xxy" terminal blocks, e.g. X41, are not printed on the terminal blocks. They are used in this Section to find the individual terminals more quickly, e.g. "A1.1" in the diagrams and the terminal assignment.

### 5.7.1 Terminal assignment PSC1-C-100 (-FBx/-MC)

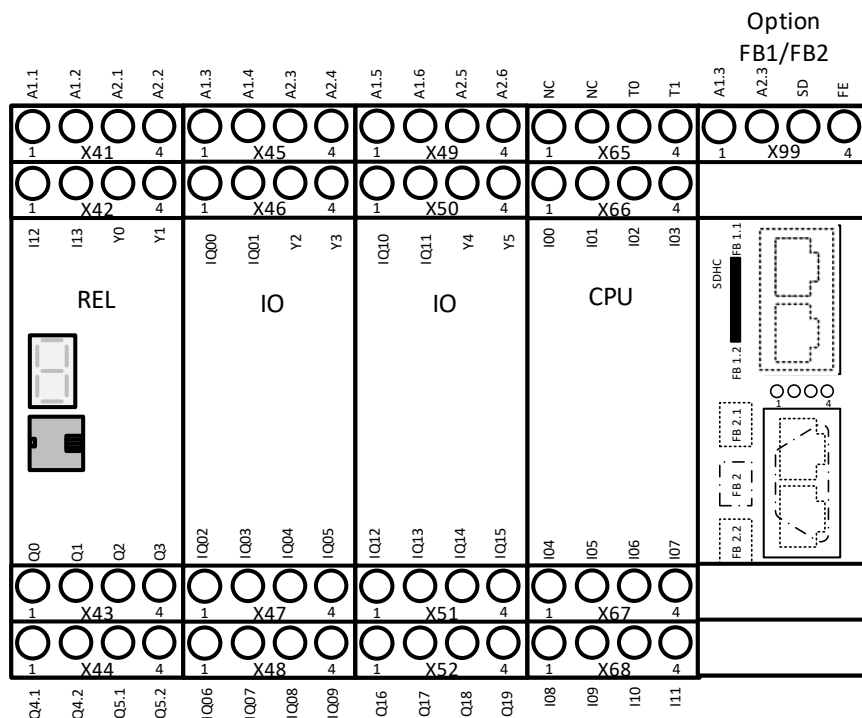


Terminal assignment				
Unit	Terminal	Pin	Description	Note
REL	X41	1 – A1.1	Device power supply +24 VDC	
		2 – A1.2	Device power supply +24 VDC outputs	
		3 – A2.1	Device power supply 0 VDC	
		4 – A2.2		
	X42	1 – I 12	Safe digital inputs	
		2 – I 13		
		3 – Y0	Signal outputs	
		4 – Y1		
	X43	1 – Q0	Output pn switching Q0_PP / pp switching Q0	optionally can be configured in the parameters via SafePLC2
		2 – Q1	Output pn switching Q1_PN / pp switching Q1	
		3 – Q2	Output pn switching Q2_PP / pp switching Q2	
		4 – Q3	Output pn switching Q3_PN / pp switching Q3	
	X44	1 – Q4.1	Safe relay output	
		2 – Q4.2		
		3 – Q5.1	Safe relay output	
		4 – Q5.2		

Unit	Terminal	Pin	Description	Note
IO	X45	1 – A1.3	Device power supply +24 VDC outputs	
		2 – A1.4		
		3 – A2.3	Device power supply 0 VDC	
		4 – A2.4		
	X46	1 – IQ00	Safe digital inputs, outputs pp switching	
		2 – IQ01		
		3 – Y2	Signal outputs	
		4 – Y3		
	X47	1 – IQ02	Safe digital inputs, outputs pp switching	
		2 – IQ03		
		3 – IQ04		
		4 – IQ05		
	X48	1 – IQ06		
		2 – IQ07		
		3 – IQ08		
		4 – IQ09		
IO	X49	1 – A1.5	Device power supply +24 VDC outputs	
		2 – A1.6		
		3 – A2.5	Device power supply 0 VDC	
		4 – A2.6		
	X50	1 – IQ10	Safe digital inputs, outputs pp switching	
		2 – IQ11		
		3 – Y4	Signal outputs	
		4 – Y5		
	X51	1 – IQ12	Safe digital inputs, outputs pp switching	
		2 – IQ13		
		3 – IQ14		
		4 – IQ15		
	X52	1 – IQ16		
		2 – IQ17		
		3 – IQ18		
		4 – IQ19		
CPU	X65	1 – NC	No function	
		2 – NC		
		3 – T0	Pulse outputs	
		4 – T1		
	X66	1 – I00	Safe digital inputs	
		2 – I01		
		3 – I02		
		4 – I03		
	X67	1 – I04		
		2 – I05		
		3 – I06		
		4 – I07		
	X68	1 – I08		
		2 – I09		
		3 – I10		
		4 – I11		
Option FB1/FB2	X99	1 – A1.7	Power supply SD-Bus +24 V DC	
		2 – A2.7	Power supply (SD-Bus) 0 V DC /	
		3 – SD	SD-Bus connection	
		4 – FE	Functional earth	Connect to FE or PE of the control cabinet (use short cables)


Note: Please refer to the installation manual for PSC1 fieldbuses for the terminal assignments of the fieldbus or SDDC/SMMC interfaces of the various communication modules.

## 5.7.2 Terminal assignment PSC1-E-21-SDM1

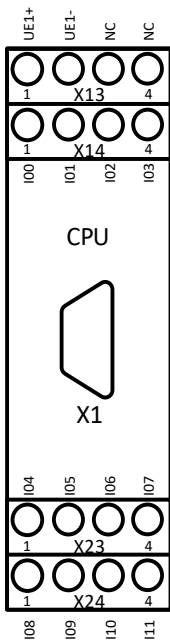


Unit	Terminal	Pin	Description	Note
CPU	X13	1 – UE1+	Encoder power supply DC (X1)	
		2 – UE1-	Encoder power supply 0V DC (X1)	
		3 – NC	No function	
		4 – NC		
	X14	1 – I 00	Safe digital inputs	
		2 – I 01		
		3 – I 02		
		4 – I 03		
	X23	1 – I 04		
		2 – I 05		
		3 – I 06		
		4 – I 07		
	X24	1 – I 08		
		2 – I 09		
		3 – I 10		
		4 – I 11		


## 5.7.3 Terminal assignment PSC1-E-22-SDM1-2

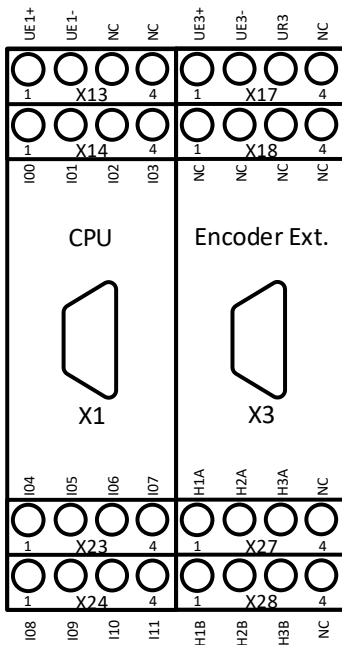

### HTL Geber Anschluß: A+/B+

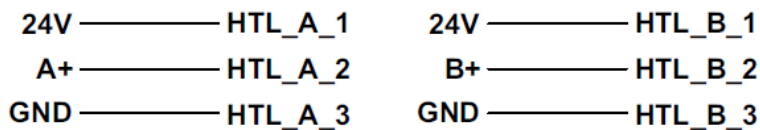


### HTL Geber Anschluß: A+,A-/B+,B-

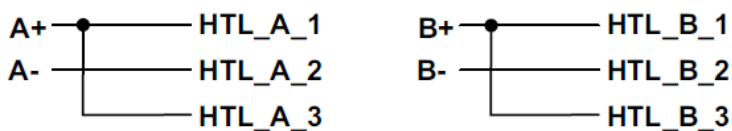

Unit	Terminal	Pin	Description	Note
CPU	X13	1 – UE1+	Encoder power supply DC (X1)	
		2 – UE1-	Encoder power supply 0V DC (X1)	
		3 – NC	No function	
		4 – NC		
	X14	1 – I 00	Safe digital inputs	
		2 – I 01		
		3 – I 02		
		4 – I 03		
	X23	1 – I 04		
		2 – I 05		
		3 – I 06		
		4 – I 07		

	<b>X24</b>	1 – I 08		
		2 – I 09		
		3 – I 10		
		4 – I 11		
Ext. encoder	<b>X17</b>	1 – UE3+	Encoder power supply DC (X3)	
		2 – UE3-	Encoder power supply 0V DC (X3)	
		3 – UR3	U reference X3	
		4 – NC	No function	
	<b>X18</b>	1 – NC	No function	
		2 – NC		
		3 – NC		
		4 – NC		
	<b>X27</b>	1 – H1A	HTL A	
		2 – H2A		
		3 – H3A		
		4 – NC		
	<b>X28</b>	1 – H1B	HTL B	
		2 – H2B		
		3 – H3B		
		4 – NC		


## 5.7.4 Terminal assignment PSC1-E-23-SDM2

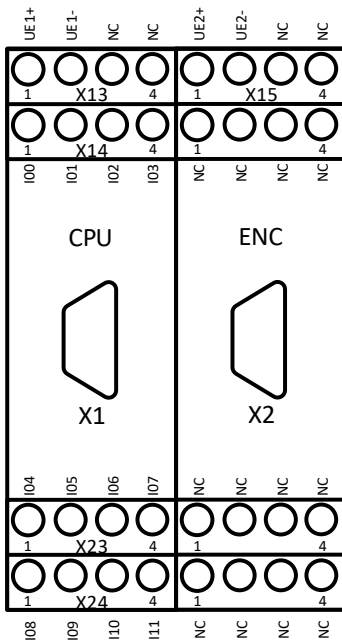


Unit	Terminal	Pin	Description	Note
CPU	X13	1 – UE1+	Encoder power supply DC (X1)	
		2 – UE1-	Encoder power supply 0V DC (X1)	
		3 – NC	No function	
		4 – NC		
	X14	1 – I00	Safe digital inputs	
		2 – I01		
		3 – I02		
		4 – I03		
	X23	1 – I04		
		2 – I05		
		3 – I06		
		4 – I07		
	X24	1 – I08		
		2 – I09		
		3 – I10		
		4 – I11		

Unit	Terminal	Pin	Description	Note
ENC	X15	1 – UE2+	Encoder power supply DC (X2)	
		2 – UE2-	Encoder power supply 0V DC (X2)	
		3 – NC	No function	
		4 – NC		
		1 – NC	No function	
		2 – NC		
		3 – NC		
		4 – NC		
		1 – NC		
		2 – NC		
		3 – NC		
		4 – NC		
		1 – NC		
		2 – NC		
		3 – NC		
		4 – NC		


## 5.7.5 Terminal assignment PSC1-E-24-SDM2-2

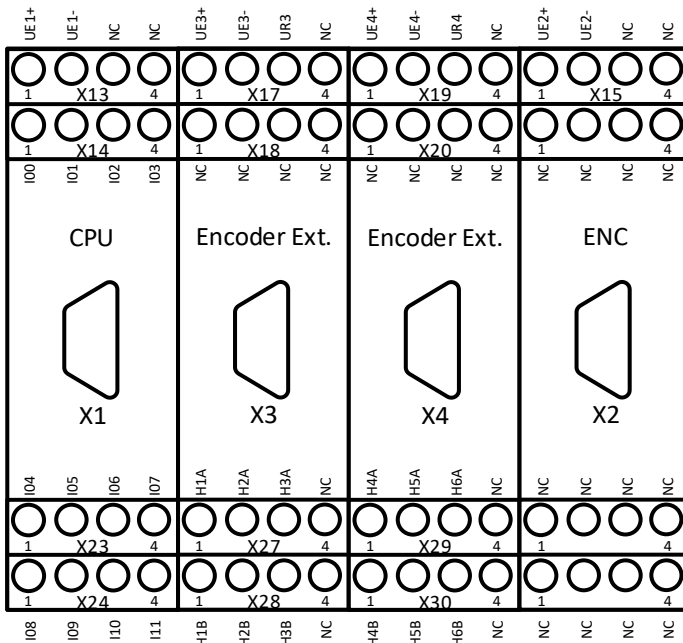

### HTL Geber Anschluß: A+/B+

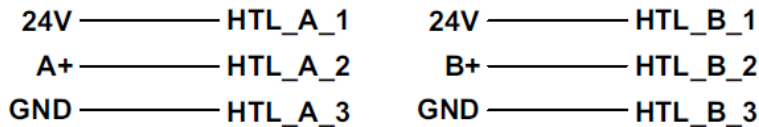

### HTL Geber Anschluß: A+,A-/B+,B-

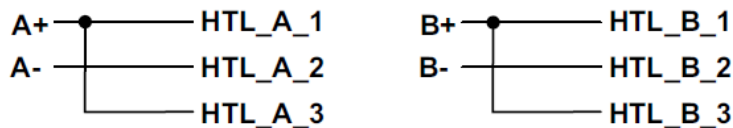


Unit	Terminal	Pin	Description	Note
CPU	X13	1 – UE1+	Encoder power supply DC (X1)	
		2 – UE1-	Encoder power supply 0V DC (X1)	
		3 – NC	No function	
		4 – NC		
	X14	1 – I 00	Safe digital inputs	
		2 – I 01		
		3 – I 02		
		4 – I 03		
	X23	1 – I 04		
		2 – I 05		
		3 – I 06		
		4 – I 07		

	<b>X24</b>	1 – I 08		
		2 – I 09		
		3 – I 10		
		4 – I 11		
Ext. encoder	<b>X17</b>	1 – UE3+	Encoder power supply DC (X3)	
		2 – UE3-	Encoder power supply 0V DC (X3)	
		3 – UR3	U reference X3	
		4 – NC	No function	
	<b>X18</b>	1 – NC	No function	
		2 – NC		
		3 – NC		
		4 – NC		
	<b>X27</b>	1 – H1A	HTL A	
		2 – H2A		
		3 – H3A		
		4 – NC		
	<b>X28</b>	1 – H1B	HTL B	
		2 – H2B		
		3 – H3B		
		4 – NC		
Ext. encoder	<b>X19</b>	1 – UE4+	Encoder power supply DC (X4)	
		2 – UE4-	Encoder power supply 0V DC (X4)	
		3 – UR4	U reference X4	
		4 – NC	No function	
	<b>X20</b>	1 – NC	No function	
		2 – NC		
		3 – NC		
		4 – NC		
	<b>X29</b>	1 – H4A	HTL A	
		2 – H5A		
		3 – H6A		
		4 – NC		
	<b>X30</b>	1 – H4B	HTL B	
		2 – H5B		
		3 – H6B		
		4 – NC		


Unit	Terminal	Pin	Description	Note
ENC	X15	1 – UE2+	Encoder power supply DC (X2)	
		2 – UE2-	Encoder power supply 0V DC (X2)	
		3 – NC	No function	
		4 – NC		
		1 – NC	No function	
		2 – NC		
		3 – NC		
		4 – NC		
		1 – NC		
		2 – NC		
		3 – NC		
		4 – NC		
		1 – NC		
		2 – NC		
		3 – NC		
		4 – NC		

## 5.7.6 Terminal assignment PSC1-E-131

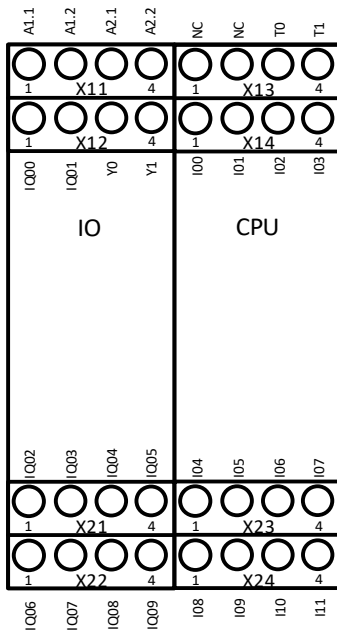

Terminal assignment				
Unit	Terminal	Pin	Description	Note
IO	X11	1 – A1.1	Device power supply +24V DC	Attention: see: "External 24 VDC power supply"
		2 – A1.2		
		3 – A2.1	Device power supply 0V DC	
		4 – A2.2		
	X12	1 – IQ 00	Safe digital inputs, outputs pp switching	
		2 – IQ 01		
		3 – Y0	Signal outputs	
		4 – Y1		
	X21	1 – IQ 02	Safe digital inputs, outputs pp switching	
		2 – IQ 03		
		3 – IQ 04		
		4 – IQ 05		
	X22	1 – IQ 06		
		2 – IQ 07		
		3 – IQ 08		
		4 – IQ 09		
CPU	X13	1 – NC	No function	
		2 – NC		
		3 – T0	Pulse outputs	
		4 – T1		
	X14	1 – I 00	Safe digital inputs	
		2 – I 01		
		3 – I 02		
		4 – I 03		
	X23	1 – I 04		
		2 – I 05		
		3 – I 06		
		4 – I 07		
	X24	1 – I 08		
		2 – I 09		
		3 – I 10		
		4 – I 11		


## 5.7.7 Terminal assignment PSC1-E-133

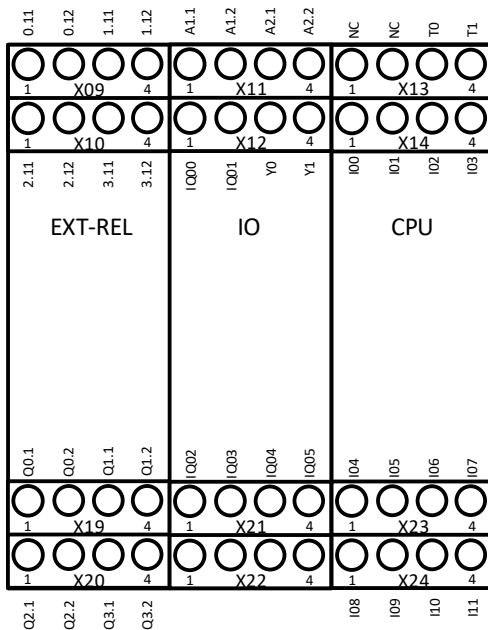

### Note:

If the relays are used for safety tasks, the readback signals must be monitored, because the module does not recognize a sticking of the internal relay or of external contacts.


The readback contacts 0.11/12, 1.11/12, 2.11/12, 3.11/12 of the internal relays Q0, Q1, Q2, Q3 must be monitored for feedback loop monitoring in addition to the readback contacts of the connected contactors or other switching amplifiers.

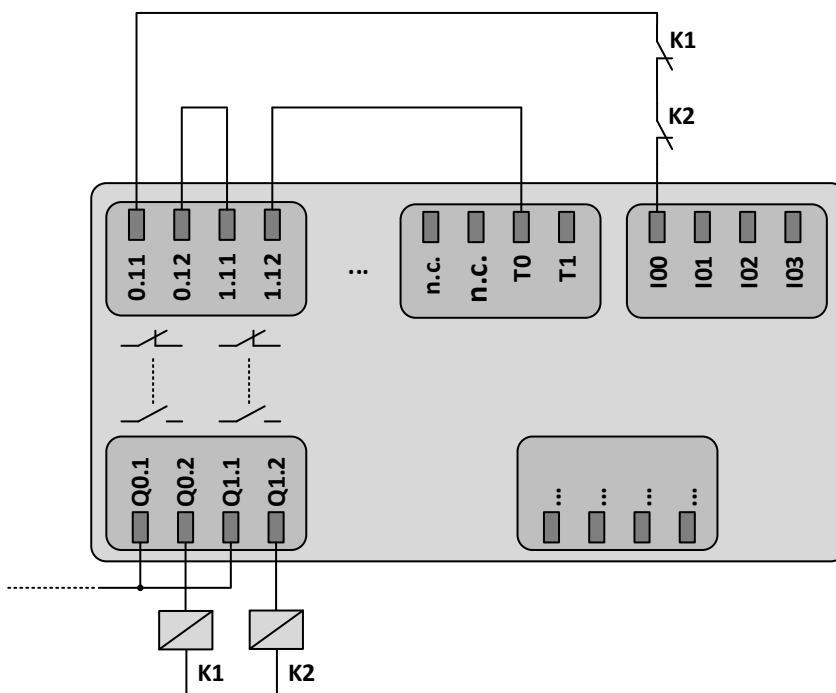

### Exemplary wiring


Terminal assignment				
Unit	Terminal	Pin	Description	Note
EXT-REL	X09	1 – 0.11	Readback contact relay 1	
		2 – 0.12		
		3 – 1.11	Readback contact relay 2	
		4 – 1.12		
	X10	1 – 2.11	Readback contact relay 3	
		2 – 2.12		
		3 – 3.11	Readback contact relay 4	
		4 – 3.12		
	X19	1 – Q0.1	Safe relay output 1	
		2 – Q0.2		
		3 – Q1.1	Safe relay output 2	
		4 – Q1.2		
	X20	1 – Q2.1	Safe relay output 3	
		2 – Q2.2		
		3 – Q3.1	Safe relay output 4	
		4 – Q3.2		
IO	X11	1 – A1.1	Device power supply +24V DC	Attention: see: "External 24 VDC power supply"
		2 – A1.2		
		3 – A2.1	Device power supply 0V DC	
		4 – A2.2		
	X12	1 – IQ 00	Safe digital inputs, outputs pp switching	
		2 – IQ 01		
		3 – Y0	Signal outputs	
		4 – Y1		
	X21	1 – IQ 02	Safe digital inputs, outputs pp switching	
		2 – IQ 03		
		3 – IQ 04		
		4 – IQ 05		
	X22	1 – NC	No function	
		2 – NC		
		3 – NC		
		4 – NC		
CPU	X13	1 – NC	No function	
		2 – NC		
		3 – T0	Pulse outputs	
		4 – T1		
	X14	1 – I 00	Safe digital inputs	
		2 – I 01		
		3 – I 02		
		4 – I 03		
	X23	1 – I 04		
		2 – I 05		
		3 – I 06		
		4 – I 07		
	X24	1 – I 08		
		2 – I 09		
		3 – I 10		
		4 – I 11		

## 5.7.8 Terminal assignment PSC1-E-37

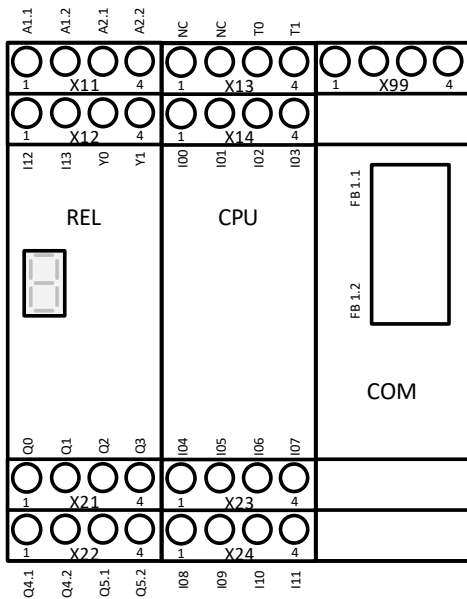

Terminal assignment				
Unit	Terminal	Pin	Description	Note
REL	X11	1 – A1.1	Device power supply +24 VDC	
		2 – A1.2	Device power supply +24 VDC outputs	
		3 – A2.1	Device power supply 0 VDC	
		4 – A2.2		
	X12	1 – I 12	Safe digital inputs	
		2 – I 13		
		3 – Y0	Signal outputs	
		4 – Y1		
	X21	1 – Q0	Output pn switching Q0_PP / pp switching Q0	optionally can be configured in the parameters via SafePLC2
		2 – Q1	Output pn switching Q1_PN / pp switching Q1	
		3 – Q2	Output pn switching Q2_PP / pp switching Q2	
		4 – Q2	Output pn switching Q3_PN / pp switching Q3	
	X22	1 – Q4.1	Safe relay output	
		2 – Q4.2		
		3 – Q5.1	Safe relay output	
		4 – Q5.2		
CPU	X13	1 – NC	No function	
		2 – NC		
		3 – T0	Pulse outputs	
		4 – T1		
	X14	1 – I 00	Safe digital inputs	
		2 – I 01		
		3 – I 02		
		4 – I 03		
	X23	1 – I 04		
		2 – I 05		
		3 – I 06		
		4 – I 07		
	X24	1 – I 08		
		2 – I 09		
		3 – I 10		
		4 – I 11		
	X99	1 – NC	No function	
		2 – NC		
		3 – NC		
		4 – FE	Functional earth	Connect to FE or PE of the control cabinet (use short cables)

## 5.7.9 Terminal assignment PSC1-E-38

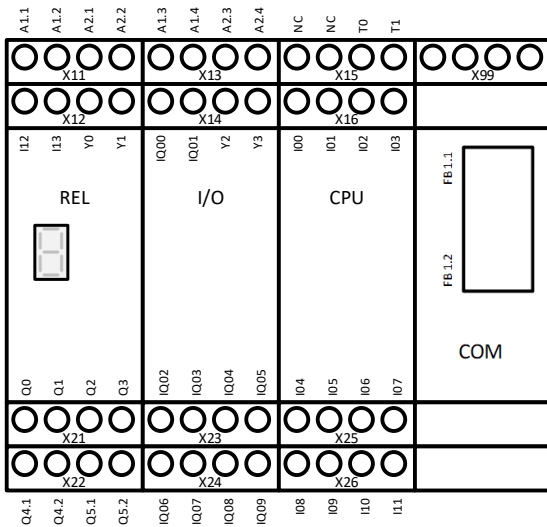

Terminal assignment				
Unit	Terminal	Pin	Description	Note
REL	X11	1 – A1.1	Device power supply +24 VDC	
		2 – A1.2	Device power supply +24 VDC outputs	
		3 – A2.1	Device power supply 0 VDC	
		4 – A2.2		
	X12	1 – I 12	Safe digital inputs	
		2 – I 13		
		3 – Y0	Signal outputs	
		4 – Y1		
	X21	1 – Q0	Output pn switching Q0_PP / pp switching Q0	optionally can be configured in the parameters via SafePLC2
		2 – Q1	Output pn switching Q1_PN / pp switching Q1	
		3 – Q2	Output pn switching Q2_PP / pp switching Q2	
		4 – Q2	Output pn switching Q3_PN / pp switching Q3	
	X22	1 – Q4.1	Safe relay output	
		2 – Q4.2		
		3 – Q5.1	Safe relay output	
		4 – Q5.2		
I/O	X13	1 – A1.1	Device power supply +24 VDC	
		2 – A1.2		
		3 – A2.1	Device power supply 0 VDC	
		4 – A2.2		
	X14	1 – IQ00	Safe digital inputs, outputs pp switching	
		2 – IQ01		
		3 – Y2	Signal outputs	
		4 – Y3		
	X23	1 – IQ02	Safe digital inputs, outputs pp switching	
		2 – IQ03		
		3 – IQ04		
		4 – IQ05		
	X24	1 – IQ06		
		2 – IQ07		
		3 – IQ08		
		4 – IQ09		

Unit	Terminal	Pin	Description	Note
CPU	X15	1 – NC	No function	
		2 – NC		
		3 – T0	Pulse outputs	
		4 – T1		
	X16	1 – I 00	Safe digital inputs	
		2 – I 01		
		3 – I 02		
		4 – I 03		
	X25	1 – I 04		
		2 – I 05		
		3 – I 06		
		4 – I 07		
	X26	1 – I 08		
		2 – I 09		
		3 – I 10		
		4 – I 11		
COM	X99	1 – NC	No function	
		2 – NC		
		3 – NC		
		4 – FE	Functional earth	Connect to FE or PE of the control cabinet (use short cables)

## 5.8 External 24 VDC power supply

The PSC1 module requires a power supply of 24 VDC (on this topic see SELV or PELV, EN50178). During the planning and installation of the power supply unit to be used, attention is to be paid to the following boundary conditions:

It is imperative the minimum and maximum tolerance on the supply voltage is observed.

<b>Nominal voltage</b>	<b>DC 24 V</b>
Minimum: 24 VDC – 15%	20.4 VDC
Maximum: 24 VDC + 20%	28.8 VDC

To achieve residual ripple on the supply voltage as low as possible, the usage of a 3-phase power supply unit or an electronically regulated unit is recommended. The power supply unit must satisfy the requirements according to IEC 61000-4-11 (voltage drop).

The connection cable must be designed according to the local regulations.

The PSC1 module can withstand an external voltage of 32 VDC (protected by suppressor diodes on the input).



### **Safety instructions:**

- Each board of a module must be supplied with the supply voltage (and fuse) separately! The respective terminals are marked with "U24\_ext".
- Two terminals U24\_ext lying next to each other in a connector are bridged internally.
- The 24 V DC supply connections of the PSC module must be protected with an external backup fuse of 3.15 A (24 V DC).
- Recommended fuse type:  
3.15A circuit breaker (class B) or fuse (slow).
- Depending on the power requirement, the protection can take place in total or per I / O group.

### **Remark:**

In all circumstances, safe electrical isolation on relation to 230 VAC or 400 VAC mains must be ensured. For this purpose, power supply units are to be selected that satisfy the standards DIN VDE 0551, EN 60 742 and DIN VDE 0160. Along with the selection of a suitable unit, attention must also be paid to equipotential bonding between PE and 0 VDC on the secondary side.

A power supply unit used for power supply must deliver at least twice the current that is fused in total (e.g.  $4 \times 3.15\text{A} = 12.6\text{A}$  → power supply unit: at least 25.2A).

## Safety instructions:


- All GND connections on the devices that are connected to the inputs on the PSC1 module must be connected to GND on the PSC1 (power supply).

Inputs on the PSC1 are:

- Digital inputs
- Digital I/O
- Encoder connections


## Remark:

The UE- (GND\_ENC) connections are not connected internally to GND!

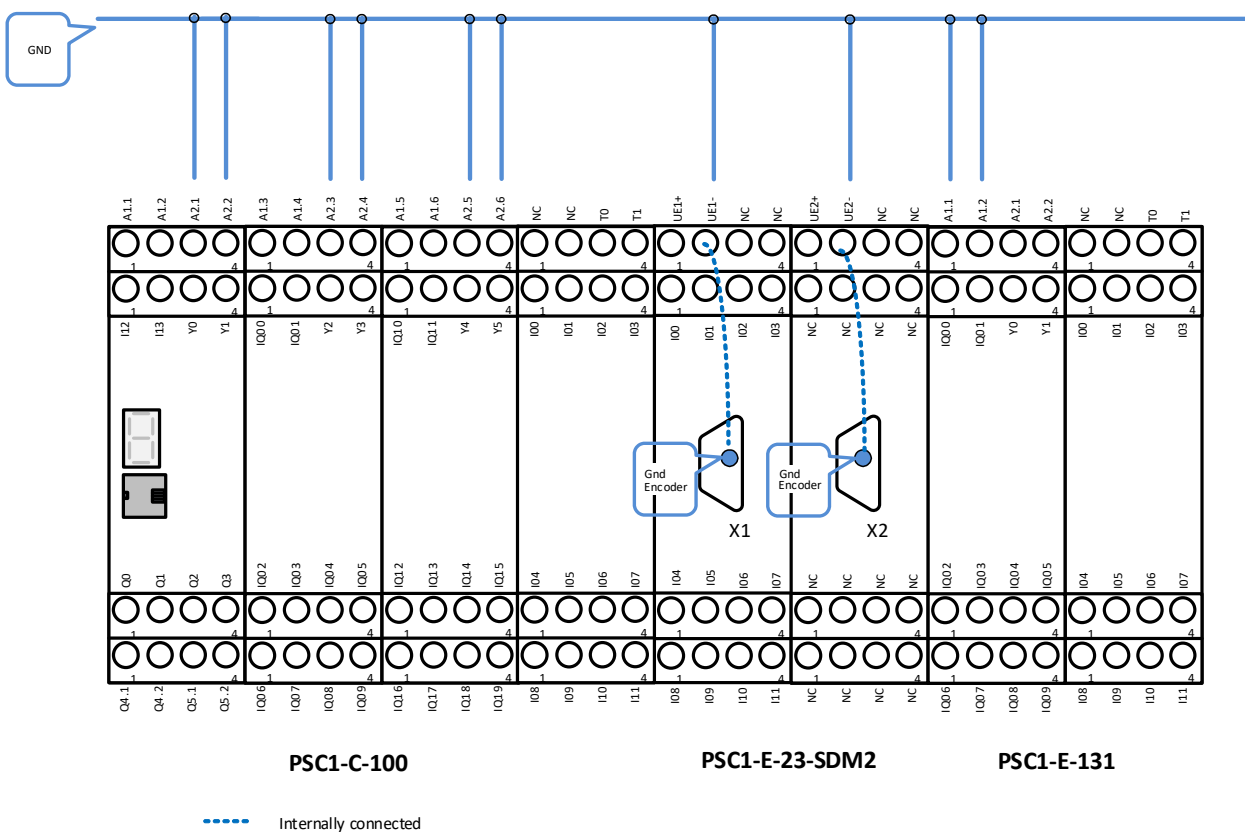

## 5.9 Connection of the external encoder supply

### 5.9.1 Incremental, HTL, SIN/COS, SSI

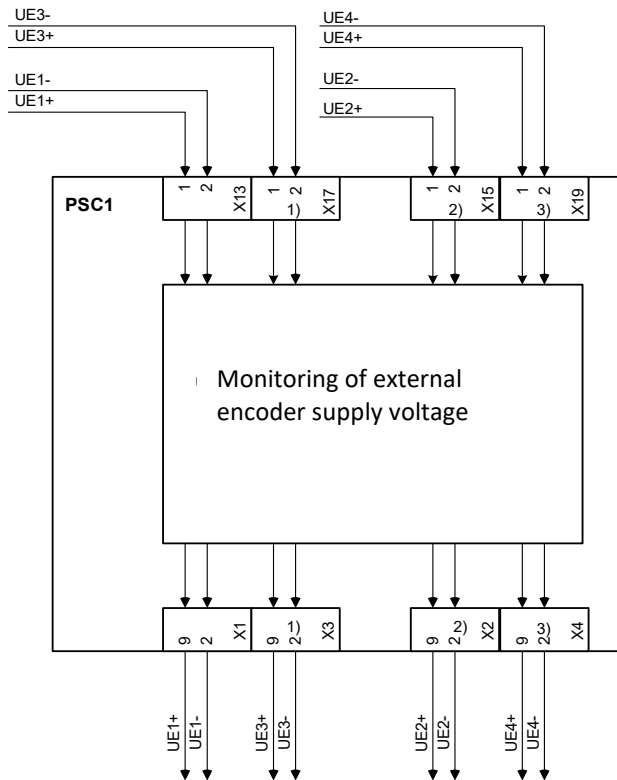

Options:

- (1) Only PSC1-E-22 and PSC1-E-24
- (2) Only PSC1-E-23 and PSC1-E-24
- (3) Only PSC1-E-24

The PSC1 module supports encoder voltages of 5V, 8V, 10 V, 12V, 20V and 24V that are monitored as per the selected configuration in SafePLC2. If an encoder system is not supplied via the PSC1 module, it must be ensured that the GND of the encoder is connected to the GND of the PSC1. If the GND of the encoder is only at pin 2 of the D-sub connector, the terminal UE- must also be connected to GND (see also chapter 5.8). Above that, the supply voltage of the encoder must be connected to pin VCC+ (pin 9 of the D-sub connector). The terminal UE+ then remains unconnected.

The encoder supply is to be protected with maximum 2 A.


#### **Safety instructions:**

- The GND connection for the encoder must be connected to GND on the PSC1

#### **Monitoring of the supply voltage as per the nominal voltage selected:**

Nominal voltage	Minimum voltage	Maximum voltage
5 VDC	4.4 VDC	5.6 VDC
8 VDC	7 VDC	9 VDC
10 VDC	8 VDC	12 VDC
12 VDC	10 VDC	14 VDC
20 VDC	16 VDC	24 VDC
24 VDC	20 VDC	29.5 VDC

## 5.9.2 Resolver

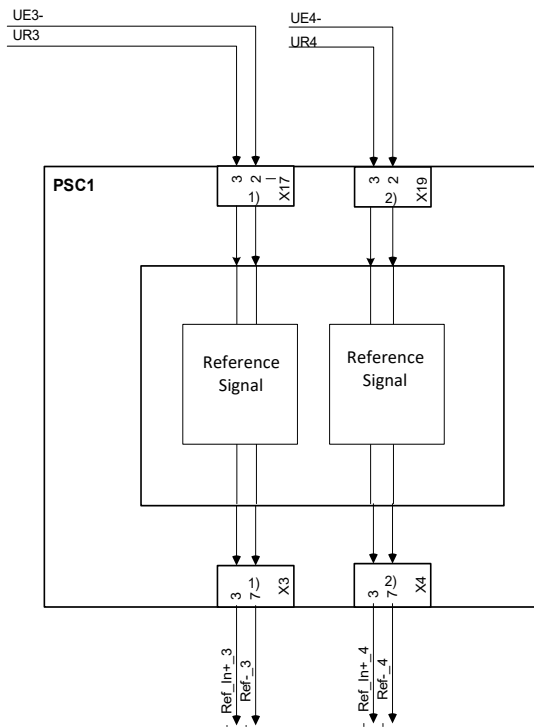

- (1) Only PSC1-E-22 and PSC1-E-24  
(2) Only PSC1-E-24

When using resolvers in master mode, an additional power supply with 24 V DC is required to generate the reference signal.

The encoder supply must be protected with maximum 2 A.

Supply voltage monitoring:

Nominal voltage	Minimum voltage	Maximum voltage
24 VDC	20 VDC	29 VDC

## 5.10 Connection of the digital inputs

- The PSC1 has 14 (PSC1-C-100 (-FBx) and PSC1-E-37/38) or 12 (PSC1-E-21-SDM1, PSC1-E-22-SDM1-2, PSC1-E-23-SDM2, PSC1-E-24-SDM2-2, PSC1-E-131/133) safe digital inputs. These are suitable for the connection of single or dual-channel signals with and without test pulses, or without cross-circuit testing.
- The signals connected must have a "high" level of DC 24 V (DC +15 V..+ DC 30 V) and a "low" level of (DC -3 V... DC +5 V, type 1 according to IEC 61131-2). The inputs are equipped internally with input filters.
- The device-internal diagnostic function cyclically checks the correct function of the inputs including the input filter. The detection of a fault places the PSC1 in the alarm state. At the same time all outputs on the PSC1 are rendered passive.
- Along with the actual signal inputs, the PSC1 module provides two pulse outputs T0 and T1. The pulse outputs are switching 24 VDC outputs. The pulse outputs are only intended to be used for monitoring the digital inputs (I0 ... I13) and cannot be used for any other functions in the application.
- The switching frequency is 125 Hz for each pulse output. During planning it is to be noted that the pulse outputs are allowed to be loaded with a maximum total current of 250 mA.
- In addition, approved OSSD outputs can be connected to the inputs I00...I13 without restriction
- On the single-channel usage of the inputs, the safety level that can be achieved is limited to SIL 2 or PL d, if there is no demand for the safety function at regular intervals.
- In principle, safety-related usage of the inputs is only intended in conjunction with the pulse outputs.
- If the pulse outputs are not used, a short-circuit in the external wiring between different inputs and the supply voltage for the PSC1 must be excluded by means of suitable external measures, in particular suitable cable routing.
- Each input on the PSC1 module can be configured individually for the following signal sources:
  - Input is assigned pulse T0
  - Input is assigned pulse T1
  - Input is assigned DC 24 V continuous voltage

## 5.11 Connection of position and speed sensors

### 5.11.1 General instructions

Depending on the module type, the PSC1-C-100 axis expansion modules (PSC1-E-21-SDM1, PSC1-E-22-SDM1-2, PSC1-E-23-SDM2, PSC1-E-24-SDM2-2) have (2/4) external encoder interfaces for the connection of the usual industrial incremental and absolute encoders. The encoder interfaces can be configured for incremental, SIN/COS, absolute SSI encoders or for proximity switches.

In addition, it is possible to connect two sensors that generate incremental signals (for instance proximity switches or HTL signals) to the counter inputs on the PSC1 module.

The signals must be read using a normal track and a complementary track.

#### **IMPORTANT:**

Power is supplied to the encoder system via the terminals provided on the PSC1 module. This voltage is supplied to the encoder connector and is monitored by an internal diagnostic process.

If the sensor is supplied with an external voltage, this must be routed via the encoder connector. The related terminal (encoder power supply) on the PSC1 module remains unused.

If an external sensor supply voltage is not fed back via the encoder connector, the failure of this supply must be included in the fault analysis for the overall system. In particular, it is therefore necessary to demonstrate that if the specified operating voltage for the encoder system is dropped below / exceeded, this fault will be detected or can be excluded.

EMC measures such as screening etc. are to be observed.

The two encoders must not interact with each other. This applies for both the electrical and the mechanical part.

If both encoders are coupled to the device to be monitored via common mechanical parts, the connection must be of a positively locking design and there must not be any parts subject to wear (chains, toothed belts etc.). If this is nevertheless the case, additional monitoring devices for the mechanical connection of the sensors are required (e.g. monitoring a toothed belt).

If position processing is active, at least one absolute encoder must be used.

On the usage of two equivalent sensors it is to be ensured that the sensor with the higher resolution is configured as sensor1 (process sensor) and the sensor with the lower resolution as sensor 2 (reference sensor).



#### **Safety instructions:**

- The GND connections for the encoders are to be connected to GND on the PSC1.

---

**Attention:**

The encoder connections are not allowed to be connected or disconnected in operation. Electrical components on the encoder may be irreparably damaged.

Disconnect the connected encoders and the PSC1 module from the electrical supply **before** connecting or disconnecting the encoder connections. For externally supplied encoders, pay attention to shutting down the external supply voltage (e.g. converter)

Twisted pairs according to the RS485 standard must be used for signal transmission for the data and clock signals or track A and track B. On the selection of the wire cross-section the current consumption of the encoder and the cable length in the installation in the specific case are to be taken into account.

**On the usage of absolute encoders, the following also applies:**

In the slave mode, the clock signal is generated by an external process and is read with the data signal from the PSC1 module. Due to this type of sampling there is a beat and as a consequence a sampling error of the following order of magnitude:


$$F = (\text{encoder sampling time, external system [ms]} / 8 [\text{ms}]) * 100 \%$$

The magnitude of the sampling error produced F must be taken into account on defining the thresholds on the monitoring functions used, as this error cannot be compensated!


## 5.11.2 Pin assignment on the encoder interface

### X1/X2


#### Incremental - Encoder




#### SIN/COS



#### Absolut - Encoder




#### SSI - Listener




### X3/X4


#### Incremental - Encoder




#### SIN/COS



#### Absolut - Encoder



#### Resolver




#### Note:

Pins marked as 'n.c.' are reserved for later expansion and must remain unconnected.

At terminals X3 / X4, when using an incremental counting system, the counting direction is inverted compared to X1 / X2. In the case of encoders that are not connected inversely, the direction of rotation is displayed inverted. The displayed direction of rotation can be corrected in the software.

## 5.11.3 Connection variants


### 5.11.3.1 Connection of an absolute encoder as master

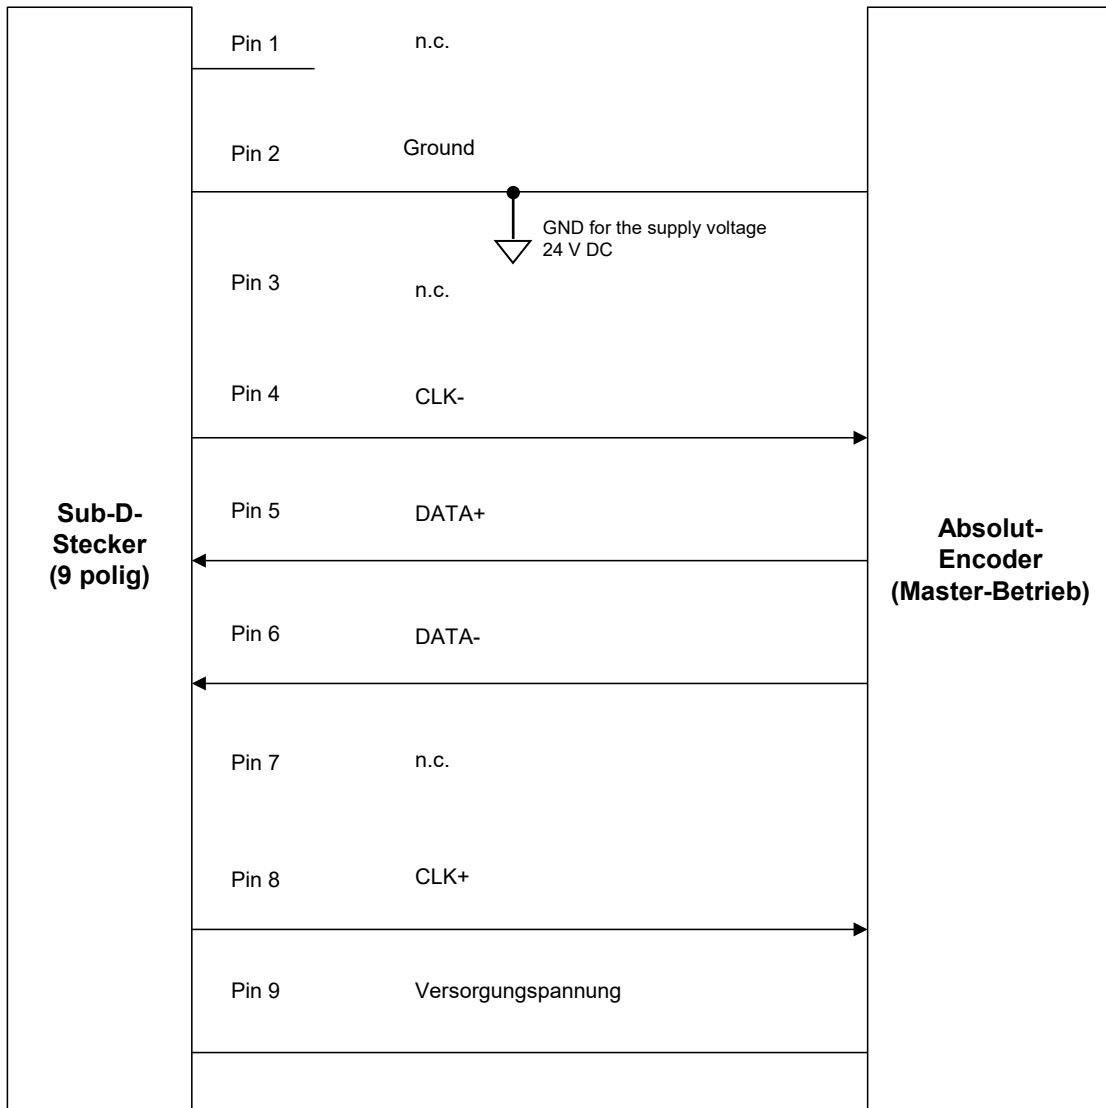

With this type of connection, the clock signals pass from the PSC1 module to the absolute encoder and the data from the encoder to the PSC1.

Pins 1, 3 and 7 are reserved for later expansion and must remain open.


## 5.11.3.2 Connection of an absolute encoder as slave

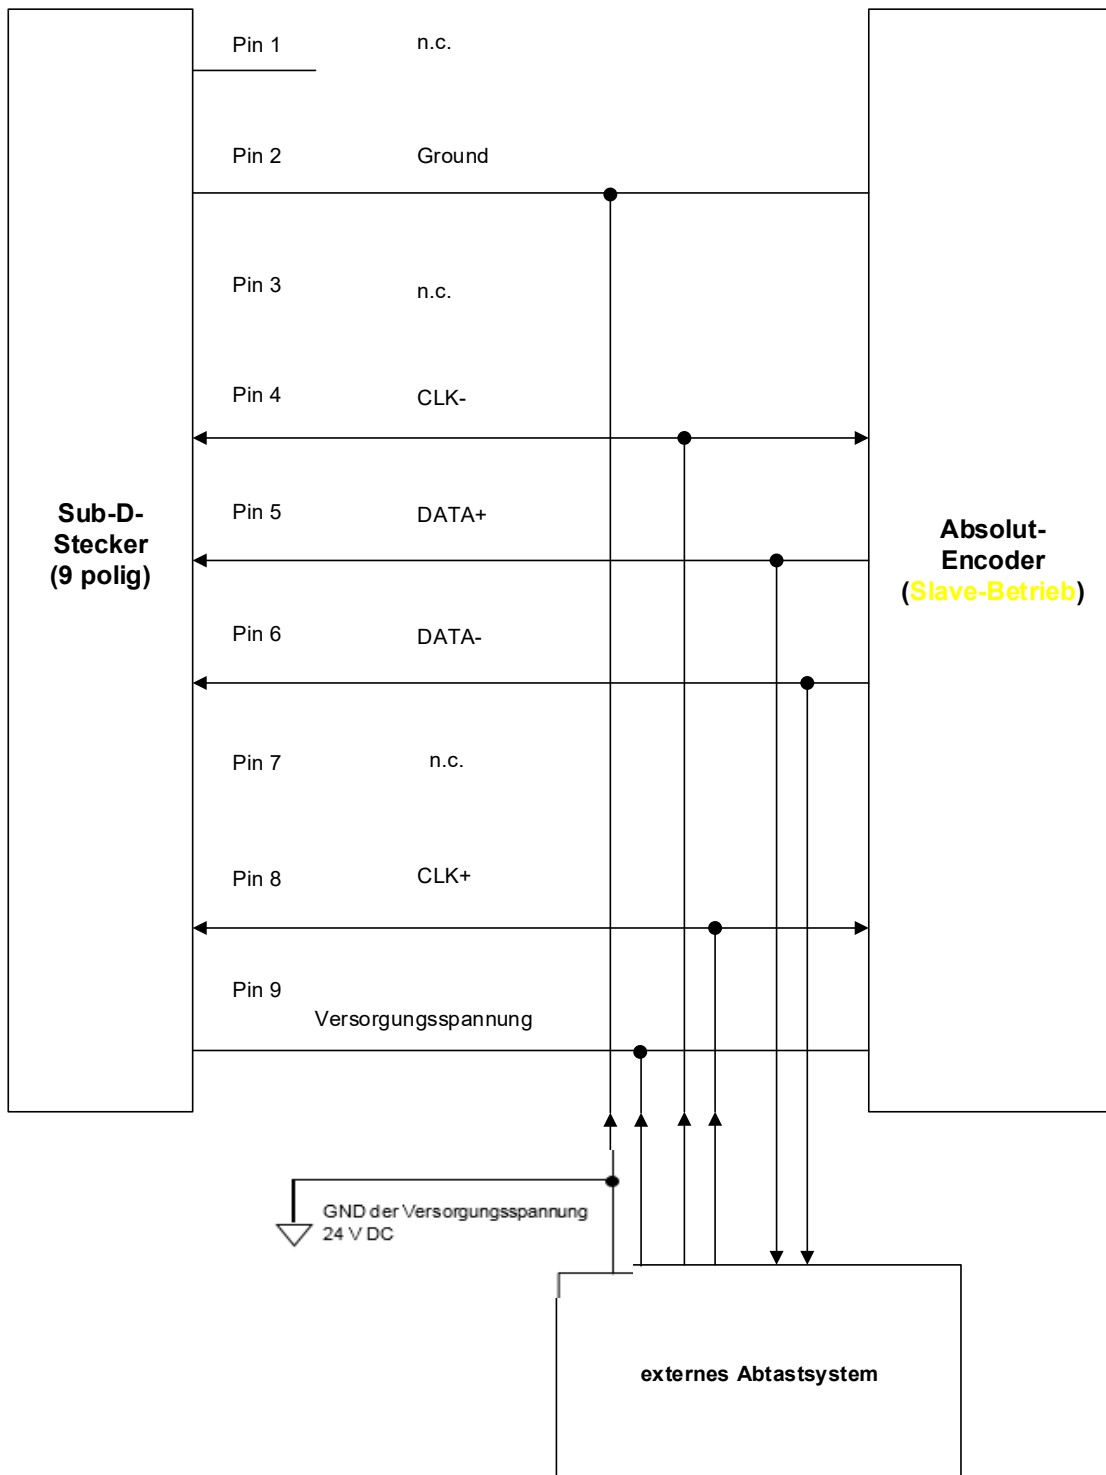

With this type of connection, the clock signals and the data are read together. In this example the encoder is not supplied with power from the module.


Pins 1, 3 and 7 are reserved for later expansion and must remain open.

## 5.11.3.3 Connection of an incremental encoder with TTL signal level

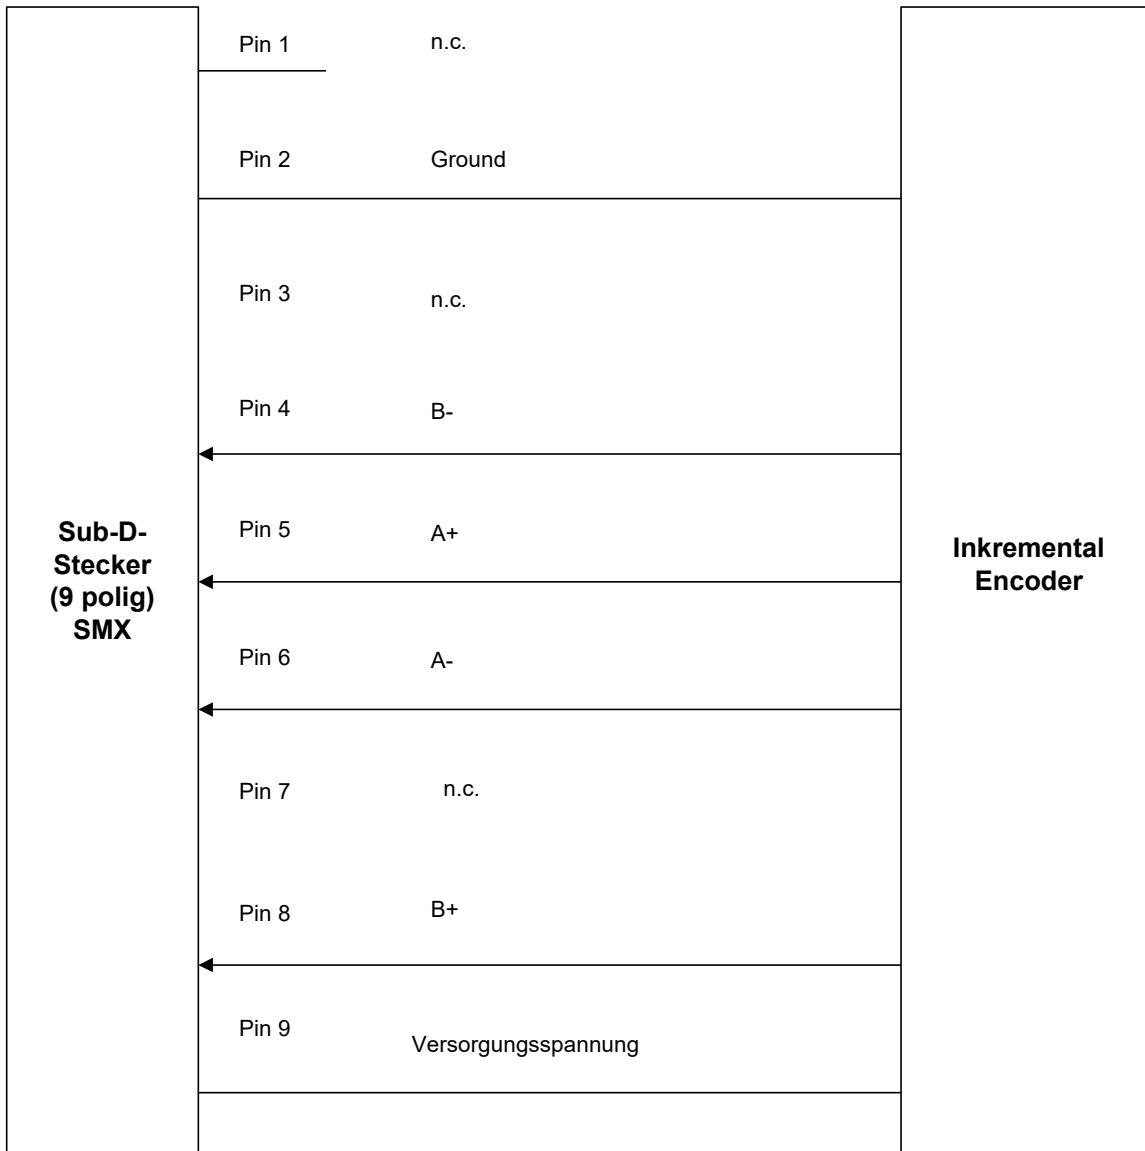


Pins 1, 3 and 7 are reserved for later expansion and must remain open.

## 5.11.3.4 Connection of a SIN/COS encoder

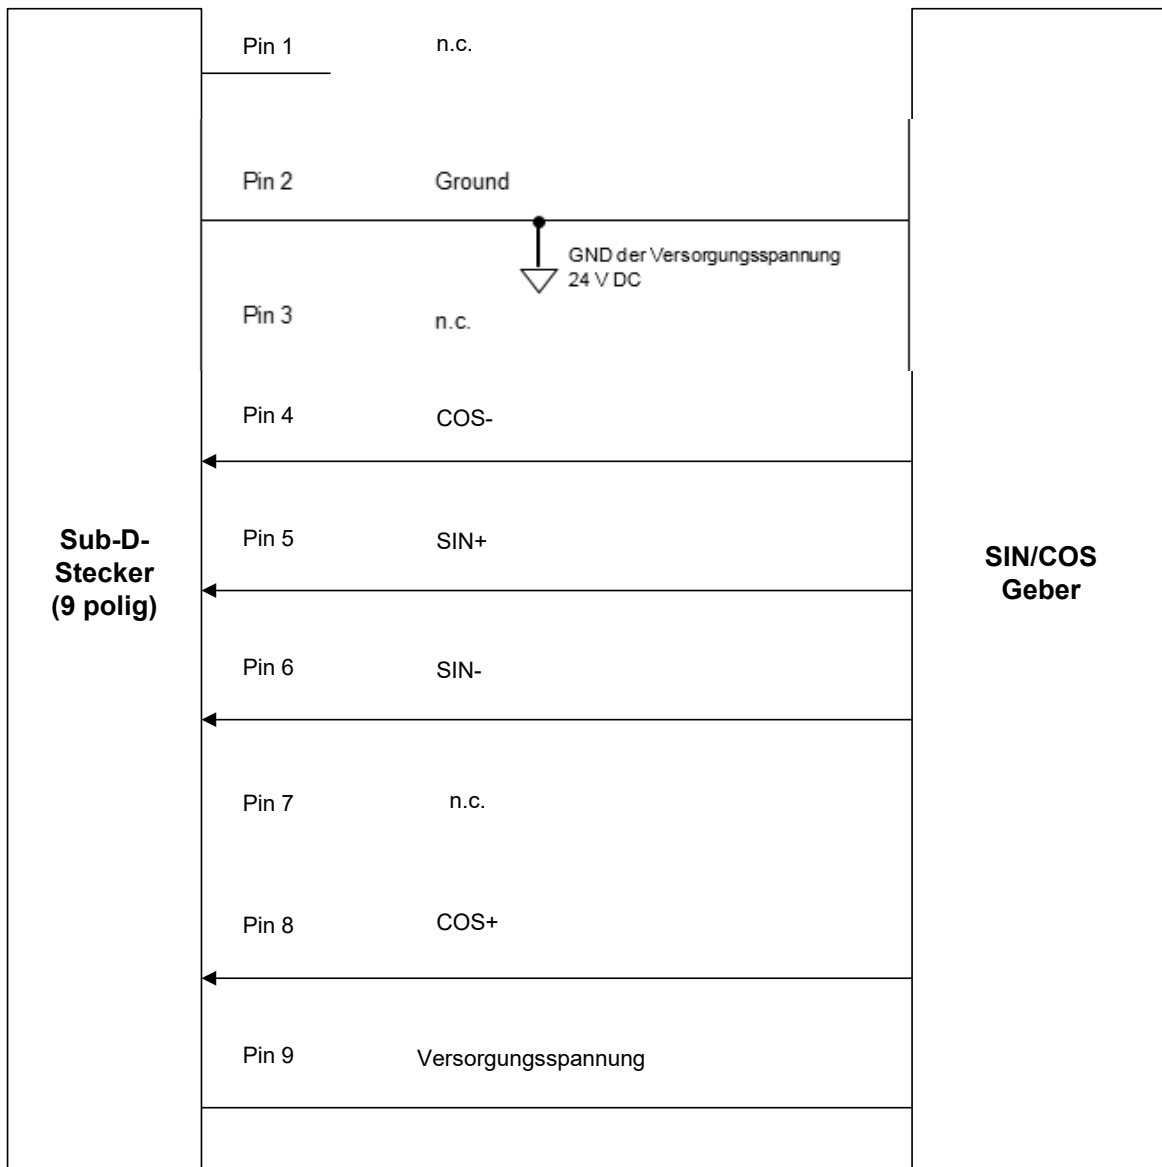

Pins 1, 3 and 7 are reserved for later expansion and must remain open.


## 5.11.3.5 Connection of resolver as master

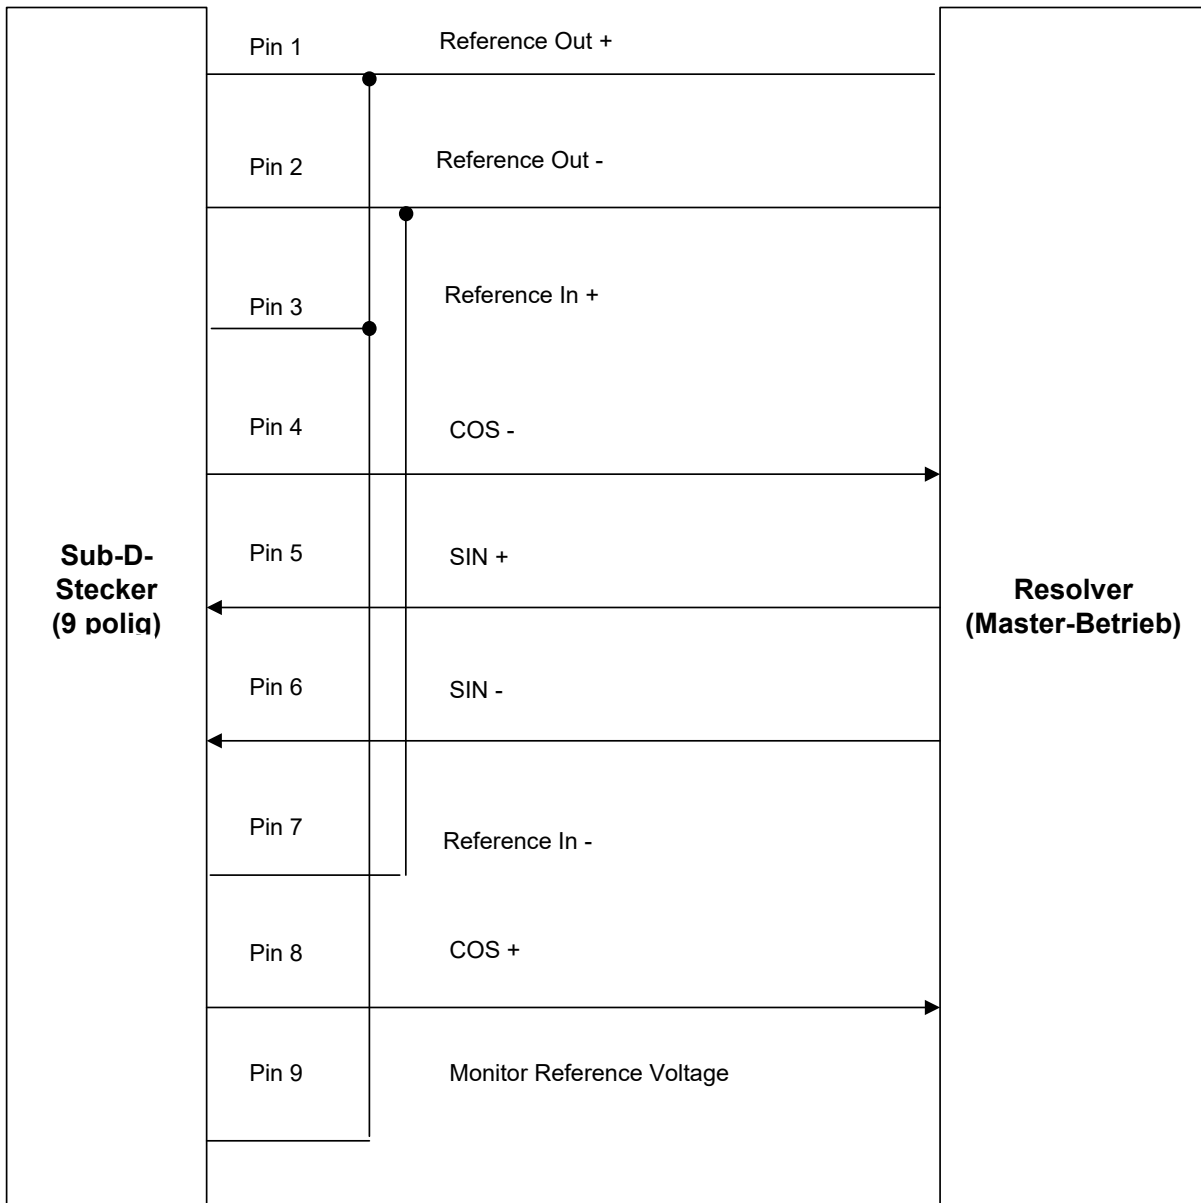

With this type of connection, the clock signals pass from the PSC1 module to the absolute encoder and the data from the encoder to the PSC1.

Pins 1, 3 and 7 are reserved for later expansion and must remain open.

## 5.11.3.6 Connection of resolver as slave

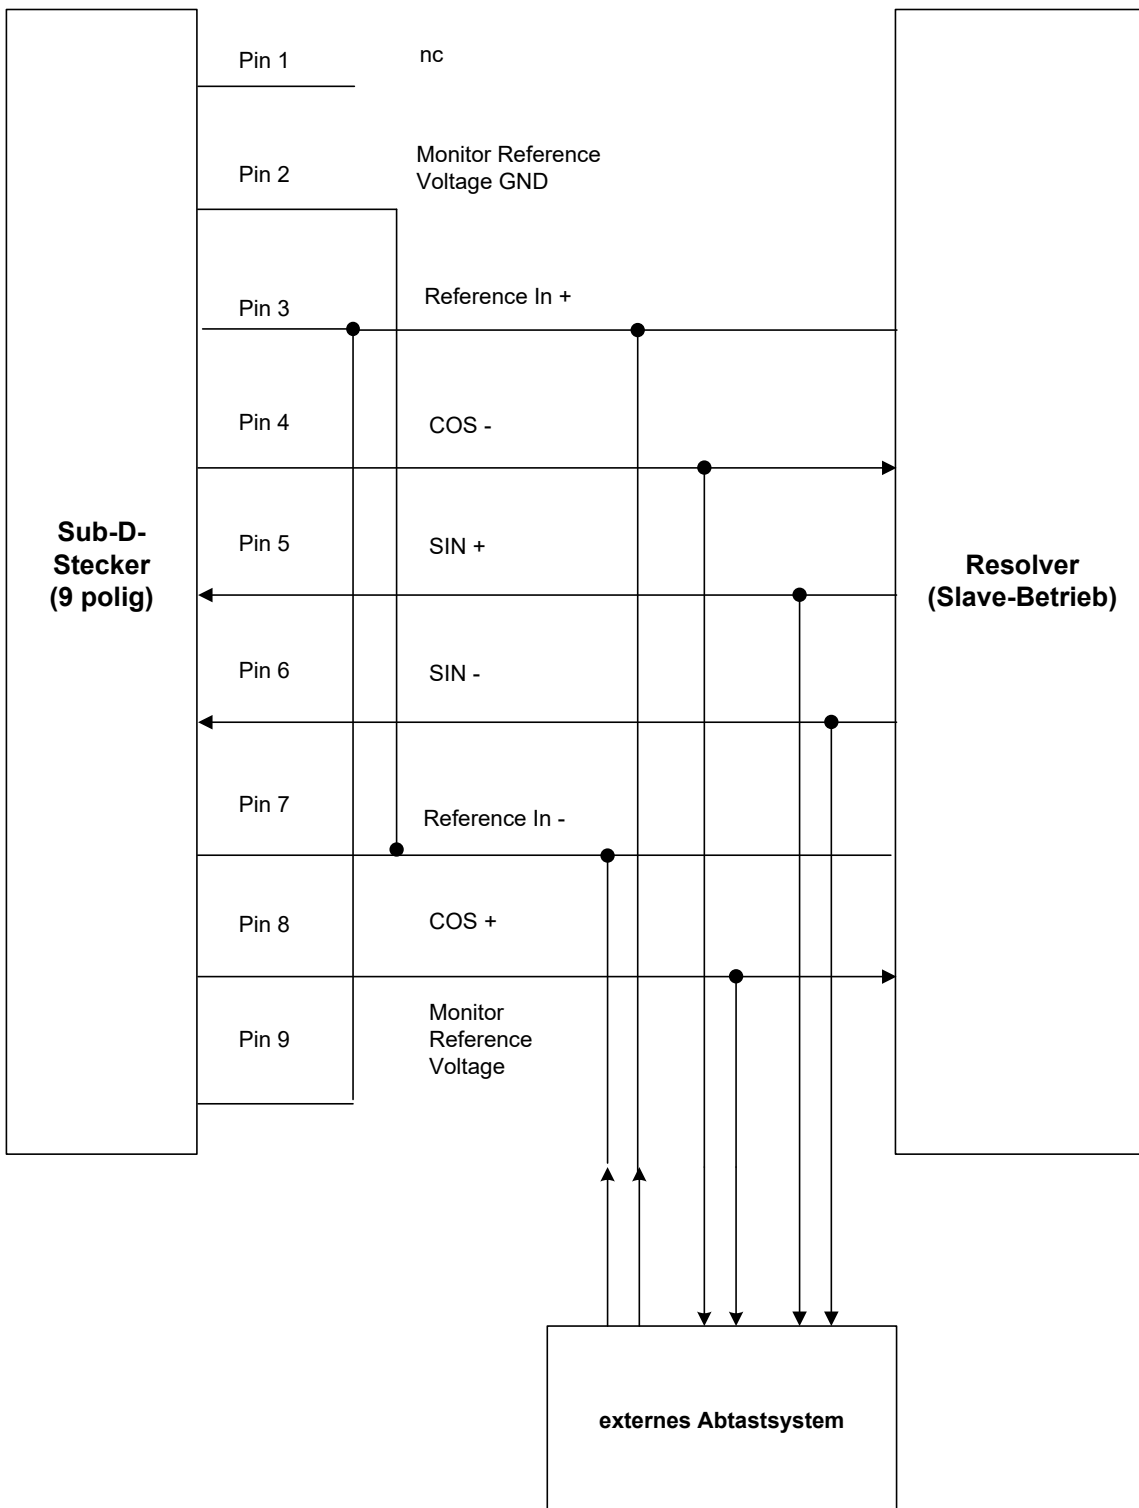

## 5.11.3.7 Connection of proximity switches

The connection is made at the digital inputs I04 ...I07. The exact pin assignment depends on which encoder combination is used and is displayed schematically in the connection diagram in the programming interface.


### Proxy1-Proxy1

When using the encoder combination Proxy1 Prox1, please observe the notes in chapters 5.12.4 and 5.12.5, especially with regard to the achievable limit frequencies and the requirements for the code disc to be used.

The selection of the number of pulses depends on the dynamics of the axis to be monitored and the parameters of the proximity switches used (switching distance, detection area). General propositions cannot be made at this point. A suitable design for the respective application is always required.


### Proxy2

For Proxy2 requires signals, that are phase-shifted by 90° to each other. The tooth form is not relevant here, but a 1:1 partition of the code disc simplifies the alignment of the sensors.

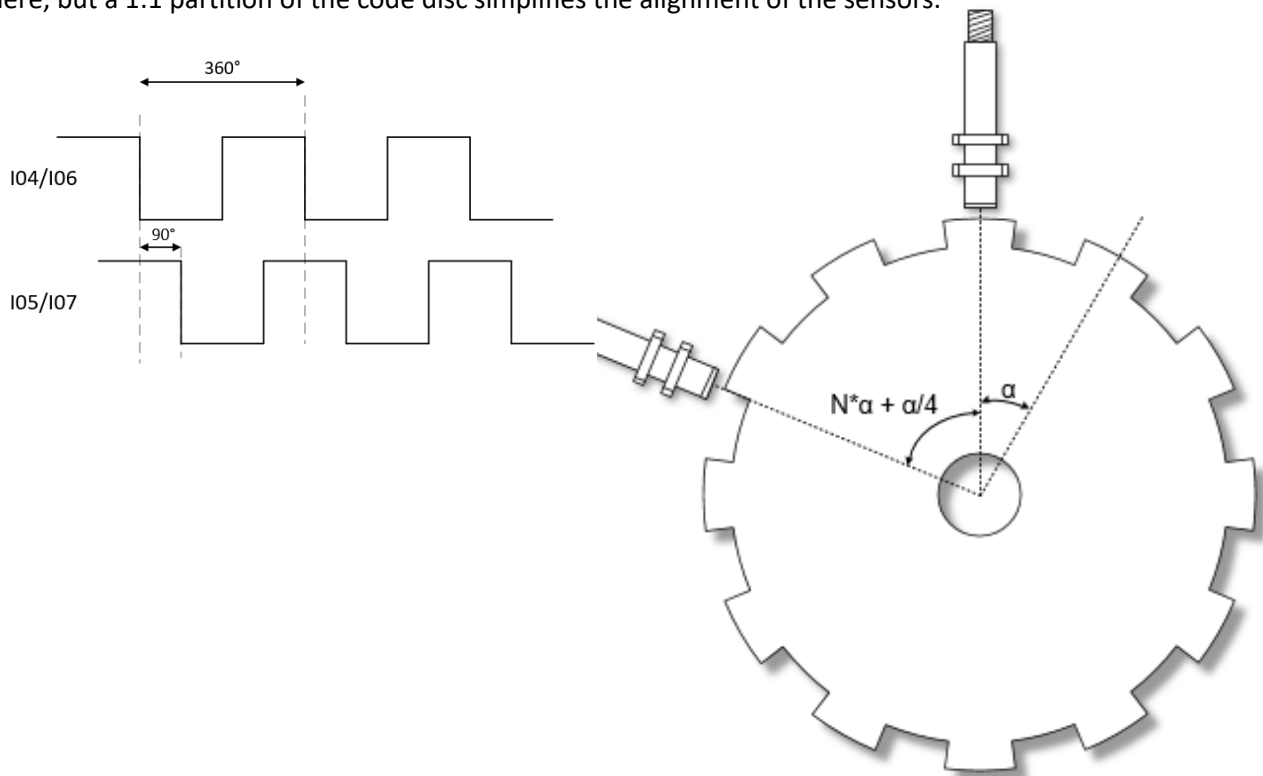

### Note:


On the usage of HTL encoder, it is to be noted that the tracks A+ and B+ or A- and B- must be combined correspondingly.



## 5.11.3.8 Connection of HTL/proximity switches

Connection is via the connectors X27 and X28, or X29 and X30


### 5.11.3.8.1 HTL encoders with A+/A- and B+/B- signal

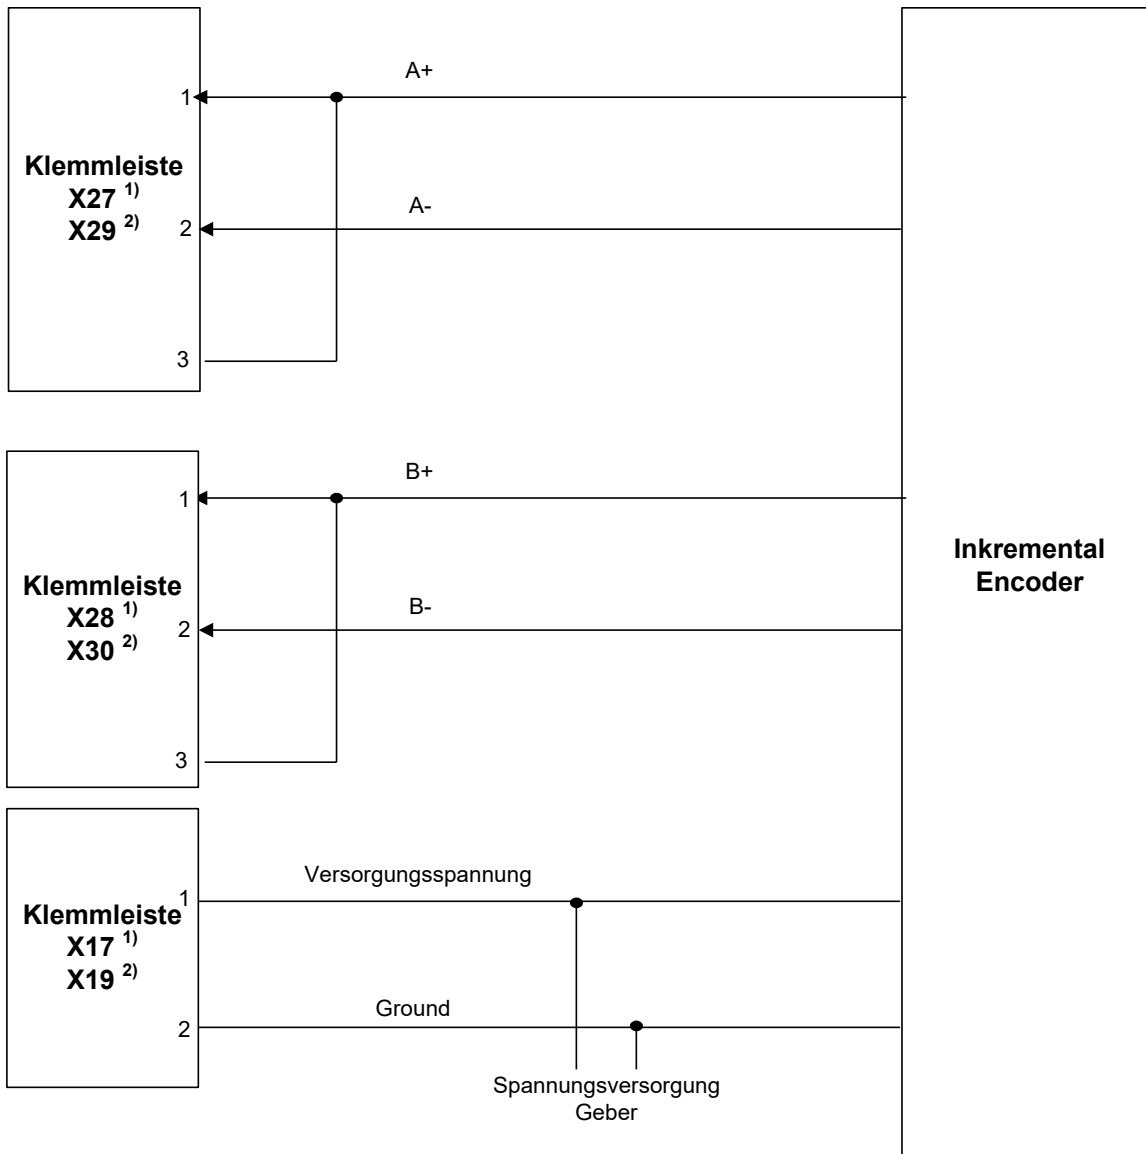

Options:

- <sup>(1)</sup> PSC1-E-22 encoder 3
- <sup>(2)</sup> PSC1-E-24 encoder 4

## 5.11.3.8.2 HTL encoder with A+ and B+- signal

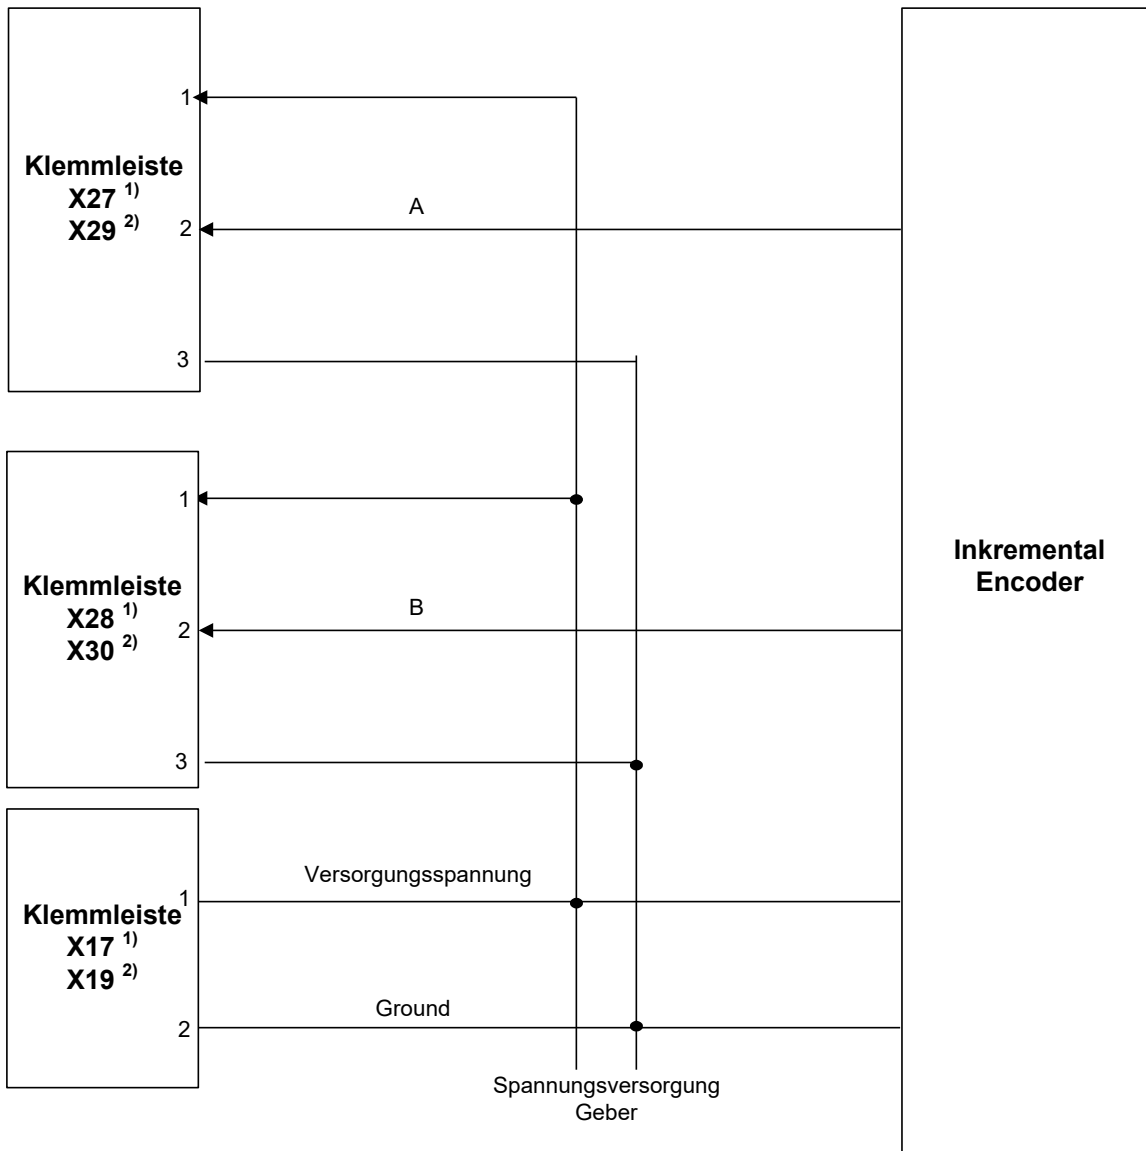

Options:

- (1) PSC1-E-22 encoder 3
- (2) PSC1-E-24 encoder 4

## 5.12 Configuration of the measurement sections

### 5.12.1 General description of the encoder configuration

The most important input variables for the module's monitoring functions are safe position, speed and acceleration. These are generated from the sensor systems connected using two channels. For PL e according to EN ISO 13849-1 an architecture corresponding to category 4, i.e. continuous dual-channel acquisition with high diagnostic coverage is required. For all single-channel portions (e.g. mechanical connection of the sensor/encoder with only one shaft/fastening) justified fault exclusions according to EN ISO 13849-2 can be defined. For PL d according to EN ISO 13849-1, reduced diagnostic coverage can be used. Taking into account the permissible fault exclusions according to EN ISO 13849-2, in some circumstances sensor systems with a simple layout (only speed monitoring) may be adequate.

#### **Note:**

Further configuration is described in the programming manual:

### 5.12.2 Sensor type

Absolute encoders and incremental measuring systems are possible as well as proximity switches that generate a count pulse.

#### 5.12.2.1 Absolute encoder:

Data interface: Serial Synchronous Interface (SSI) with variable data length from 12 to 28 bits  
 Data format: Binary or Gray code  
 Physical layer: RS-422 compatible

#### **SSI master operation:**

Clock rate: 150kHz


#### **SSI listener operation (slave operation):**

Max. external clock rate: 200 kHz <sup>1)</sup> or 350 kHz <sup>2)</sup>.  
 Min. pulse pause time: 150 µs  
 Max. pulse pause time: 1 ms

#### **Diagnostics:**


Diagnostics	Parameter	Fault threshold
Supply voltage monitoring	Fixed values 5 V, 8 V, 10 V, 12 V, 20 V, 24 V	+/- 20% +/-2% (measuring tolerance)
Monitoring differential level on the input	Fixed value RS 485 level	+/- 20% +/-2% (measuring tolerance)
Clk frequency monitoring	Fixed value	100 kHz < f < 350 kHz
Plausibility of speed versus position	Fixed value	DP < 2 * V * T with T = 8 ms

## SSI format parameter configuration:

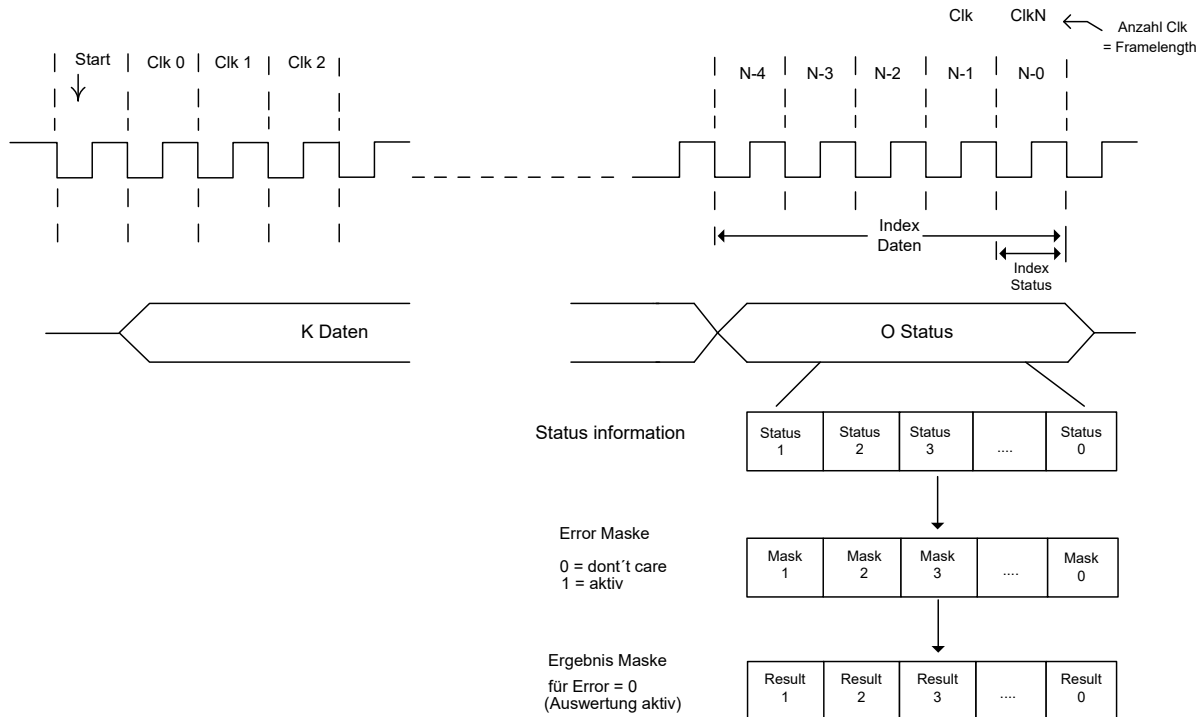

### Example:

SSI-Frame length: 28 pulses  
Data length: 22 bits  
Status: 5 bits, 3 bits error + 2 bits warning/ready for operation

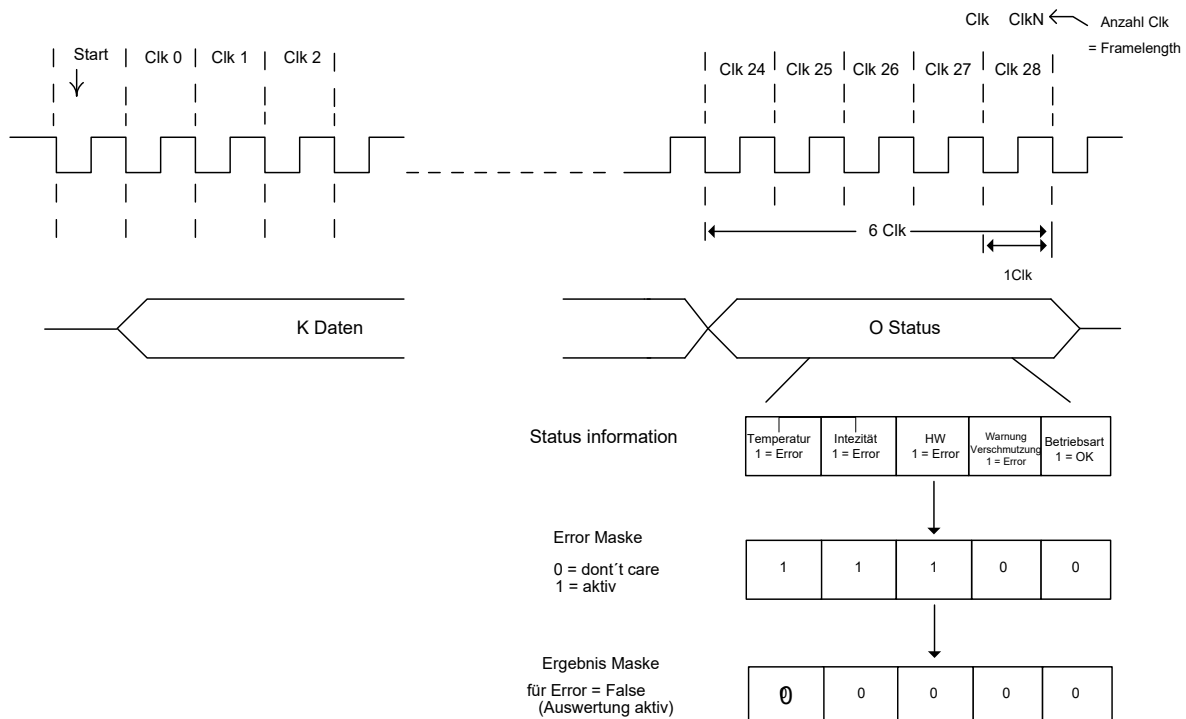

## 5.12.2.2 Incremental encoder:

Physical layer: RS-422 compatible  
Measured signal A/B: Track with 90 degree phase difference  
Maximum input pulse frequency: 200 kHz

### Diagnostics:

Diagnostics	Parameter	Fault threshold
Supply voltage monitoring	Fixed values 5 V, 8 V, 10 V, 12 V, 20 V, 24 V	+/- 20% +/-2% (measuring tolerance)
Monitoring differential level on the input	Fixed value RS 485 level	+/- 20% +/-2% (measuring tolerance)
Monitoring of the count signal separately for each track A/B	Fixed value	DP > 4 increments

## 5.12.2.3 SineCosine encoder – standard mode

Physical layer: +/- 0.5 Vpp (without voltage offset)  
Measured signal A/B: Track with 90 degree phase difference  
Maximum input pulse frequency: 200 kHz

### Diagnostics:

Diagnostics	Parameter	Fault threshold
Supply voltage monitoring	Fixed values 5 V, 8 V, 10 V, 12 V, 20 V, 24 V	+/- 20% +/-2% (measuring tolerance)
SIN <sup>2</sup> +COS <sup>2</sup> amplitude monitoring	Fixed value 1V <sub>pp</sub>	65% or 1 V <sub>pp</sub> +/- 2.5% (measuring tolerance)
Monitoring of phase A/B	Fixed value 90°	+/- 30° +/-5° measuring tolerance)

## 5.12.2.4 SineCosine encoder – high-resolution mode:

Physical layer: +/- 0.5 Vpp (without voltage offset)  
 Measured signal A/B: Track with 90-degree phase difference  
 Maximum input pulse frequency: 400 kHz

### Diagnostics:

Diagnostics	Parameter	Fault threshold
Supply voltage monitoring	Fixed values 5 V, 8 V, 10 V, 12 V, 20 V, 24 V	+/- 20% +/-2% (measuring tolerance)
SIN <sup>2</sup> +COS <sup>2</sup> amplitude monitoring	Fixed value 1V <sub>pp</sub>	65% or 1 V <sub>pp</sub> +/- 2.5% (measuring tolerance)
Monitoring of phase A/B	Fixed value 90°	+/- 30° +/-5° measuring tolerance)
Monitoring of quadrant count signal / signal phase	Fixed value	+/- 45°

## 5.12.2.5 Proximity switch

Signal level: 24 V/0 V  
 Max. count pulse frequency: 10 kHz  
 Min. count pulse frequency: 4 Hz  
 De-bounced switching logic

### Diagnostics:

Diagnostics	Parameter	Fault threshold
Monitoring of supply voltage	Fixws value 24V	+/- 20% +/-2% (measuring tolerance)

## 5.12.2.6 Extended monitoring with 2 proximity switches

For extended monitoring the two status states of the counting signals are logically compared. The cogwheel must always guarantee a 'high' level of at least one of the two input signals


Signal A	Signal B	Result
0	0	False
1	0	True
0	1	True
1	1	True

In addition, the following parameters must be met.

Max. blanking 0 signal: 50%

Min. overlap: 10%

The easiest way to achieve this is to use a 2: 1 division. This also simplifies the correct assembly of the associated sensors. The following picture illustrates this for a radial arrangement of the sensors:

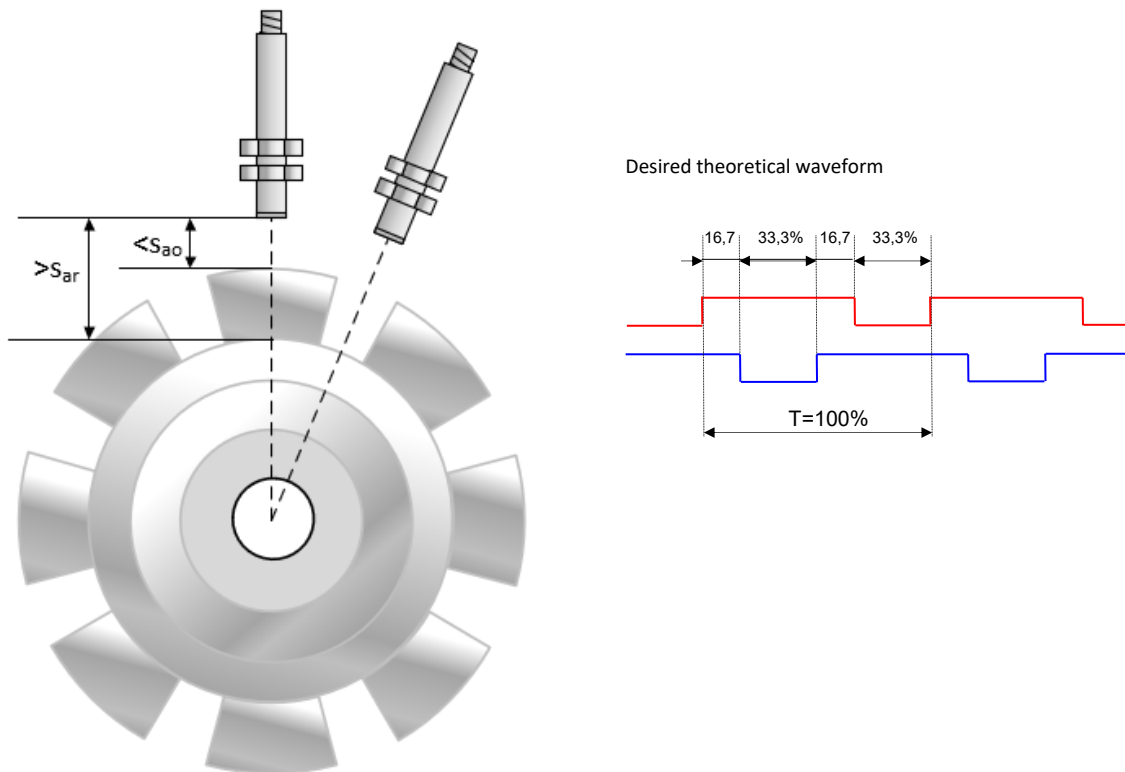

Signal level: 24 V/0 V

Max. count pulse frequency: 4 kHz

De-bounced switching logic

### Diagnostics:

Diagnostics	Parameter	Fault threshold
Monitoring of supply voltage not possible	Fixed value 24V	+/- 20% +/-2% (measuring tolerance)

## 5.12.2.7 HTL sensor

Signal level: 24 V/0 V  
Physical layer: Push/pull  
Measured signal A/B: Track with 90° phase difference  
Max. count pulse frequency: 200 kHz on X27/28 or X29/30  
(only PSC1-E-22 or PSC1-E-24)

### Diagnostics:

Diagnostics	Parameter	Fault threshold
Supply voltage monitoring	Fixed values 5 V, 8 V, 10 V, 12 V, 20 V, 24 V	+/- 20% +/-2% (measuring tolerance)
Monitoring differential level on the input	Fixed value 24 V	+/- 20% +/-2% (measuring tolerance)
Monitoring of the count signal separately for each track A/B	Fixed value	DP > 4 increments

## 5.12.2.8 Resolver

Measured signal: SIN/COS – track with 90° phase difference  
Max. count pulse frequency: 2 kHz/pole  
Resolution: 9 bits / pole

### Master mode:

Reference signal frequency: 8 kHz

### Slave mode:

Reference signal frequency: 6 - 16 kHz  
Reference signal shape: Sine, triangle

### Diagnostics:

Diagnostics	Parameter	Fault threshold
Monitoring ratio	Fixed values 2:1, 3:2, 4:1	+/- 20% +/-2% (measuring tolerance)
SIN <sup>2</sup> +COS <sup>2</sup> signal amplitude monitoring	Fixed value	<2.8 V +/- 5% (measuring tolerance)
Monitoring of phase A/B	Fixed value 90°	+/- 7° +/-2° (measuring tolerance)
Ref. frequency monitoring	Fixed values 6 .. 12 kHz in steps from 1 kHz, 14 kHz, 16 kHz	+/- 20% +/-5% (measuring tolerance)
Reference signal shape	Sine, triangle, no monitoring	40% shape deviation
Monitoring of quadrant count signal / signal phase	Fixed value	+/- 45°

## 6 Response times of the PSC1

The response time is an important safety-related property and must be taken into account for each application / safety function. In the following section the response times for individual functions, in some case also as a function of other parameters, are listed. If this information is inadequate for a specific application, the actual response must be validated against the required behaviour by means of specific measurements. This statement applies in particular also to the usage of filter functions.



### **Safety instructions:**

- The response times are to be defined for each safety function in the required behaviour and compared against the actual value with the aid of the following information.
- Particular care is required on the usage of filter functions. Depending on the filter length / filter time, the response time may be significantly extended; this aspect must be taken into account in the safety-related design.
- For particularly critical tasks, the response must be validated by means of measurements.
- On device startup / alarm or error reset, in some circumstances (depending on the application program) the outputs may become active for the duration of the response time. This aspect must be taken into account on planning the safety functions
- On the usage of safe fieldbus connections (e.g. PROFIsafe, FSoE) the system propagation time (watchdog) is to be included in the calculation.

## 6.1 Response times in standard operation

The basis for the calculation of response times is the cycle time of the PSC1. system. This can be selected in 3 levels **T<sub>cycle</sub> = 16 / 24 / 32 ms**. The response times stated correspond to the related maximum propagation time within the PSC1-C-100 module for the specific application. Depending on the application, further application-dependent response times for the sensors and actuators used must be included in the calculation to obtain the total propagation time.

Function	Response time [ms]			Explanation
Cycle time	16	24	32	
Activation of a monitoring function by means of ENABLE with subsequent shutdown via digital output	16 *)	24 *)	32 *)	Activation of a monitoring function by means of the ENABLE signal.
Activation of a monitoring function by means of ENABLE with subsequent shutdown via safety relay	39 *)	47 *)	55 *)	Activation of a monitoring function by means of the ENABLE signal.
Response of an already activated <b>monitoring function</b> including PLC processing for position and speed processing via digital output	36 *)	56 *)	70 *)	If a monitoring function is already activated via ENABLE, the module requires <u>one</u> cycle to calculate the actual speed value. In the next cycle, after the calculation of the monitoring function, the information is further processed and output by the PLC, i.e. based on the logic implemented this results, e.g., in the switching of an output.
Response of an already activated <b>monitoring function</b> including PLC processing for position and speed processing via safety relay	59 *)	79 *)	93 *)	If a monitoring function is already activated via ENABLE, the module requires <u>one</u> cycle to calculate the actual speed value. In the next cycle, after the calculation of the monitoring function, the information is further processed and output by the PLC, i.e. based on the logic implemented this results, e.g., in the switching of an output.
Activation of digital output via digital input	32	48	64	Activation of an input and switching the output
Activation of output relay via digital input	42	58	74	Activation of an input and switching the output
Deactivation of digital output via digital input	32	48	64	Deactivation of an input and therefore deactivation of the output
Deactivation of output relay via digital input	55	71	87	Deactivation of an input and therefore deactivation of the output
Mean value filter (for setting see encoder dialogue box SafePLC2)	0 - 64	0 - 64	0 - 64	Group propagation time for the averager. This propagation time only acts on monitoring functions related to position / speed / acceleration, however not on the logic processing.
Activation of digital output via 2 manual elements	32 ms			Activation of the 2 manual elements and therefore deactivation of the output
Deactivation of digital output via 2 manual elements	32 ms			Deactivation of the 2 manual elements and therefore deactivation of the output

### Note:

\*) When using a mean value filter, its response time must be added

## 6.2 Response times for FAST\_CHANNEL

FAST\_CHANNEL refers to a property of the PSC1-C-100 to react faster to speed requirements than is possible on processing the safety program in the normal cycle (= 16 / 24 / 32 ms). The sampling time of the FAST\_CHANNEL is 2 ms, + 2 ms for the signalling on the bus.

**The following response times can be stated:**

- 6 ms (worst-case condition)



### **Safety instructions:**


- On the usage of the FAST\_CHANNEL it is to be noted that a shutdown in the time stated above for a specified speed threshold can only occur if the sensor information is of adequate resolution. The smallest resolvable switching threshold for the FAST\_CHANNEL requires at least 2 edge changes on the selected sensor system within a time of 2 ms.
- This function is only possible when using semiconductor outputs.
- The FAST\_CHANNEL must not act on SSI listeners

## 6.3 Response times for overspeed distance monitoring

For the calculation of the worst-case condition, there is the following calculation scheme:

System speed at sampling point:	$V(t)$
System speed on response from the PSC1:	$V_A$
( $t_{Threshold}$ for monitoring (SLS or SCA):	$V_S = \text{constant for all } t$
Filter value configured:	$XF = \text{constant for all } t$
Maximum possible acceleration for the application:	$a_F = \text{constant for all } t$
Delay after shutdown:	$a_V = \text{constant for all } t$
Sampling point for occurrence of worst-case event:	$T_{Fault}$
Response time of the PSC1 system:	$t_{Resp}$

For the worst-case assessment it is assumed that the drive is initially moving at a speed  $v(k)$  exactly at the threshold configured  $v_0$  and then accelerates with the maximum possible value  $a_0$ .

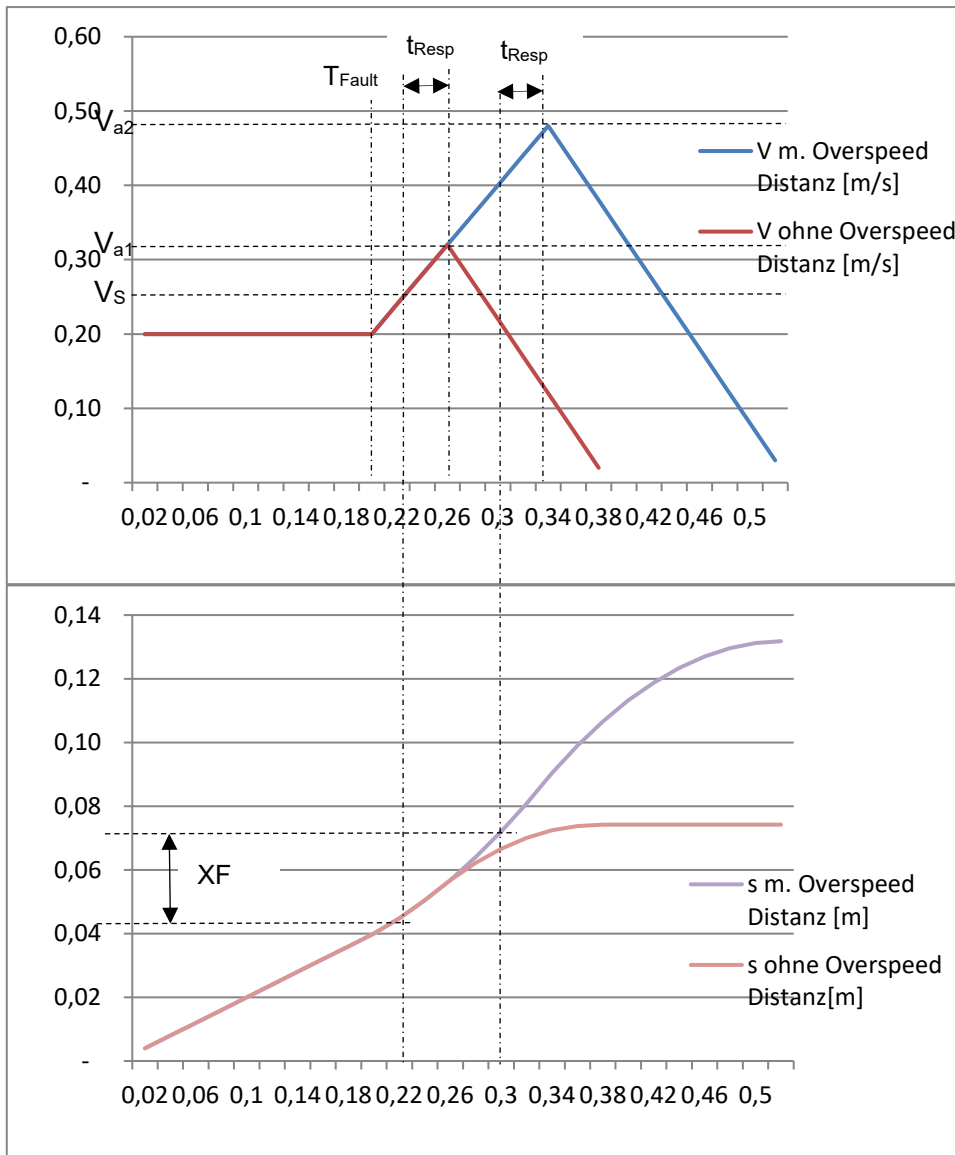

Behaviour of the drive with / without overspeed distance

**For the V and s curves there are the following relationships without overspeed distance:**

Parameter	Acceleration method	Remark
$t_{Resp}$	Value from PSC1 response time data + delay in external shutdown chain	Delay in external shutdown chain from relay / contactor, brake manufacturer data etc.
$a_F, a_V$	n.a.	Estimation from application
$V_{a1}$	$= V_S + a_F * t_{Resp}$	

For the *V* and *s* curves with overspeed distance the following applies:

Parameter	Acceleration method	Remark
$t_{\text{Resp}}$	Value from PSC1 response time data + delay in external shutdown chain	Delay in external shutdown chain from relay / contactor, brake manufacturer data etc.
$a_F, a_V$	n.a.	Estimation from application
$V_{a2}$	$= a_F * t_{\text{Resp}} + (V_s^2 + 2 * a_F * XF)^{1/2}$	

With its action, the filter displaces the set speed threshold  $V_a$  upwards by an amount **delta\_v\_filter**. For the application, the new values for the response time ( $T_{\text{Resp}} = T_{\text{PSC1}} + T_{\text{Filter}}$ ), as well as the resulting speed on shutdown by the PSC1, must be taken into account.

## 6.4 Response times when using the inputs and outputs on the expansion modules

The basis for the calculation of response times is the cycle time of the PSC1. system. In operation this is  **$T_{\text{cycle}} = 16 / 24 / 32 \text{ ms}$** . The response times stated correspond to the related maximum propagation time within the PSC1-C-100 module for the specific application. Depending on the application, further application-dependent response times for the sensors and actuators used must be included in the calculation to obtain the total propagation time.

Function	Description	Response time [ms]	Explanation
Worst-case delay, input in the basic module to the PAE	$T_{\text{IN\_BASE}}$	$T_{\text{Cycle}}$	E.g. activation of a monitoring function by an input signal in the basic module
Worst-case delay, input expansion module to the PAE in basic module	$T_{\text{IN\_Exp}}$	$T_{\text{Cycle}} + 6 \text{ ms}$	E.g. activation of a monitoring function by an input signal in the expansion module PSC1-E-x
Processing time PAE to PAA in basic module	$T_{\text{PLC}}$	$T_{\text{Cycle}}$	Shutdown by a monitoring function or by an input in the PAE
Activation / deactivation of digital output in basic module from PAA	$T_{\text{OUT\_BASE}}$	-	Activation or deactivation of an output in the basic module after change in the PAA
Activation / deactivation of digital output in expansion module via PAA on basic module	$T_{\text{OUT\_Exp}}$	$T_{\text{Cycle}} + 8 \text{ ms}$	Activation or deactivation of an output in the expansion module PSC1-E-x after change in the PAA in the basic module

---

## ***Determination of the total response time***

$$T_{TOTAL} = T_{IN} + T_{PLC} + T_{OUT}$$

### ***Example 1:***

Input on expansion module, activation of SLS and processing in PLC, output on basic module

$$T_{TOTAL} = T_{IN\_Exp} + T_{PLC} + T_{OUT\_Base} = T_{Cycle} + 6 \text{ ms} + T_{Cycle} + 0 \text{ ms} = 2 * T_{Cycle} + 6 \text{ ms};$$

### ***Example 2:***

Input on basic module, activation of SLS and processing in PLC, output on expansion module

$$T_{TOTAL} = T_{IN\_Base} + T_{PLC} + T_{OUT\_Exp} = T_{Cycle} + T_{Cycle} + T_{Cycle} + 6 \text{ ms} = 3 * T_{Cycle} + 8 \text{ ms};$$

### ***Example 3:***

Input on expansion module, activation of SLS and processing in PLC, output on expansion module

$$T_{TOTAL} = T_{IN\_Exp} + T_{PLC} + T_{OUT\_Exp} = T_{Cycle} + 6 \text{ ms} + T_{Cycle} + T_{Cycle} + 8 \text{ ms} = 3 * T_{Cycle} + 14 \text{ ms};$$

## 7 Commissioning

### 7.1 Procedure

Commissioning is only allowed to be undertaken by qualified personnel!  
Please follow the safety instructions during commissioning!

### 7.2 Sequences for switching on

Each time after restarting the module, if there are no errors, the following phases are run through and displayed on the seven-segment display on the front:

7-segment display	Mode	Description	
"1"	STARTUP	Synchronisation between both processor systems and checking the configuration/firmware data	
"2"	SENDCONFIG	Distribution of the configuration/firmware data and further checking of these data. Subsequent range calculation for the configuration data.	
"3"	STARTUP BUS	If present, initialisation of a bus system	
"4"	RUN	Normal operation of the system. All outputs are switched based on the actual state of the logic.	
"5"	STOP	Parameter data and program data can be loaded externally in the stop mode.	
"A"	ALARM	Alarm can be reset via digital input or reset button on the front.	
"E"	ECS alarm ICS alarm ACS alarm	ECS alarm can be reset via digital inputs or reset button on the front.	
"F"	Fault	Faults can only be reset via module ON/OFF.	
". "	PROFIsafe/FSOE status	Off	F-bus not used
		Slow flashing	F-bus configured, no connection to the master
		Fast flashing	Connection to the master, F-bus activation pending
		On	F-bus connected

When using the PSC1-C-100 with slave modules, bus errors may occur.

*The bus status messages are described in the following:*

Indication	Description	Effect on system	Reset condition
b0003	Initialisation/synchronisation with slave module.	All outputs are shut off!	Can be reset by switching off/on the master module (POR).
b0008	Transfer of the configuration data to the slave module.	All outputs are shut off!	None required
b0010	Bus in "RUN"	All outputs become active!	None required
b0012	Bus error	All outputs are shut off!	Can be reset by input configured in the parameters or by switching off/on the master module (POR).
b0012 — Fxyyyy	Slave module x has a fatal error yyyy and cannot be logged onto the SDDC bus system	All outputs are shut off!	Can be reset by switching off/on the slave module (POR).

If there is an error, the bus status may remain continuously in the state "b0003" or "b0012".

*The two error cases are listed in the following:*



<b>Bus status</b>	<b>b0003</b>
Message	Establishment of communication with slave module
Cause	Slave user is not responding
Error rectification	Check address of slave user. Check slave module status LED (must be flashing green) Check mechanical installation of PSC1-C-100

<b>Bus status</b>	<b>b0012</b>
Message	Bus error
Cause	Bus error due to erroneous slave user
Error rectification	Slave module configured (e.g. PSC1-E-23-SDM2) does not match the existing slave module (e.g. PSC1-E-21-SDM1) Check slave module status LED (must be flashing green)

## 7.3 Reset behaviour


The reset function differentiates between a startup function after the return of the power supply = general reset and a status/alarm reset = "internal reset". The latter is triggered via the front button or an input configured accordingly = start/reset element with activated "alarm reset or logic reset" function. The following table provides an overview on the reset functions and their effect.

### 7.3.1 Reset types and triggering element

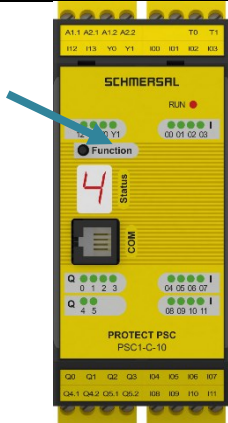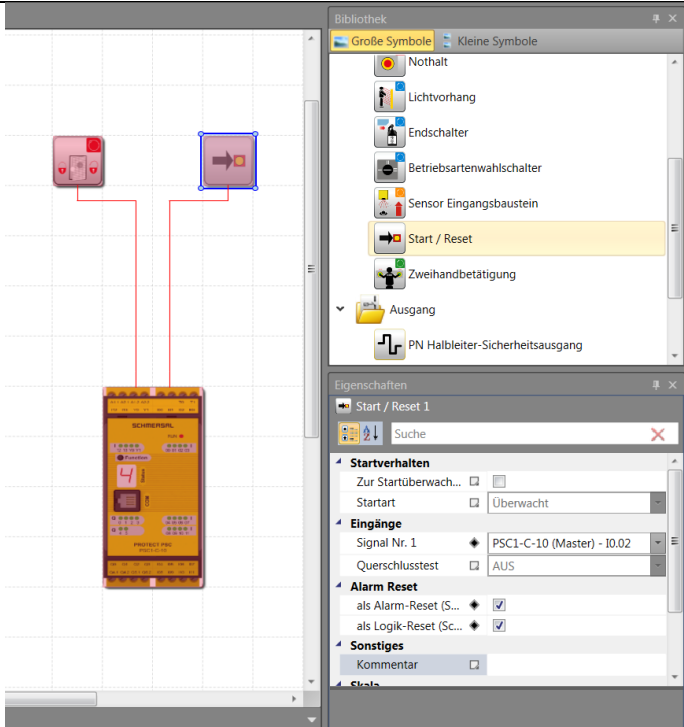Reset type	Triggering element	Remark
General reset	Return of supply of power / device startup	Reset function after completely switching off and on the device
Internal reset		The internal reset is triggered using the Reset button on the front
		Configuration of a reset input

## 7.3.2 Reset timing

An "Internal Reset" is triggered with the falling edge of the reset input.

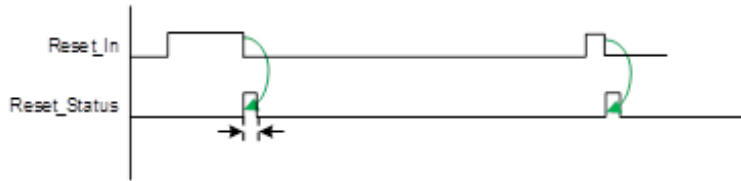


## 7.3.3 Reset function

Function unit	General Reset	Internal Reset	Function
Fatal error	X		Reset error
Alarm	X	X	Reset alarm
Monitoring functions	X	X	Resetting a triggered monitoring function
Flip-flop	X	X <sup>(1)</sup>	Status = Reset
Timer	X	X	Timer = 0


(1) **Attention:**  
As the start/reset element is configured here as a logic reset and connected as an element to a flip-flop element, the flip-flop is reset at high signal...

**The status of the monitoring functions is formed again after a reset:**


- If the limits configured are exceeded, process values do not cause the output status of the monitoring function to change
- Time-based functions - timers reset the output status of the monitoring function. Triggering only occurs if the limits configured are exceeded again

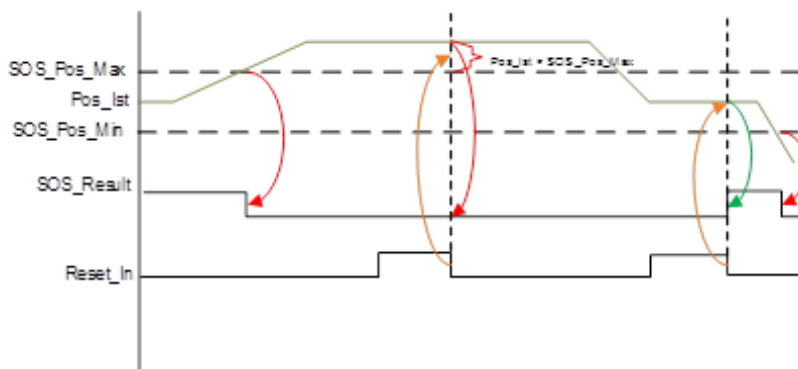

Process value (position) => no change to the output status on reset in the alarm state

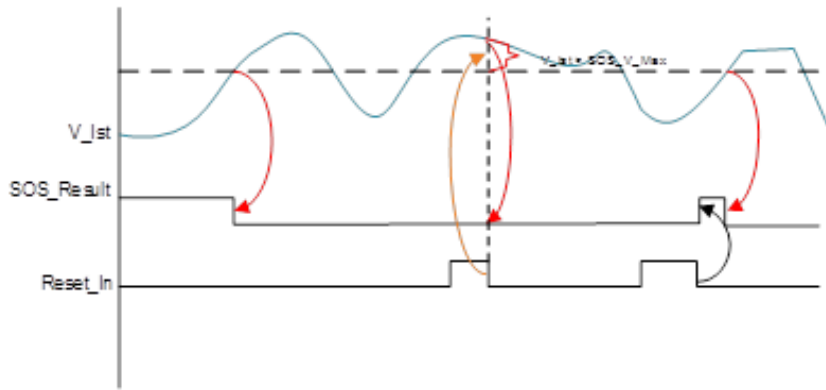

Process value (speed) => no change to the output status on reset in the alarm state

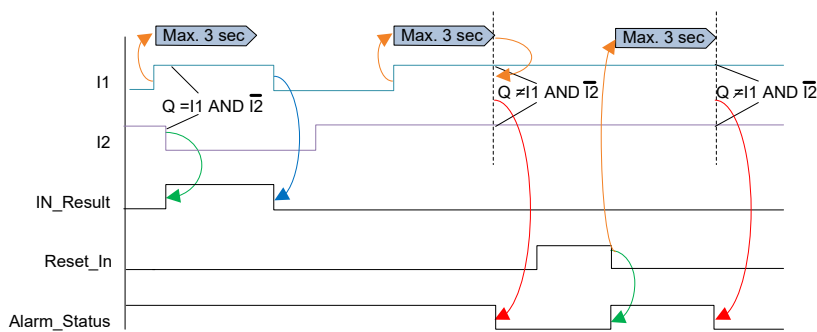

Time-based function => reset the output status, triggering if limit exceeded again

## **⚠ Safety instructions:**

- For time-based functions, e.g. monitoring of the timing of complementary input signals, the output status is reset, and a state defined as erroneous only detected if the (time) limit is exceeded again.
- To protect against incorrect usage, e.g. repeated triggering of the reset function to bypass an alarm state, if necessary applicative measures must be taken in the PLC programming.

## 7.3.3.1 Example reset function with protection against incorrect usage

### **Function:**


- On a machine, the hazard area must be protected in normal operation by a guard and in setup up mode by an enable button in conjunction with standstill monitoring and safely limited speed.
- The presence of the guard is monitored by an electrical sensor. If the guard is open, movement is only possible with the enable button actuated.
- In the program this aspect is realised by a "Safety door" function (2-channel with time monitoring) and an "Enable" function.
- The "Safety door" logic signal is generated using input pre-processing with complementary inputs and time monitoring. The time monitoring for this element is fixed at 3 seconds.
- If the safety door is open ("LOW" signal), the axis can be moved at reduced speed if enabling is active.

### **Problem:**

- If a "cross-circuit" fault is simulated on the safety door input, the PSC1 module indicates the alarm 6701.
- This alarm can be acknowledged and the "safety door" signal correctly remains at "0".
- After the time monitoring of 3 seconds has elapsed, alarm 6701 is triggered again.
- If the enable is pressed during this period, the axis can be moved again for 3 seconds.


## Application-related measure:

- Using an operator in the PLC program, the activation of the outputs while bypassing the alarm state for this time is prevented.

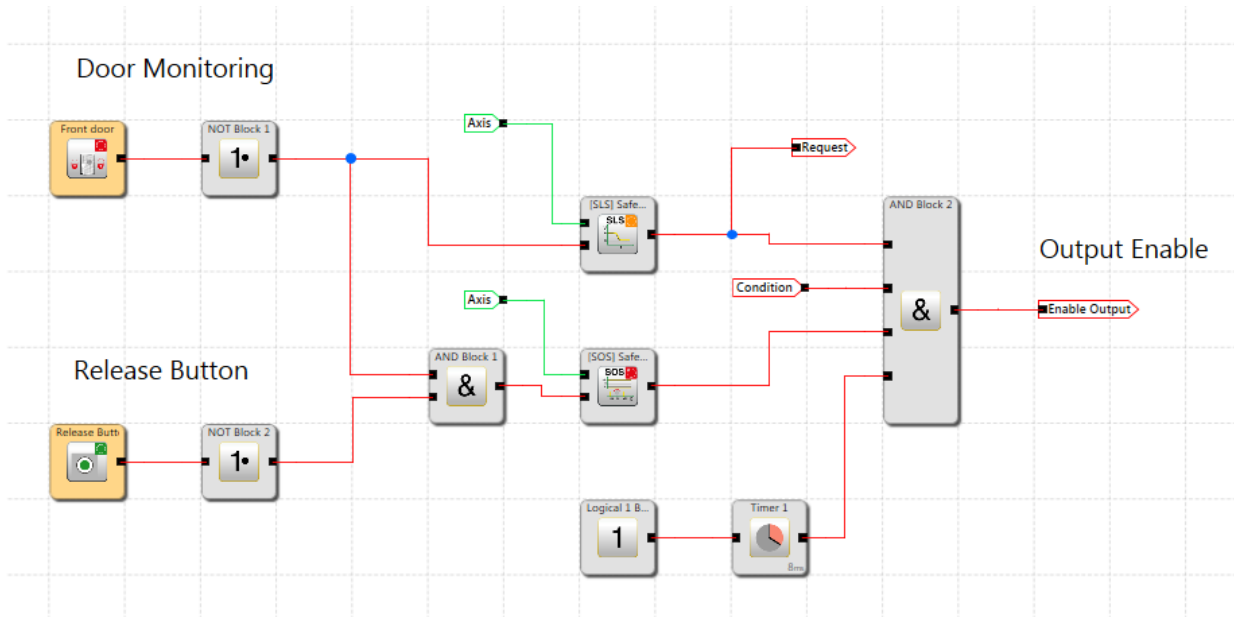

## Example 1:

- The enable function for the outputs (AND function) is also linked to a "reset timer". This operator prevents the activation of the outputs for  $t > 3$  sec after a reset => the renewed action of time monitoring is safeguarded.

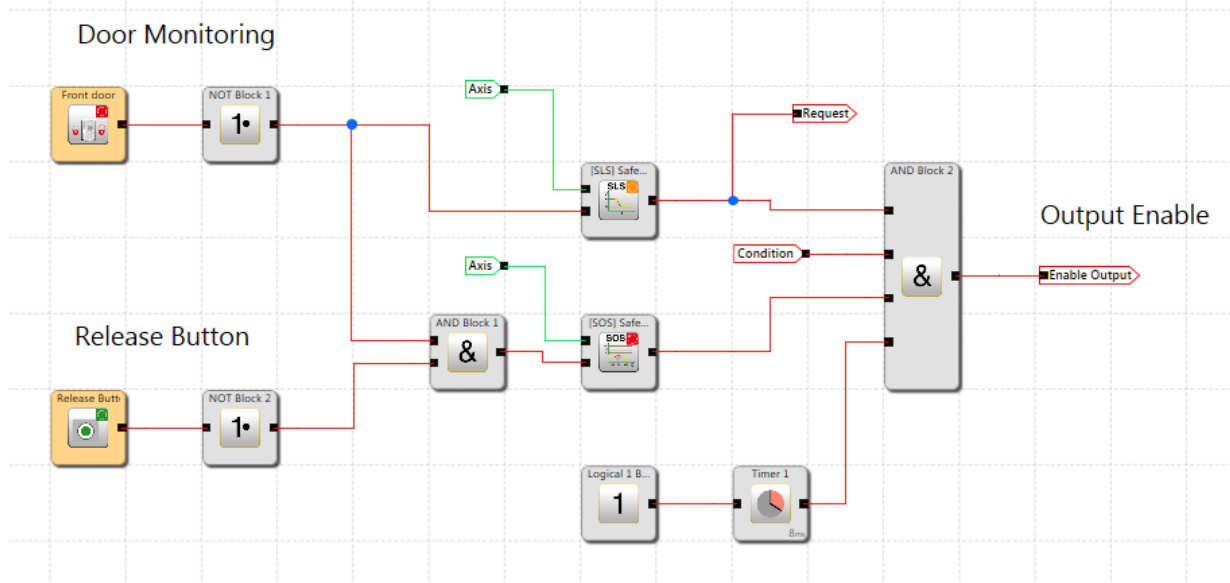

## Example 2:

- The enable function for the outputs (AND function) is also linked to FF. This operator prevents the activation of the outputs after a reset if there is a fault present in the input circuit. The outputs are only enabled after an error-free input signal has been applied once.

## 7.4 LED indication

<i><b>Colour</b></i>	<i><b>Mode</b></i>	<i><b>Description</b></i>
Green	"Flashing"	System OK, configuration validated
Yellow	"Flashing"	System OK, configuration not yet validated
Red	"Flashing"	Alarm
Red	"Continuous"	Fatal error
Yellow - red	"Flashing"	System OK, configuration not validated, SMMC configured but no bus user
Green - red	"Flashing"	System OK, configuration validated, SMMC configured but no bus user

### **Note:**

For all operating states except RUN, the outputs are rendered passive by the firmware, i.e. safely shut down. In the RUN state, the state of the outputs is dependent on the PLC program implemented.

## 7.5 Parameter configuration


The parameters are configured using the program SafePLC2. To be able to send the data to the module, a programming adapter is required; the user must install the driver for this adapter prior to use.

For a description of the parameter configuration, see *Programming manual*

### 7.5.1 Using the Memory Card

Any industrial grade standard microSD card between 2 MB and 16 GB with FAT16 or FAT32 file system can be used.

The necessary data must be copied to the SD card via the PC. This can be done directly from SafePLC2 using the 'Project to MC card' function.



The configuration files can also be copied manually. To do this, a folder 'bin' must first be created in the root directory on the memory card and the files then stored here. In addition, the files must be renamed according to the following table.

Projekt-Konfiguration	
<i>Musterprojekt.cfd100Conf2</i>	param1.cfd
<i>Musterprojekt.cfd100Prog2</i>	param2.cfd

Netzwerk-Konfiguration	
<i>Musterprojekt.cfdNetwork</i>	network.cfd

Make sure that the device is in a de-energized state.



**The module must be in a de-energized state during insertion or removal of the memory card.** Incorrect voltages or short circuits can lead to defects in the module

Insert the card into the slot provided on the front.

Please switch on the supply voltage.

If there are different configurations in the unit and on the card, the alarm **A(0)1212** is generated. If the configurations are identical, the default boot sequence runs.

#### **Note:**

The card can also remain permanently in the control unit.

Now press the function button on the front panel **twice within 3 seconds**. The system now goes into stop status. A "5" is shown in the 7-segment display.

The entire configuration, including the network configuration, is now transferred from the card to the safety control system.



This process may take some time. **Please do not interrupt the power supply or remove the card during this time.**

After successful transfer, the system is **automatically** started with the new configuration.

**Note:**

If the module shows a fatal error, the module goes into a safe state. The transfer of a configuration must then be carried out via a **direct** connection with the SafePLC2 programming software.

## 7.6 Function check

To safeguard the safety of the module, a function test on the safety functions must be undertaken once per year by the user.

For this purpose, the blocks (inputs, outputs, monitoring functions and logic blocks) used in the parameter configuration must be tested in relation to their function and shutdown, see the *Programming manual*.

## 7.7 Validation

To safeguard the safety functions implemented, the parameters and operators must be checked and documented by the user after completion of commissioning and parameter configuration. Support for this task is provided by the validation wizard in the user interface (see section "Safety-related check").

## 8 Safety-related check

To ensure the implemented safety functions, the user must check and document the parameters and links after commissioning and parameterization. This is supported by the SafePLC2 parameterization software (see programming manual).

General information on the system can be given on the first two pages. The last page of the validation report contains the individual proof of the safety-related check.

You must make the following entries here:

- Serial number (identical to the serial number on the nameplate)
- Identity to the assembly

Here the responsible tester of the safety module confirms that the CRC displayed in the programming interface is identical to the CRC stored in the module.

After entering all header data, the validation report can be generated using the "Save" button. The parameterization tool then generates a report (.PDF) with the file name of the program data record. The report contains the following information:

- The 3 pages of the header data edited above
- The configuration of the encoder
- The parameters of the existing monitoring functions
- PLC program as an instruction list

After the configuration and program data have been transferred to the PSC1 module, the status LED flashes yellow. This indicates that the configuration data has not yet been validated. By confirming the "LOCK CONFIGURATION" button at the end of the validation dialog, the data is marked as "Validated" and the LED flashes in the color "Green".

## 9 Maintenance

### 9.1 Modification / dealing with changes to the device

Servicing work is only allowed to be undertaken by qualified personnel.  
It is not necessary to undertake regular servicing work.

#### **Repair**

Devices are always to be replaced completely.  
It is only possible to repair a device in the factory.

#### **Warranty**

The warranty will be rendered void if the module is opened without authorisation.

#### **Note:**

The modification of the module will render void the safety approval!

### 9.2 Replacement of a module

On the replacement of a module the following should be noted:

- Disconnect power converter from the main supply.
- Switch off power supply for the device and disconnect.
- Disconnect encoder connectors.
- Disconnect all other connectors.
- Remove module from the DIN rail and correct correctly in relation to EMC.
- Fit new module to the DIN rail.
- Restore all connections.
- Switch on power converter.
- Switch on supply voltage.
- Configure device

#### **Note:**

In principle, no plug-in connection on the PSC1 module is allowed to be disconnected or connected again while electrically live. In particular, there is a risk of irreparable damage to position or speed sensors connected.

### 9.3 Servicing interval

Module replacement	See technical data
Function check	See section Commissioning

## 10 Technical specifications




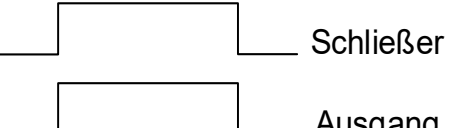

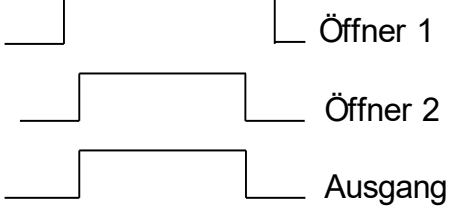

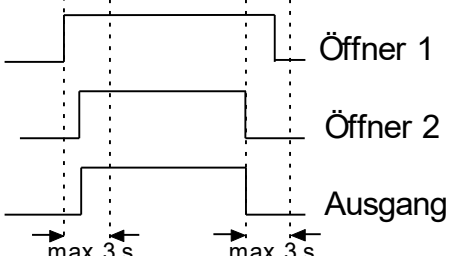
### 10.1 Ambient conditions

Degree of protection	IP 20
Ambient temperature	0 °C* ... 50 °C
Climatic class	3k3 according to DIN 60 721
Minimum, maximum relative humidity (non-condensing)	5-85%
Overvoltage category	III
Degree of pollution (IEC/EN 60664-1)	2
Max. Installation height	2000m
Service life (Tm, time to mission))	90000h in 50 °C environment







### 10.2 Safety-related characteristic data

Max. achievable safety class	<ul style="list-style-type: none"> <li>SIL 3 as per IEC 61508</li> <li>Category 4 as per EN945-1</li> <li>Performance Level e as per EN ISO 13849-1</li> </ul>	
System structure	2-channel with diagnostics (1oo2) according to IEC 61508 Architecture category 4 according to EN ISO 13849	
Design of the operating mode	"High demand" as per IEC 61508	
Probability of a dangerous failure per hour (PFH value)  Specific values as per tables "Safety-related characteristic data"	PSC1-C-100-x	See section 3.3.1
	PSC1-E-21-SDM1 PSC1-E-22-SDM1-2 (1 axis)	See section 3.3.2
	PSC1-E-23-SDM2 PSC1-E-24-SDM2-2 (2 axes)	See section 3.3.2
	PSC1-E-13x	See section 3.3.2
Proof test interval (IEC 61508)	20 years, after that the module must be replaced	





## 11 Switch types

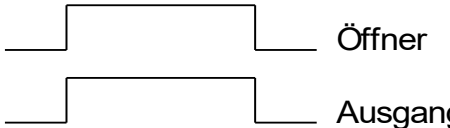

Type	Switch symbol	Truth table	Function block	Function																
1	  eSwitch_1o	<table><tr><th>NC</th><th>A</th></tr><tr><td>0</td><td>0</td></tr><tr><td>1</td><td>1</td></tr></table>	NC	A	0	0	1	1		Truth table behaves like an normally open contact, only the symbol is a normally closed contact										
NC	A																			
0	0																			
1	1																			
2	  sSwitch_1s	<table><tr><th>S</th><th>A</th></tr><tr><td>0</td><td>0</td></tr><tr><td>1</td><td>1</td></tr></table>	S	A	0	0	1	1		Normally open contact, like type 1										
S	A																			
0	0																			
1	1																			
3	  eSwitch_2o	<table><tr><th>NC1</th><th>NC2</th><th>A</th></tr><tr><td>0</td><td>0</td><td>0</td></tr><tr><td>1</td><td>0</td><td>0</td></tr><tr><td>0</td><td>1</td><td>0</td></tr><tr><td>1</td><td>1</td><td>1</td></tr></table>	NC1	NC2	A	0	0	0	1	0	0	0	1	0	1	1	1		AND operation both inputs	
NC1	NC2	A																		
0	0	0																		
1	0	0																		
0	1	0																		
1	1	1																		
4	  eSwitch_2oT	<table><tr><th>NC1</th><th>NC2</th><th>A</th></tr><tr><td>0</td><td>0</td><td>0</td></tr><tr><td>1</td><td>0</td><td>0</td></tr><tr><td>0</td><td>1</td><td>0</td></tr><tr><td>1</td><td>1</td><td>1</td></tr></table>	NC1	NC2	A	0	0	0	1	0	0	0	1	0	1	1	1	Time monitoring	Like 3, however with time monitoring of state changes. On signal change on one of the NC, complementary signal must follow within time t=3 s. If not change to fault and O=0	
NC1	NC2	A																		
0	0	0																		
1	0	0																		
0	1	0																		
1	1	1																		





# Installation manual

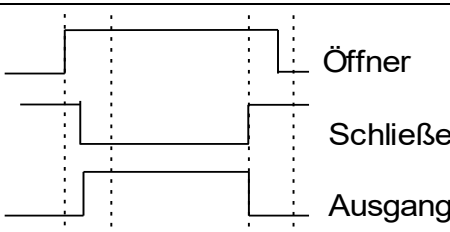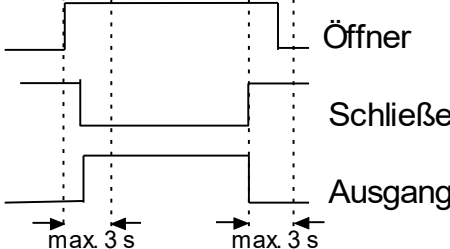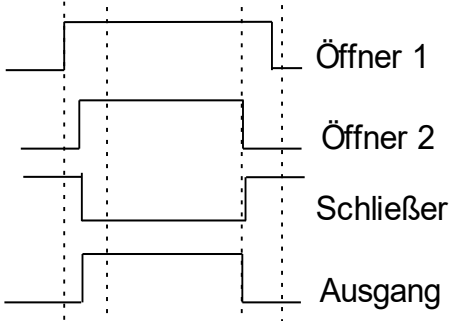Type	Switch symbol	Truth table		Function																										
5	  eSwitch_1s1o	<table><tr><th>S</th><th>NC</th><th>A</th></tr><tr><td>0</td><td>0</td><td>0</td></tr><tr><td>1</td><td>0</td><td>0</td></tr><tr><td>0</td><td>1</td><td>1</td></tr><tr><td>1</td><td>1</td><td>0</td></tr></table>	S	NC	A	0	0	0	1	0	0	0	1	1	1	1	0		Monitoring for NO = inactive and NC = active	 Öffner Schließer Ausgang										
S	NC	A																												
0	0	0																												
1	0	0																												
0	1	1																												
1	1	0																												
6	  eSwitch_1s1oT	<table><tr><th>S</th><th>NC</th><th>A</th></tr><tr><td>0</td><td>0</td><td>0</td></tr><tr><td>1</td><td>0</td><td>0</td></tr><tr><td>0</td><td>1</td><td>1</td></tr><tr><td>1</td><td>1</td><td>0</td></tr></table>	S	NC	A	0	0	0	1	0	0	0	1	1	1	1	0	Time monitoring	Like 5, however with time monitoring of state changes. On signal change on one of the NC, complementary signal must follow within time t=3 s. If not change to fault and O=0	 Öffner Schließer Ausgang max. 3 s max. 3 s										
S	NC	A																												
0	0	0																												
1	0	0																												
0	1	1																												
1	1	0																												
7	  eSwitch_2s2o	<table><tr><th>NO 1</th><th>NC 1</th><th>NO 2</th><th>NC2</th><th>A</th></tr><tr><td>1</td><td>0</td><td>1</td><td>0</td><td>0</td></tr><tr><td>0</td><td>1</td><td>1</td><td>0</td><td>0</td></tr><tr><td>0</td><td>1</td><td>0</td><td>1</td><td>1</td></tr><tr><td>1</td><td>0</td><td>0</td><td>1</td><td>0</td></tr></table>	NO 1	NC 1	NO 2	NC2	A	1	0	1	0	0	0	1	1	0	0	0	1	0	1	1	1	0	0	1	0		Monitoring for NO1*NO2= inactive and NC1*NC2= active	 Öffner 1 Öffner 2 Schließer Ausgang
NO 1	NC 1	NO 2	NC2	A																										
1	0	1	0	0																										
0	1	1	0	0																										
0	1	0	1	1																										
1	0	0	1	0																										





# Installation manual

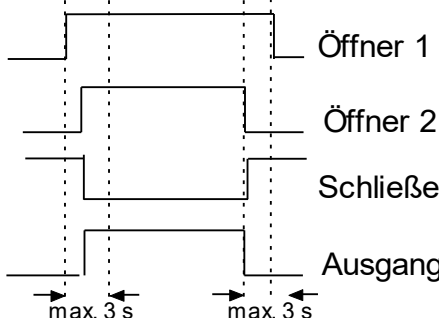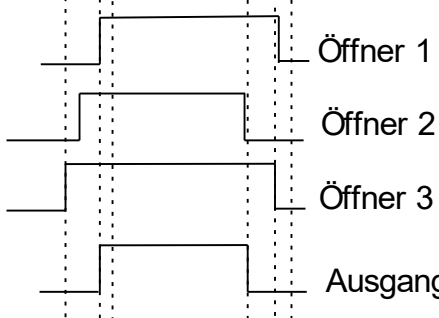Type	Switch symbol	Truth table		Function																										
8	  eSwitch_2s2oT	<table><tr><th>NO 1</th><th>NC 1</th><th>NO 2</th><th>NC2</th><th>A</th></tr><tr><td>1</td><td>0</td><td>1</td><td>0</td><td>0</td></tr><tr><td>0</td><td>1</td><td>1</td><td>0</td><td>0</td></tr><tr><td>0</td><td>1</td><td>0</td><td>1</td><td>1</td></tr><tr><td>1</td><td>0</td><td>0</td><td>1</td><td>0</td></tr></table>	NO 1	NC 1	NO 2	NC2	A	1	0	1	0	0	0	1	1	0	0	0	1	0	1	1	1	0	0	1	0	Time monitoring	Like 7, however with time monitoring of state changes. On signal change on NO (attention common wire!) or NC, complementary signal must follow within time $t=3$ s. If not change to fault and O=0	
NO 1	NC 1	NO 2	NC2	A																										
1	0	1	0	0																										
0	1	1	0	0																										
0	1	0	1	1																										
1	0	0	1	0																										
9	  eSwitch_3o	<table><tr><th>NC1</th><th>NC2</th><th>NC 3</th><th>A</th></tr><tr><td>0</td><td>0</td><td>0</td><td>0</td></tr><tr><td>1</td><td>0</td><td>0</td><td>0</td></tr><tr><td>0</td><td>1</td><td>0</td><td>0</td></tr><tr><td>1</td><td>1</td><td>0</td><td>0</td></tr><tr><td>1</td><td>1</td><td>1</td><td>1</td></tr></table>	NC1	NC2	NC 3	A	0	0	0	0	1	0	0	0	0	1	0	0	1	1	0	0	1	1	1	1		AND operator on the three inputs		
NC1	NC2	NC 3	A																											
0	0	0	0																											
1	0	0	0																											
0	1	0	0																											
1	1	0	0																											
1	1	1	1																											

10	 <p>eSwitch_3oT</p>	<table><tr><th>NC1</th><th>NC2</th><th>NC 3</th><th>A</th></tr><tr><td>0</td><td>0</td><td>0</td><td>0</td></tr><tr><td>1</td><td>0</td><td>0</td><td>0</td></tr><tr><td>0</td><td>1</td><td>0</td><td>0</td></tr><tr><td>1</td><td>1</td><td>0</td><td>0</td></tr><tr><td>1</td><td>1</td><td>1</td><td>1</td></tr></table>	NC1	NC2	NC 3	A	0	0	0	0	1	0	0	0	0	1	0	0	1	1	0	0	1	1	1	1	Time monitoring	Like 8, however with time monitoring of state changes. On signal change on one of the NC inputs the other inputs must follow within time $t=3$ s. If not change to fault and O=0	
NC1	NC2	NC 3	A																										
0	0	0	0																										
1	0	0	0																										
0	1	0	0																										
1	1	0	0																										
1	1	1	1																										

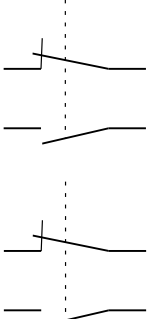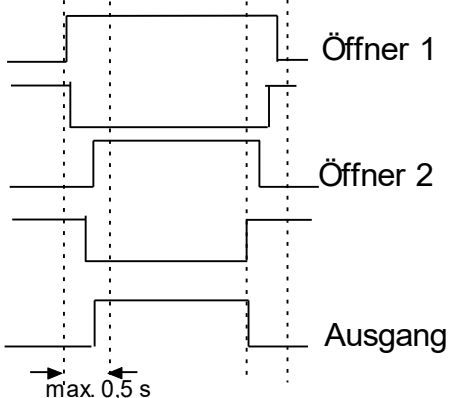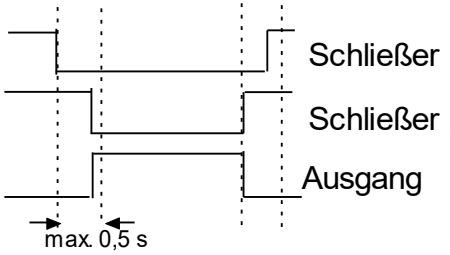Type	Switch symbol	Truth table		Function																										
11		<table><tr><th>N C1</th><th>N O 1</th><th>N C2</th><th>N O 2</th><th>A</th></tr><tr><td>0</td><td>1</td><td>0</td><td>1</td><td>0</td></tr><tr><td>1</td><td>0</td><td>0</td><td>1</td><td>0</td></tr><tr><td>1</td><td>0</td><td>1</td><td>0</td><td>0</td></tr><tr><td>0</td><td>1</td><td>0</td><td>1</td><td>1</td></tr></table>	N C1	N O 1	N C2	N O 2	A	0	1	0	1	0	1	0	0	1	0	1	0	1	0	0	0	1	0	1	1	Two-hand control MEZ	<p>Monitoring for NO1*NO2 = inactive and NC1*NC2 = active + time monitoring of this state. I.e. if there is a signal change on an NO from 1-&gt;0 or NC from 0-&gt;1 then the other signals (i.e. further NO=0 or NC=1) must follow within 0.5 s. If not the output remains = 0.</p> <p>No malfunction evaluation! No time monitoring on change to inactive state.</p>	
N C1	N O 1	N C2	N O 2	A																										
0	1	0	1	0																										
1	0	0	1	0																										
1	0	1	0	0																										
0	1	0	1	1																										
eTwoHand_2o																														
12		<table><tr><th>NO 1</th><th>N O2</th><th>A</th></tr><tr><td>1</td><td>0</td><td>0</td></tr><tr><td>0</td><td>1</td><td>0</td></tr><tr><td>0</td><td>0</td><td>0</td></tr><tr><td>1</td><td>1</td><td>1</td></tr></table>	NO 1	N O2	A	1	0	0	0	1	0	0	0	0	1	1	1	Two-hand control MEZ	<p>Monitoring for NO1*NO2 = inactive + time monitoring of this state. I.e. if there is a signal change on an NO from 1-&gt;0 then the other signal (i.e. further NO=0) must follow within 0.5 s. If not the output remains = 0.</p> <p>No malfunction evaluation! No time monitoring on change to inactive state.</p>											
NO 1	N O2	A																												
1	0	0																												
0	1	0																												
0	0	0																												
1	1	1																												
eTwoHand_2s																														

# Installation manual

13		<table><tr><th>NO</th><th>N</th><th>O</th><th>O</th></tr><tr><td>1</td><td>O2</td><td>1</td><td>2</td></tr><tr><td>1</td><td>0</td><td>1</td><td>0</td></tr><tr><td>0</td><td>1</td><td>0</td><td>1</td></tr><tr><td>0</td><td>0</td><td>0</td><td>0</td></tr><tr><td>1</td><td>1</td><td>0</td><td>0</td></tr></table>	NO	N	O	O	1	O2	1	2	1	0	1	0	0	1	0	1	0	0	0	0	1	1	0	0	Selector switch	Unambiguous operator for the permissible switch positions		Öffner Schließer Ausgang																																				
NO	N	O	O																																																															
1	O2	1	2																																																															
1	0	1	0																																																															
0	1	0	1																																																															
0	0	0	0																																																															
1	1	0	0																																																															
eMode_1s1o																																																																		
14		<table><tr><th>NO</th><th>N</th><th>S3</th><th>O</th><th>O</th><th>O</th></tr><tr><td>1</td><td>O2</td><td></td><td>1</td><td>2</td><td>3</td></tr><tr><td>1</td><td>0</td><td>0</td><td>1</td><td>0</td><td>0</td></tr><tr><td>0</td><td>1</td><td>0</td><td>0</td><td>1</td><td>0</td></tr><tr><td>0</td><td>0</td><td>1</td><td>0</td><td>0</td><td>1</td></tr><tr><td>1</td><td>1</td><td>0</td><td>0</td><td>0</td><td>0</td></tr><tr><td>1</td><td>0</td><td>1</td><td>0</td><td>0</td><td>0</td></tr><tr><td>0</td><td>1</td><td>1</td><td>0</td><td>0</td><td>0</td></tr><tr><td>1</td><td>1</td><td>1</td><td>0</td><td>0</td><td>0</td></tr><tr><td>0</td><td>0</td><td>0</td><td>0</td><td>0</td><td>0</td></tr></table>	NO	N	S3	O	O	O	1	O2		1	2	3	1	0	0	1	0	0	0	1	0	0	1	0	0	0	1	0	0	1	1	1	0	0	0	0	1	0	1	0	0	0	0	1	1	0	0	0	1	1	1	0	0	0	0	0	0	0	0	0	Selector switch	Unambiguous operator for the permissible switch positions		Schalter 1 Schalter 2 Schalter 3 Ausgang 1
NO	N	S3	O	O	O																																																													
1	O2		1	2	3																																																													
1	0	0	1	0	0																																																													
0	1	0	0	1	0																																																													
0	0	1	0	0	1																																																													
1	1	0	0	0	0																																																													
1	0	1	0	0	0																																																													
0	1	1	0	0	0																																																													
1	1	1	0	0	0																																																													
0	0	0	0	0	0																																																													
eMode_3switch																																																																		


## 12 Notes for designing, programming, validating and testing safety-related applications

The following notes describe the procedures for designing, programming, validating and testing safety-related applications

The notes are intended to assist the user in arranging, clearly understanding and applying all steps from the risk assessment to the system test. For improved understanding of the related points, the individual steps are explained in more detail based on examples.


### 12.1 Risk assessment

In principle the manufacturer of a machine must ensure the machine designed and supplied is safe. The related applicable directives and standards are to be used for the assessment. The goal of the safety assessment and the resulting measures derived must be the reduction of the hazard for persons to an acceptable level.

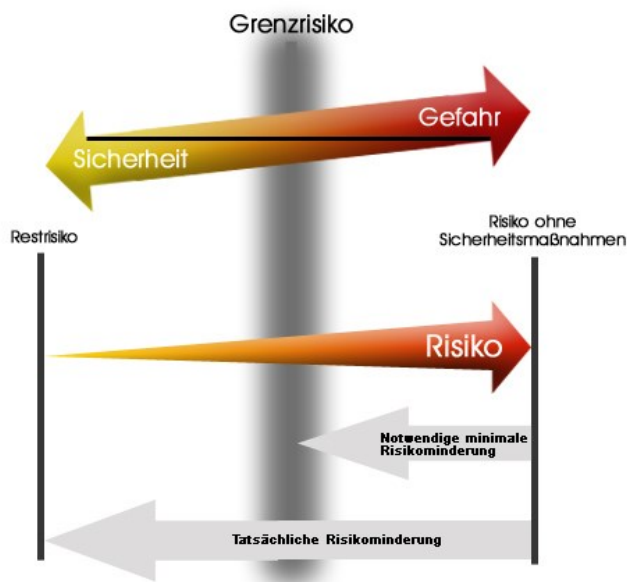

The analysis of the hazards must take into account all operating states of the machine such as operation, setting up and servicing or installing and decommissioning, as well all foreseeable misuse. The necessary procedure for the risk assessment and the measures for the reduction of the risk are given, e.g. in the applicable standards  
EN ISO 13849-1 Safety of machinery  
EN ISO 61508 Functional safety of electrical/electronic/programmable electronic safety-related systems.

## Risk assessment according to EN ISO 13849-1

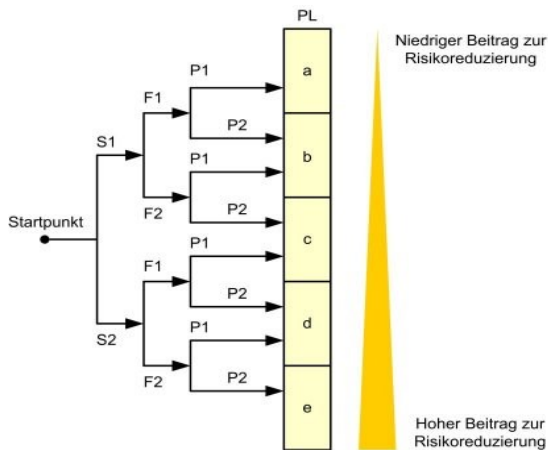

S – severity of injury

S1 = slight, reversible injury

S2 = serious, irreversible injury

F – frequency and/or exposure to hazard

F1 = seldom, not cyclic


F2 = frequent to continuous and/or exposure time is long, cyclic operation

P – possibility of avoiding hazard

P1 = possible, slow movement / acceleration

P2 = scarcely possible, high acceleration in event of a fault

## Risk assessment according to EN ISO 61508

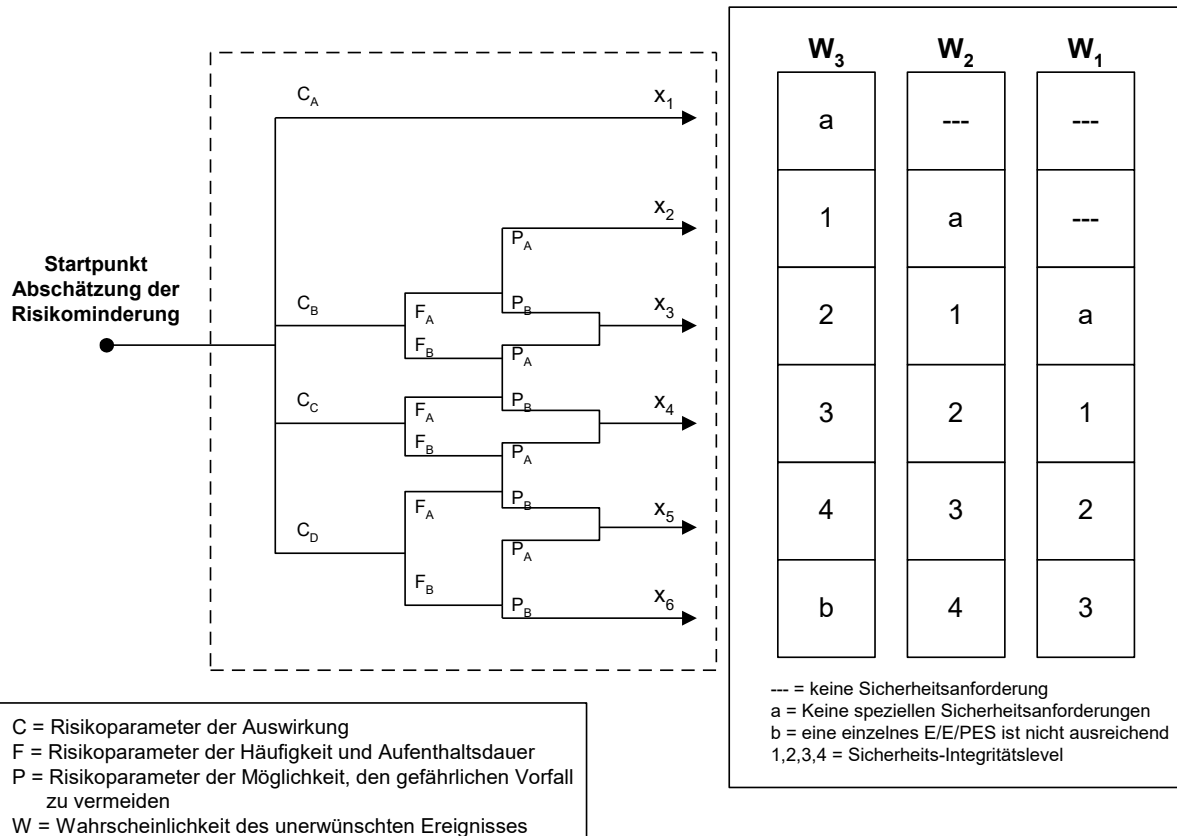

The risks to be considered are also given in the applicable directives and standards and are to be considered specifically by the manufacturer based on the manufacturer's specific knowledge of the machine.

For machines placed on the market in the EU, the risks to be considered as a minimum are specified in the EU Machinery Directive 2006/42/EC or in the latest version of this Directive.

Further information on the risk assessment and the safe design of machines is given in the standards EN 14121 Safety of machinery - Risk assessment

EN 12100 Safety of machinery - General principles for design.

Measures that are applied to reduce the hazards identified must correspond as a minimum to the same level as the hazard. Such measures and the requirements on them are also given in examples in the directives and standards listed above.

## 12.2 Technical documentation required

Various technical documents are to be delivered by the manufacturer. The minimum scope of these documents is also given in the applicable directives and standards.

***E.g. as per the EU Machinery directive the following documents as a minimum are to be delivered:***

1. Die technischen Unterlagen umfassen:
  - a) eine technische Dokumentation mit folgenden Angaben bzw. Unterlagen:
    - eine allgemeine Beschreibung der Maschine
    - eine Übersichtszeichnung der Maschine und die Schaltpläne der Steuerkreise sowie Beschreibungen und Erläuterungen, die zum Verständnis der Funktionsweise der Maschine erforderlich sind
    - vollständige Detailzeichnungen, eventuell mit Berechnungen, Versuchsergebnissen, Bescheinigungen usw., die für die Überprüfung der Übereinstimmung der Maschine mit den grundlegenden Sicherheits- und Gesundheitsschutzanforderungen erforderlich sind
    - die Unterlagen über die Risikobeurteilung, aus denen hervorgeht, welches Verfahren angewandt wurde; dies schließt ein:
      - i) eine Liste der grundlegenden Sicherheits- und Gesundheitsschutzanforderungen, die für die Maschine gelten
      - ii) eine Beschreibung der zur Abwendung ermittelter Gefährdungen oder zur Risikominderung ergriffenen Schutzmaßnahmen und gegebenenfalls eine Angabe der von der Maschine ausgehenden Restrisiken
    - die angewandten Normen und sonstige technische Spezifikationen unter Angabe der von diesen Normen erfassten grundlegenden Sicherheits- und Gesundheitsschutzanforderungen
    - alle technischen Berichte mit den Ergebnissen der Prüfungen, die vom Hersteller selbst oder von einer Stelle nach Wahl des Herstellers oder seines Bevollmächtigten durchgeführt wurden
    - ein Exemplar der Betriebsanleitung der Maschine
    - gegebenenfalls die Einbauerklärung für unvollständige Maschinen und die Montageanleitung für solche unvollständigen Maschinen
    - gegebenenfalls eine Kopie der EG-Konformitätserklärung für in die Maschine eingebaute andere Maschinen oder Produkte,
    - eine Kopie der EG-Konformitätserklärung
  - b) bei Serienfertigung eine Aufstellung der intern getroffenen Maßnahmen zur Gewährleistung der Übereinstimmung aller gefertigten Maschinen mit den Bestimmungen dieser Richtlinie

Source BGIA Report 2/2008

The documents must be prepared such that they are easy to understand and in the national language.

## 12.3 Steps required for designing, realisation and testing


The realisation of parts of systems with a safety-related function requires particular care during planning, realisation and testing. Guidelines on these issues are also given in the applicable standards (cf. EN ISO 13849-2 or EN ISO 61508). The effort here depends on the complexity of the task for parts of the system with a safety-related function.

For the realisation of such functions with the aid of safety-related control and monitoring functions, the PSC1 series offers efficient support in the form of the system architecture (architecture cat. 4 according to EN ISO 13849-1) and above all also the programming language and tested safety functions. Programming is in the form of FUP (function plan-orientated programming) as recommended in the safety standards. It also corresponds to the requirements on a limited variability programming language (LVL) for which significant simplifications in the documentation and test scope apply.

In any case the individual steps require careful planning and analysis of the methods and systems used. The individual steps are also to be documented so they are clearly traceable.

### **V model (simplified):**

The implementation of safety-related functions requires a structured procedure as is shown, for example, in the V model recommended in applicable standards. In the following as an example the procedure for applications with modules from the PSC1 series is shown.

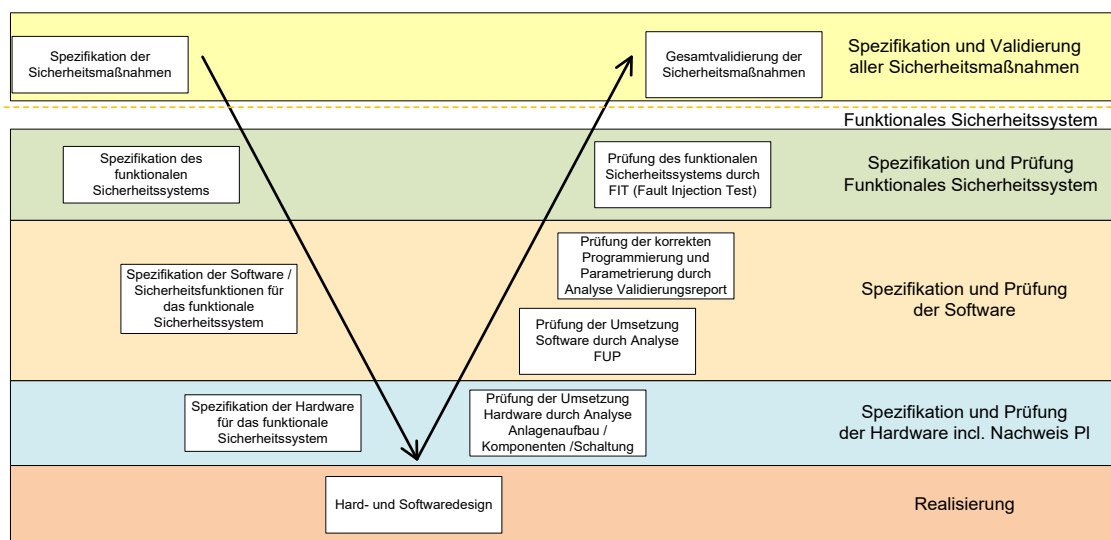

## 12.3.1 Phases of the V model

Description	Description	
	Design phase	Validation phase
Specification and validation of all passive and active safety measures	Specification of all safety measures to be taken such as covers, barriers, max. machine parameters, safety-related functions etc.	Check on all passive and active safety measures for their correct implementation and effectiveness
Specification of the functional safety system	Specification of the active safety systems and their allocation to the risks to be reduced, e.g. limited speed in setting up mode, stop mode, monitoring of the access areas etc. Specification of the PLr or required SIL for each individual safety function	Check on all active safety systems for their effectiveness and compliance with the parameters specified, e.g. incorrectly increased speed, incorrect stop, triggering of monitoring devices etc. using practical tests
Specification of the software / safety functions	Specification of the functionality of individual safety functions incl. definition of the shutdown circuit etc. Definition of the parameters for the individual safety function, e.g. max. speed, stop ramps and category etc.	Check on the correct implementation of the functional specifications by means of analysis of FUP programming Validation of the application program and the parameters by comparison of the validation report with FUP and specifications for parameters
Specification of the hardware	Specification of the system layout and the functions for the individual sensors, controls, control components and actuators in relation to the safety functions	Check on the correct implementation of the specifications. Determination of the probability of failure or PL by means of analysis of the complete architecture and the characteristic data for all components involved, in each case in relation to the individual safety functions
Hardware and software design	Specific planning and implementation of the system layout / wiring.  Specific implementation of the safety functions by means of programming in FUP	

## 12.3.2 Specification of the safety requirements (breakdown)

*The safety requirements must be analysed in detail based on the standards to be applied, e.g. product standards.*

1	Allgemeine Produkt- und Projektangaben
1.1	Produktidentifikation
1.2	Autor, Version, Datum, Dokumentenname, Dateiname
1.3	Inhaltsverzeichnis
1.4	Begriffe, Definitionen, Glossar
1.5	Versionshistorie und Änderungsvermerke
1.6	Für die Entwicklung relevante Richtlinien, Normen und technische Regeln
2	Funktionale Angaben zur Maschine, soweit sicherheitstechnisch von Bedeutung
2.1	Bestimmungsgemäße Verwendung und vernünftigerweise vorhersehbare Fehlanwendung/-bedienung
2.2	Prozessbeschreibung (Betriebsfunktionen)
2.3	Betriebsarten (z.B. Einrichtbetrieb, Automatikbetrieb, Betrieb mit lokalem Bezug oder von Teilen der Maschine)
2.4	Kenndaten, z.B. Zykluszeiten, Reaktionszeiten, Nachlaufwege
2.5	Sonstige Eigenschaften der Maschine
2.6	Sicherer Zustand der Maschine
2.7	Wechselwirkung zwischen Prozessen (siehe auch 2.2) und manuellen Aktionen (Reparatur, Einrichten, Reinigen, Fehlersuche usw.)
2.8	Handlungen im Notfall
3	Erforderliche(r) Performance Level (PL <sub>r</sub> )
3.1	Referenz auf vorhandene Dokumentation zur Gefährdungsanalyse und Risikobeurteilung der Maschine
3.2	Ergebnisse der Risikobeurteilung für jede ermittelte Gefährdung oder Gefährdungssituation und Festlegung der zur Risikominderung jeweils erforderlichen Sicherheitsfunktion(en)
4	Sicherheitsfunktionen (Angaben gelten für jede Sicherheitsfunktion)
	- Funktionsbeschreibung („Erfassen – Verarbeiten – Ausgeben“) einschließlich aller funktionaler Eigenschaften (siehe auch Tabellen 5.1 und 5.2)
	- Aktivierungs-/Deaktivierungsbedingungen oder -ereignisse (z.B. Betriebsarten der Maschine)
	- Verhalten der Maschine beim Auslösen der Sicherheitsfunktion
	- zu berücksichtigende Wiederanlaufbedingungen
	- Leistungskriterien/Leistungsdaten
	- Ablauf (zeitliches Verhalten) der Sicherheitsfunktion mit Reaktionszeit
	- Häufigkeit der Betätigung (d.h. Anforderungsrate), Erholungszeiten nach Anforderung
	- sonstige Daten
	- einstellbare Parameter (soweit vorgesehen)
	- Einordnung und Zuordnung von Prioritäten bei gleichzeitiger Anforderung und Bearbeitung mehrerer Sicherheitsfunktionen
	- funktionales Konzept zur Trennung bzw. Unabhängigkeit/Rückwirkungsfreiheit zu Nicht-Sicherheitsfunktionen und weiteren Sicherheitsfunktionen
5	Vorgaben für den SRP/CS-Entwurf
5.1	Zuweisung, durch welche SRP/CS und in welcher Technologie die Sicherheitsfunktion realisiert werden soll, vorgesehene Betriebsmittel
5.2	Auswahl der Kategorie, vorgesehene Architektur (Struktur) als sicherheitsbezogenes Blockdiagramm mit Beschreibung
5.3	Schnittstellenbeschreibung (Prozessschnittstellen, interne Schnittstellen, Bedienerchnittstellen, Bedien- und Anzeigeelemente usw.)
5.4	Einschaltverhalten, Umsetzung des erforderlichen Anlaufverhaltens und Wiederanlaufverhaltens
5.5	Leistungsdaten: Zykluszeiten, Reaktionszeiten usw.
5.6	Verhalten des SRP/CS bei Bauteilausfällen und -fehlern (Erreichen und Aufrechterhalten des sicheren Zustandes) einschließlich Zeitverhalten
5.7	Zu berücksichtigende Ausfallarten von Bauteilen, Baugruppen oder Blöcken und ggf. Begründung für Fehlerausschlüsse
5.8	Konzept zur Umsetzung der Erkennung und Beherrschung von zufälligen und systematischen Ausfällen (Selbsttests, Testschaltungen, Überwachungen, Vergleiche, Plausibilitätsprüfungen, Fehlererkennung durch den Prozess usw.)
5.9	Quantitative Aspekte
5.9.1	Zielwerte für $MTTF_d$ und $DC_{avg}$
5.9.2	Schalthäufigkeit verschleißbehafteter Bauteile
5.9.3	Häufigkeit von Maßnahmen zur Fehleraufdeckung
5.9.4	Gebrauchsdauer, falls abweichend von der Berechnungsgrundlage der vorgesehenen Architekturen (20 Jahre)
5.10	Betriebs- und Grenzdaten (Betriebs- und Lagertemperaturbereich, Feuchteklasse, IP-Schutzart, Schock-/Vibrations-/EMV-Störfestigkeitswerte, Versorgungsdaten mit Toleranzen usw.) (IP = International Protection, EMV = elektromagnetische Verträglichkeit)
5.11	Anzuwendende Grundnormen für die Konstruktion (zur Ausrüstung, zum Schutz gegen elektrischen Schlag/gefährliche Körperströme, zur Störfestigkeit gegen Umgebungsbedingungen usw.)
5.12	Technische und organisatorische Maßnahmen für einen gesicherten Zugriff auf sicherheitsrelevante Parameter bzw. SRP/CS-Eigenschaften (Manipulationsschutz, Zugangssicherung, Programm-/Datenschutz) und zum Schutz gegen unbefugtes Bedienen (Schlüsselschalter, Code usw.), z.B. bei Sonderbetriebsarten
5.13	Allgemeine technische Voraussetzungen und organisatorische Rahmenbedingungen für die Inbetriebnahme, Prüfung und Abnahme sowie Wartung und Instandhaltung

Source: General specifications, extract BGIA Report 2/2008 on EN ISO 13849-1

## *Example for an automatic handling system:*

### **Functional description:**

The automatic handling system is used to pick up varying height lorry cabs automatically. After pick-up the height of the cab is safely acquired so that the cab cannot be lowered below a certain height in the working area. The automatic system must not exceed a maximum speed in the working area. After the cab has been fully processed, it is set down again at the end of the processing line and the automatic handling system returns via a return path to the start of the line to pick up a cab again....

### **Boundaries of the machine:**

Spatial boundaries: there must be enough space for the workers in the working area so that all the necessary work on the cab can be undertaken.... In the return there must be enough space for the empty automatic system tackle...

Time-related boundaries: description of the service life, description of ageing processes that could cause a change to machine parameters (e.g. brakes). Monitoring mechanisms must be provided for such cases.

Application boundaries: the automatic system automatically collects new cabs and moves them through a processing area. In the processing area there are workers...etc.

The following operating modes are provided: setting up mode, automatic mode and service mode...etc.

### **Identification of hazards:**

The following mechanical hazards are relevant on the automatic handling system:

Hazard 1: Crushing due to falling cab / lifting bar

Hazard 2: Impact due to falling cab / lifting bar

Hazard 3: Crushing due to fast lowering of the cab if there is a fault

Hazard 4:.....

### **Risk analysis:**

G1: The weight of the cab and the lifting bar is so high that irreversible crushing or fatalities may occur.

G2: Due to moving cab / lifting bar, impact with irreversible injuries may occur.

G3: ....

### **Risk assessment:**

A risk reduction is necessary taking into account all operating conditions.

Inherently (risks from the project) safe design

Moving the cab in x and y direction in the working area is unavoidable. The cab must be moved up/down and forwards in the processing area....











The following measures can be taken:

Avoid hazards due to excessively fast movements

Avoid hazards due to excessively small distances

Example for a hazard analysis:

## Gefahrenanalyse

Sicherheitsnachweis für Herstellereklärung			Maschinentyp Verpackungsanlage	Auftrags-Nummer 200-402		Kunde		Erstellt: Michael Düssel am 16.10.06 Blatt 1 von 4			
Betriebs- zustand	Gefährdung durch Kurzbeschreibung	Check	Ereignis oder Schutzziel	Leistung	Auf- KL	St. Kat.	Verwendete Normen und Richtlinien	Hinweise/ Kriterien für Inbetriebnahme und Prüfung	geprüft am	von	
			<b>Lineareinheiten</b>								
Automatik und Hand- betrieb	Quetschen Erfassen Einziehen	  	Schutz vor Quetschen, Erfassen und Einziehen erforderlich bei: -Linearbewegung in X-Richtung -Linearbewegung in Y-Richtung	Schutzverkleidung 2m hoch, mit Punktschweiß- gitter MW 40 mm Schutztür mit Sicherheits- türschalter			EN 292-2 Abs. 3.2 EN 294 Abs. 4.5.1	Schutzverkleidung vorhanden? Fest mit der Maschine ver- schraubt? ES-Funktion überprüft -Maschine muß sofort anhalten, wenn Türe geöffnet wird			
			<b>Strafferzylinder/Schwert</b>								
Automatik und Hand- betrieb	Quetschen Stossen		Schutz vor Quetschen und Stossen erforderlich bei: -pneumatische Linearbewegung	Schutzverkleidung 2m hoch, mit Punktschweiß- gitter MW 40 mm			EN 292-2 Abs. 3.2 EN 294 Abs. 4.5.1	Schutzverkleidung vorhanden? Fest mit der Maschine ver- schraubt?			
			<b>Zentrierung mit Andrückblech</b>								
Automatik und Hand- betrieb	Quetschen Erfassen Einziehen	  	Schutz vor Quetschen, Erfassen und Einziehen erforderlich bei: -pneumatischer Schwenkbewegung	Schutzverkleidung 2m hoch, mit Punktschweiß- gitter MW 40 mm Schutztür mit Sicherheits- türschalter			EN 292-2 Abs. 3.2 EN 294 Abs. 4.5.1	Schutzverkleidung vorhanden? Fest mit der Maschine ver- schraubt? ES-Funktion überprüft -Maschine muß sofort anhalten, wenn Türe geöffnet wird			
			<b>Schließrollen</b>								
Automatik und Hand- betrieb	Quetschen Erfassen Einziehen	  	Schutz vor Quetschen, Erfassen und Einziehen erforderlich bei: -pneumatische Linearbewegung	Schutzverkleidung 2m hoch, mit Punktschweiß- gitter MW 40 mm. Schutzabdeckung aus Blech bzw. Lochblech, Spalte und Lochgröße < 8mm			EN 292-2 Abs. 3.2 EN 294 Abs. 4.5.1	Schutzverkleidung vorhanden? Schutzab- deckung vorhanden? Fest mit der Maschine verschraubt?			

## 12.3.3 Specification of the functional safety system

Derived from the general hazard and risk analysis for the machine, the active protection functions are to be identified and specified.

Active protection functions are, e.g. safely limited speed in certain system states, monitored stop and standstill functions, range monitoring, processing of monitoring devices such as light grids, safety mats, etc.

The safety functions are each to be bounded and the specific requirements defined in relation to function and safety level.


### 12.3.3.1 Definition of the safety functions

The definition of the safety function must:

- State the risk to be covered
- Describe the exact function
- List all sensors, controls involved
- Identify all controllers
- Identify the related shutdown circuit
- The definition is intended to form the basis for the specification of the hardware and software design.
- For each of the safety functions defined in this manner, any parameters to be used, e.g. max. system speed in the setting up mode etc. are to be defined.
- Example for safety functions:
  - SF1: STO (safe torque off) for protection against safe startup
  - SF2: Safe speeds
  - SF3: Safe positions
  - SF4.:.....

## 12.3.3.2 Performance Level required (PLr) (additional emergency stop)

The Performance Level required must now be determined from the safety functions SF1..... stated above. The decision path can be seen in the example below.

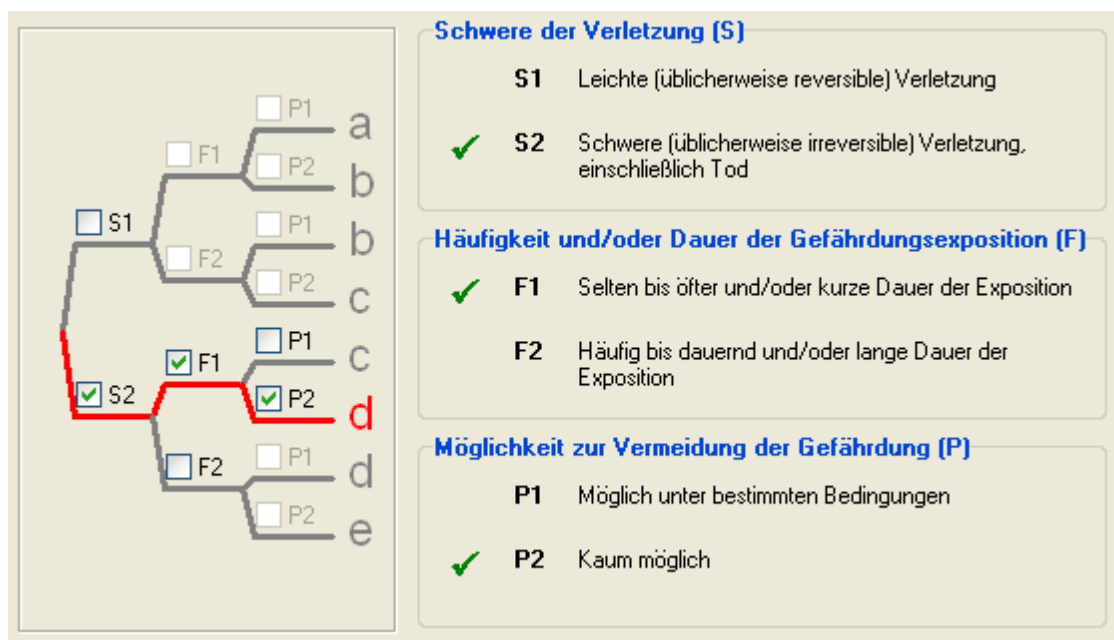

Example for SF1: Result PF = d (source Sistema)

## 12.3.3.3 Example – specification of the safety functions in tabular form

Seq. no.	Safety function	Ref. from GFA	PL <sub>r</sub>	Measured value /sensor	Implementation in software	Required Parameter	Input/ activation	Response/ output
1.1	Limitation of the max. speed of movement, Monitoring of the maximum speed	2.3	e	1 x WCS absolute encoder  1 x incremental encoder on motor / drive wheel	Monitoring using tested safety function SLS for fixed limits:	550mm/s Overspeed distance monitoring: 200mm	Continuous  Reset: Reset button	Operation stop  SF 1.7.1
1.2	Limitation of the max. speed of movement of the running gear in working area of worker Monitoring of the maximum speed for < 0.33 m/s	2.4	e	1 x WCS absolute encoder  1 x incremental encoder on motor / drive wheel	Monitoring using tested safety function SLS for fixed limits:	60 mm/s Overspeed distance monitoring: 200mm	Identification of working area of worker via position of running gear AND NOT setting up  Reset: Reset button	SF 1.7.1
1.3	Limitation of the max. speed of movement of the running gear in the setting up mode Monitoring of the maximum speed for < 0.07 m/s	3.1	d	1 x WCS absolute encoder  1 x incremental encoder on motor / drive wheel	Monitoring using tested safety function SLS for fixed limits:	70mm/s Overspeed distance monitoring: 200mm	Setting up operating mode AND "Bypass safety" button  Reset: Reset button	SF 1.7.1
1.4	Running gear collision protection  Monitoring of the distances for minimum distance using redundant laser distance measurement	2.5	d	2 x laser distance measuring devices	Monitoring of the distances using tested SAC function.  The analogue distance measured values are compared mutually for max. tolerance (analogue sensor diagnostics) Monitored for minimum values (SAC function) Min. distance value 25% of the max. value for measuring device		Running gear outside working area of the worker  Reset: Reset button	SF 1.7.1
1.6.1	Running gear sensor system monitoring * for the two running gear sensors	5.1	e	1 x WCS absolute encoder 1 x incremental encoder on motor / drive wheel	Muting of the diagnostics for both running gear sensors using tested SCA function Muting is started before each gap, an incorrect encoder value is then briefly suppressed. In the gap, an encoder value outside of 2 to 160000 mm results in muting		Pos 1 (7626 - 7850) Pos 2 (11030-1263) Pos 3 (75134-5338) Pos 4 (145562-145622) Pos 5 (143935-143995) Pos 6 (80000-80060)	SF 1.6.2

## 12.3.4 Software specification

The software specification relates to the prior specification of the safety functions. It can also be replaced by a correspondingly prepared specification of the safety functions if this contains all specifications (see example in 12.3.3.3).

***However, it is recommended to prepare an extracted list. This list should contain the following information:***

- Identification of the safety function
- Functional description
- Parameters as far as present
- Triggering event / operating state
- Response / output

The level of detail in the specification should be suitable for subsequent validation of the programming.

## Example software specification

Seq. no.	Safety function	PLr	Measured value /sensor	New solution	Input/activation	Response/output
1.4	Monitoring V_rope in relation to V_required Monitoring of the difference between main drive speed and rope drive for maximum value	d	Digital incremental encoder,  tacho generator sheave	Monitoring using tested function SLS + SAC with comparison of speed ranges / analogue value range = comparison for diagnostics on the speed acquisition  Shutdown 2-channel new (see below)	Continuous  Reset: Reset button	Operating stop  SF 1.3.1
1.6	Backstop Monitoring for return	d	Mechanical limit switch 22S2  Digital incremental encoder	Monitoring using tested function, direction monitoring SDI	EMERGENCY (auxiliary contact 28K4 – inspection movement)  Reset: Reset button	Operating stop  SF 1.3.1
1.15	Stepwise shutdown 3 Activation of the safety brake	e	-	Processing of SF in SafePLC2	SF 1.2 SF 1.3.2 SF 1.7 SF 1.8	Set safety brake
1.8	Functional standstill	d	Digital incremental encoder	Standstill monitoring using tested function SOS	Controller disable OR Set service brake	SF 1.15/ Set safety brake
1.9	Direction monitoring	e	Digital incremental encoder,	Monitoring using tested function, direction monitoring SDI	28K1 = FORWARD 28K2 = BACK	Operating stop  SF 1.3.1

## 12.3.5 Hardware specification

In the hardware specification, the complete system layout and in particular the components used here are to be described with their specific characteristic data. The hardware specification is used as the basis for determining the safety level achieved based on the architecture and the characteristic data of all devices involved in a safety function.

In addition, the design measures for protection against systematic and common cause failures are to be stated in the hardware specification.

### 12.3.5.1 Selection of SRP/CS and equipment

The SRP/CS (safety related parts of control system) are to be selected appropriately for achieving the safety level required for each safety function. The components are to be marked with the safety-related function in a complete overview of the system and assigned to the individual safety functions. The safety-related characteristic data are to be determined for these components.

The characteristic data include the following values:


$MTTF_d$  = mean time to dangerous failure

$DC_{avg}$  = average diagnostic coverage

CCF = common cause failure

On a SRP/CS, the software and systematic failures are also to be considered.

In principle, an analysis is to be undertaken on the SRP/CS involved in a safety function according to the scheme sensor / PES / actuator.



## 12.3.5.2 Examples for hardware specification

Safety function		Safely limited speed	SF 2.2	Safely monitored limited speed with door open							
Type	Description	Function	Designation	Characteristic data							Comment
				Architec ture	MTTFd [years]	PFH [1/h]	B10d	Source	DC [%]	Source	
Sensor	Sensor 1	Door locking – monitoring of the access door	A 3.1	4			10000 0	Data sheet	99	Inst. Handb. PSC1	
	Sensor 2.1	Incremental encoder – motor feedback SIN/COS	G 1.1	4	30			Gen. specificatio ns	99	Inst. Handb. PSC1	Cat. 4 in conjunction with eval. PSC1
PES	Safety PLC	Central safety PLC for control system and evaluation of safety-related functions	A 4.1			1.4 E-8		Data sheet PSC1			
Actuator	STO	Safe Torque Off on converter	A 5.1	4	150			Data sheet converter	99	Inst. Handb. PSC1	Cat. 4 in conjunction with 2nd channel
	Mains contactor	Contactor in the mains cable for the converter	K 5.1	4			20 E6	Data sheet contactor	99	Inst. Handb. PSC1	Cat. 4 in conjunction with 2nd channel


## 12.3.5.3 Consideration of systematic failures

In addition, systematic failures are also to be considered in the hardware specification.

### **Example of measures against systematic failures:**

Loss of power during operation. If there is a hazard here, a power loss must be considered like an operating state. The SRP/CS must control this state such that the safe state is retained.

### **Measures against systematic failures according to Annex G DIN EN ISO 13849-1:**

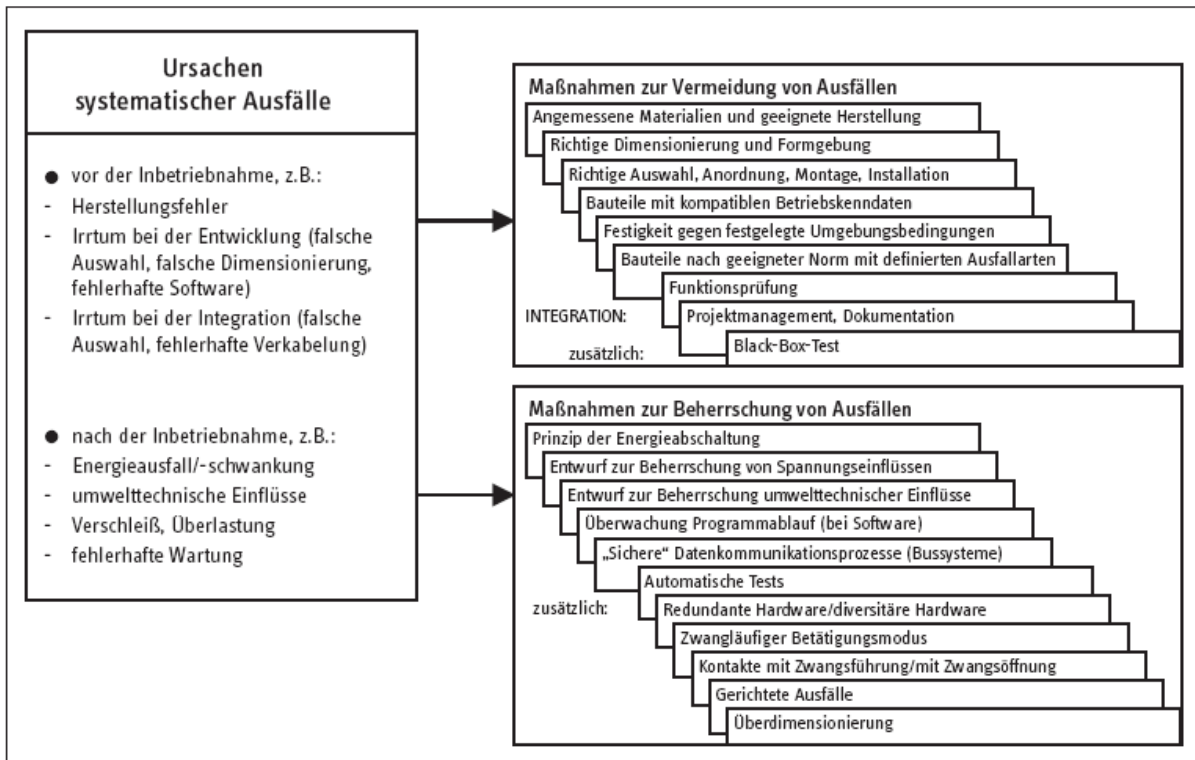

Source BGIA Report 2/2008

### **Fault exclusions:**

If there are fault exclusions for certain devices or system components, these are to be stated and specified in detail.

Fault exclusions can be, e.g. mech. shaft fracture, sticking switching contacts, short-circuits in cables and wires etc.

The admissibility of the fault exclusions is to be justified, e.g. by referencing permissible fault exclusions according to applicable standards e.g. EN ISO 13849-1)

If special measures are necessary for these fault exclusions, these are to be stated.

**Examples for fault exclusions and measures assigned:**

- Positive locking connection on mech. shaft connections
- Dimensioning based on adequate theoretical principles related to fracture of components in the safety chain
- Positive guidance in conjunction with positive separation on sticking of switching contacts
- Protected laying within the switchgear to avoid short-circuits in cables and wires, as well as laying cables in cable ducts

## 12.3.6 Hardware and software design

The specifications from the hardware and software specification are implemented in the actual system design.

The specifications for the components to be used and their circuitry from the hardware specification are to be met as are the specifications for the fault exclusions. Both are to be safeguarded using suitable means and are to be documented.

The specifications from the software specification are also to be followed and fully implemented in the software.

In addition, the higher-level specifications for the software from safety-related programming must be observed. These include:

- Modular and clearly structured layout of the program
- Assignment of functions to the safety functions

Comprehensible depiction of the functions by means of:

- Unambiguous identifiers
- Comprehensible comments
- Wide-ranging use of tested functions/function blocks
- Defensive programming

## 12.3.7 Check of the hardware design

On completion of the planning, the hardware design is to be checked for compliance with the specifications from the hardware specification.

In addition, compliance with the specific safety level for each individual safety function is to be checked by means of suitable analysis. The analytical methods are described in the applicable standards (e.g. EN ISO 13849-1).

### ***Circuit diagram analysis:***

Compliance with the safety-related aspects of the specifications is to be checked based on the circuit diagram and the parts list.

In particular, to be checked are:

- The component connection circuitry as per specifications
- The dual-channel layout as far as specified
- The freedom from interaction of parallel, redundant channels
- The use of components as per specifications
- The check must be made by means of a traceable analysis

### 12.3.7.1 Iterative check on the safety level achieved


The safety level achieved is to be determined based on the circuit layout (= architecture single-channel / dual-channel / with or without diagnostics), the device characteristic data (information from manufacturer or appropriate sources) and the diagnostic coverage (information from manufacturer of PES or general sources). The appropriate methods are to be found in the underlying safety standard.

As an example, a calculation according to EN ISO 13849-1 is shown:


## Safety function:

Safely limited speed with open access door

## Schematic layout:

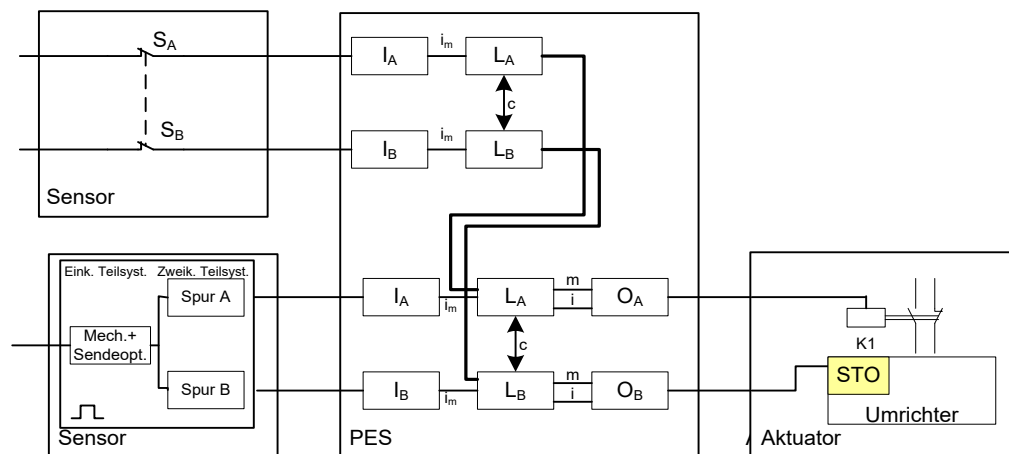

## Safety-related schematic layout:

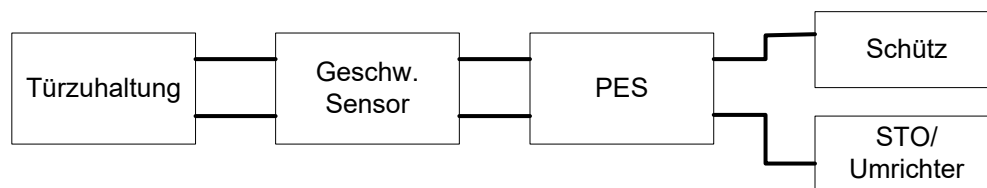

## Calculation according to EN ISO 13849-1:

### Channel A – shutdown via mains contactor:

Component	MTTFd [years]	DC
Door locking	$B10d = 100000$ $NOP = 30/\text{working days} = 9270/\text{year} (309 \text{ working days/year})$ $MTTFd = \frac{B10d}{0,1 * Nop} = 108 \text{ Jahre}$	$DC_{\text{Switch}} = 99\%$
SIN/COS encoder	$MTTFd_{\text{SinCos}} = 30 \text{ years}$	$DC_{\text{Encoder}} = 99\%$
PES	$PFHd = 1.4 * 10^{-8}$ $MTTFd = \frac{1}{8760 * PFHd} = 8154 \text{ Jahre}$	$DC_{\text{PES}} = 99\%$
Mains contactor	$B10d = 20 * 10^6$ $NOP = 20/\text{working days} = 3990/\text{year} (309 \text{ working days/year})$ $MTTFd = \frac{B10d}{0,1 * Nop} = 32362 \text{ Jahre}$	$DC_{\text{PES}} = 60\%$
$MTTFd\_A = \frac{1}{\frac{1}{MTTFd\_Türz.} + \frac{1}{MTTFd\_SinCos} + \frac{1}{MTTFd\_PES} + \frac{1}{MTTFd\_Netzs}} = 23 \text{ Jahre}$		

### Channel B – shutdown via STO/converter:

Component	MTTFd [years]	DC
Door locking	$B10d = 100000$ $Nop = 30/\text{working days} = 9270/\text{year} (309 \text{ working days/year})$ $MTTFd = \frac{B10d}{0,1 * Nop} = 108 \text{ Jahre}$	$DC_{\text{Switch}} = 99\%$
SIN/COS encoder	$MTTFd_{\text{SinCos}} = 30 \text{ years}$	$DC_{\text{Encoder}} = 99\%$
PES	$PFHd = 1.4 * 10^{-8}$ $MTTFd = \frac{1}{8760 * PFHd} = 8154$	$DC_{\text{PES}} = 99\%$
STO/converter	$MTTFd_{\text{STO}} = 150 \text{ years}$	$DC_{\text{PES}} = 90\%$
$MTTFd\_B = \frac{1}{\frac{1}{MTTFd\_Türz} + \frac{1}{MTTFd\_SinCos} + \frac{1}{MTTFd\_PES} + \frac{1}{MTTFd\_Netzs}} = 20 \text{ Jahre}$		

## Resulting PL for both channels:

Symmetrisation of both channels:	$MTTFd = \frac{2}{3} \left[ MTTFd\_A + MTTFd\_B - \frac{1}{\frac{1}{MTTFd\_A} + \frac{1}{MTTFd\_B}} \right] = 21,5 \text{ Jahre}$
DC average value	$DC_{avg} = \frac{\frac{DC_{Switch}}{MTTFd\_Türz} + \frac{DC_{SinCos}}{MTTFd\_SinCos} + \frac{DC_{PES}}{MTTFd\_PES} + \frac{DC_{Schütz}}{MTTFd\_Schütz} + \frac{DC_{STO}}{MTTFd\_STO}}{\frac{1}{MTTFd\_Türz} + \frac{1}{MTTFd\_SinCos} + \frac{1}{MTTFd\_PES} + \frac{1}{MTTFd\_Netzsch}}$ <p><math>DC_{avg} = 0,9776 \sim 98\%</math></p>
PL	<p>MTTFd = 21.5 years = medium              DC<sub>avg</sub> = 98 % = medium</p> <p>PL = "d" (from EN ISO 13849-1, Tables 5, 6 and 7)</p> <p>In this case the B10d value for the door monitoring is definitive for the PL. If a higher safety level is to be achieved, a correspondingly higher quality switch is to be used.</p>

### Note:

It is also possible to determine the PL using the tool "Sistema" from the BGIA, among others.

## 12.3.8 Verification of software (program) and parameters

### *The verification/validation is undertaken in two steps:*

- Check on the FUP in relation to the specified functionality
- Check on the FUP against the IL listing in the validation report, and the parameters specified against those in the validation report.

### 12.3.8.1 FUP check

The FUP actually programmed is to be checked against the requirements in the specification.


### Note:

The comparison is all the more efficient the clearer the programming has been structured in relation to the safety functions.

## Example:


### Safety function:

- Limitation of the max. travel speed of the running gear (FW) to 1.1 VMax
- Monitoring of the maximum speed for < 1.1 VMax
- Monitoring "FW Max Speed" is continuously activated and triggers if a speed of 550 rpm is exceeded.

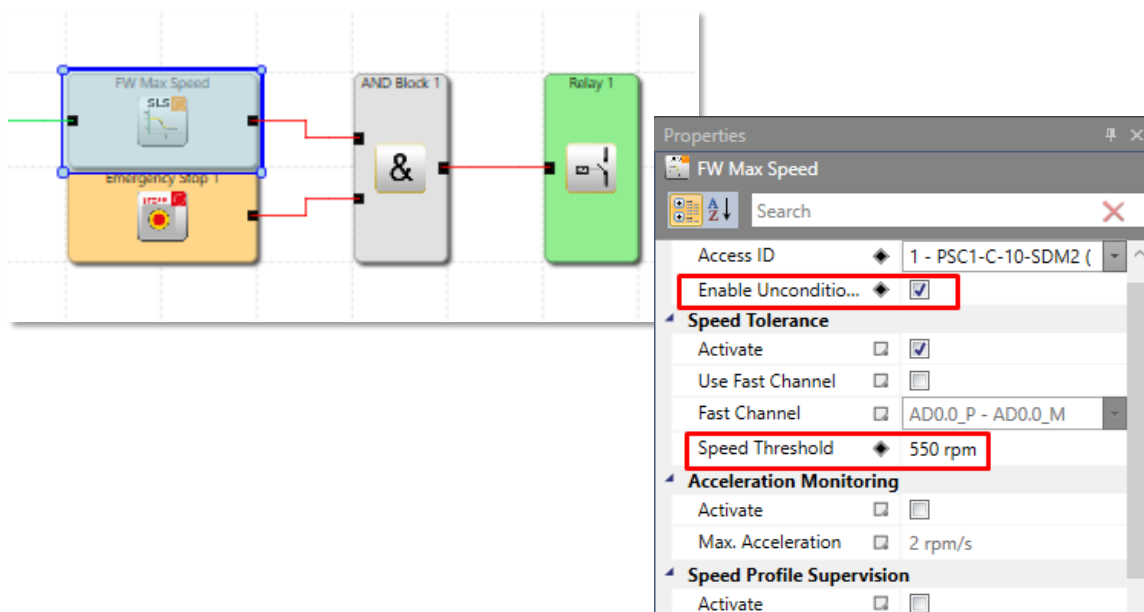

### Safety function:

- Limitation of the max. travel speed of the running gear (FW) in the worker's area
- Monitoring of the maximum speed for < 60 mm/s
- Safe Speed" monitoring is activated when the running gear is in the "WorkerArea", "Setup" has not been activated and the maximum speed is exceeded.

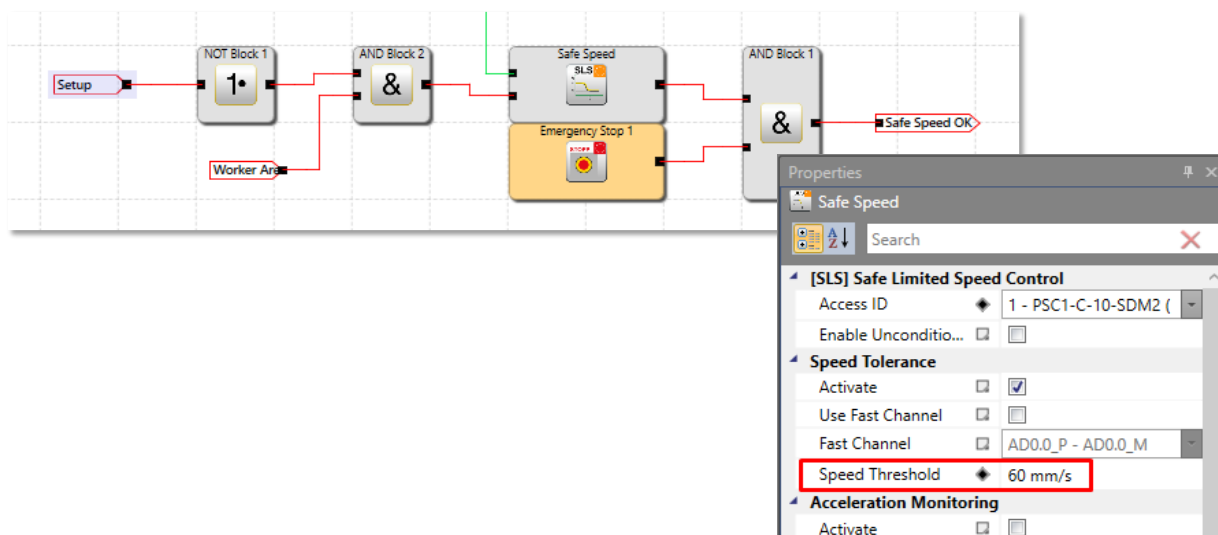

## 12.3.8.2 Validating FUP against IL and parameters using validation report

The programming in the FUP is to be compared with the IL listing in the validation report.

### Example IL listing in the validation report

Validation report					
PLC program					
Index	Command	Operand			Validated
1	NO1	SLI_EN.1			
2	NO1	SLI_EN.2			
3	NO1	SLI_EN.3			
4	NO1	SCA_EN.1			
5	NO1	SCA_EN.2			
6	NO1	SCA_EN.3			
7	NO1	SLS_EN.2			
8	NO1	SCA_EN.4			
9	NO1	SLS_EN.3			
10	NO1	SLS_EN.4			
11	NO1	SLI_EN.5			
12	SQH				
13	LD	I0.00			
14	ST	MX.2			
15	SQC				
16	SQH				
17	LD	I0.02			
18	AND	I0.03			
19	ST	MX.3			
20	SQC				

A stepwise check is recommended. The check is all the more efficient the more the programming in the FUP has been structured.

After checking the program, the parameters are to be checked against the parameters in the specifications by comparing.

## Example SLS:

Validation report				
Safely Limited Speed (SLS)				
Index	Parameter	Value		Validated
SLS - 1	Selected axis:	1		
	Speed threshold:	200	0	
SLS - 2	Selected axis:	1		
	Speed threshold:	500	0	
SLS - 3	Selected axis:	1		
	Speed threshold:	100	0	
	Acceleration threshold:	2	0	
SLS - 4	Selected axis:	1		
	Speed threshold:	50	0	
	SSX ramp assigned:	1		

## Example encoder configuration:

Validation report				
Axis configuration / sensor interface				
Axis 1				
General parameters				
Measurement length:	500	0		
Type:	Rotary			
Position processing:	Active			
Maximum speed:	2000	0		
Switch off position:	10	0		
Shutdown speed:	100	0		
Sensors	1		2	
Type:	SSI standard		SSI standard	
Format:	Binary		Binary	
Count direction:	high		high	
Voltage supply:	24V		24V	
Resolution:	1024	Steps/1000 mm	64	Steps/1000 mm
Offset:	0	Steps	0	Steps

	General parameters correctly configured		
	Parameters sensor 1 correct		
	Parameters sensor 2 correct		

## 12.3.9 Performance of system tests / FIT test (Fault Injection Test)

For the FIT test the manufacturer must prepare a complete list of functions to be tested. This list includes the safety functions defined as well as fault tests for checking the correct response of the SRP/CS to these faults.

### Example test list:

No.	Setup	Test	Result
1 Test SLS for max. speed setting up mode			
	Activate setting up mode Movement with max. permitted speed	<ul style="list-style-type: none"> <li>Diagnostics on the actual speed versus SLS limit</li> <li>Tamper with the setting up speed so it is above permitted limited speed</li> </ul>	
2 Test SSX for stop category 2			
	Movement with max. speed Actuate EMERGENCY STOP	<ul style="list-style-type: none"> <li>Diagnostics on the SSX ramp against the actual deceleration ramp</li> <li>Set an inadmissibly slow deceleration</li> <li>Move the axis after reaching standstill by tampering with the drive</li> </ul>	
3 Test on the 2-channel door monitoring			
	Select setting up mode operating mode	<ul style="list-style-type: none"> <li>Diagnostics on the inactive monitoring with door closed (by means of diagnostic function FUP)</li> <li>Diagnostics on the active monitoring with door open (by means of diagnostic function FUP)</li> <li>Disconnect a channel and open the door</li> <li>Generate cross-circuit between the two inputs</li> </ul>	

## 13 Appendix

### 13.1 Appendix A – categorisation of the switch types

#### General note:

The individual switches for the following input elements can be assigned as required to the digital inputs I0 to I13.

#### *Enable switch*

Switch type	Remark	PL categorisation acc. To EN ISO 13849-1	SIL categorisation acc. EN 61508
1 normally closed contact	Simple enable switch	PL d	SIL 2
1 normally open contact	Simple enable switch	PL d	SIL 2
2 normally closed contact	Enable switch for increased requirement	PL e	SIL 3
2 normally closed contacts time monitoring	Monitored enable switch	PL e	SIL 3

#### *Emergency stop*

Switch type	Remark	Category categorisation	SIL categorisation
1 normally closed contact	EMERGENCY STOP simple	PL d <sup>(1)</sup>	SIL 2
2 normally closed contact	EMERGENCY STOP for increased requirement	PL e	SIL 3
2 normally closed contacts time monitoring	EMERGENCY STOP monitored	PL e	SIL 3

<sup>(1)</sup> Fault exclusions and conditions according to EN ISO 13849-2 are to be observed!

#### *Door monitoring*

Switch type	Remark	Category categorisation	SIL categorisation
2 normally closed contact	Door monitoring for increased requirement	PL e	SIL 3
2 normally closed contacts time monitoring	Monitored door monitoring	PL e	SIL 3
1 normally open contact + 1 normally closed contact	Door monitoring for increased requirement	PL e	SIL 3
1 normally open contact + 1 normally closed contact time monitored	Monitored door monitoring	PL e	SIL 3
2 normally open contact + 2 normally closed contact	Door monitoring for increased requirement	PL e	SIL 3

2 normally open contact + 2 normally closed contact time monitored	Monitored door monitoring	PL e	SIL 3
3 normally closed contact	Door monitoring for increased requirement	PL e	SIL 3
3 normally closed contacts time monitored	Monitored door monitoring	PL e	SIL 3

## **Two-handed operation**

Switch type	Remark	Category categorisation	SIL categorisation
2 change-over contacts	Two-hand button for increased requirement	Type III C PL e	SIL3
2 normally open contacts	Monitored two-hand button	Type III A PL c	SIL1

## **Note:**

On these input elements there is a fixed pulse assignment that the user cannot change!

## **Light curtain**

Switch type	Remark	Category categorisation	SIL categorisation
2 normally closed contact	Light curtain for increased requirement	PL e	SIL 3
2 normally closed contacts time monitoring	Monitored light curtain	PL e	SIL 3
1 normally open contact + 1 normally closed contact	Light curtain for increased requirement	PL e	SIL 3
1 normally open contact + 1 normally closed contact time monitored	Monitored light curtain	PL e	SIL 3

## **Operating mode selector switch**

Switch type	Remark	Category categorisation	SIL categorisation
2 positions	Monitored operating mode selector switch	PL e	SIL 3
3 positions	Monitored operating mode selector switch	PL e	SIL 3



## **Safety instructions:**

- On a state change on the switch, it is to be ensured by the SafePLC2 program to be written that the outputs on the module are deactivated

## Sensor

Switch type	Remark	Category categorisation	SIL categorisation
1 normally closed contact	Simple sensor input	PL d	SIL 2
1 normally open contact	Simple sensor input	PL d	SIL 2
2 normally closed contact	Sensor input for increased requirement	PL e	SIL 3
2 normally closed contacts time monitoring	Monitored sensor input	PL e	SIL 3
1 normally open contact + 1 normally closed contact	Sensor input for increased requirement	PL e	SIL 3
1 normally open contact + 1 normally closed contact time monitored	Monitored sensor input	PL e	SIL 3

## Start / Reset

Switch type	Remark	Category categorisation	SIL categorisation
1 normally open contact	Simple alarm reset (edge evaluation)	--	--
1 normally open contact	Simple logic reset	PL d	SIL 2
1 normally open contact	Simple start monitoring (special function)	--	--

### Note:


The alarm reset input can be operated with a continuous voltage of 24 V and is edge controlled.

## 13.2 CE – declaration of conformity

### EU Declaration of Conformity



Original	K.A. Schmersal GmbH & Co. KG Möddinghofe 30 42279 Wuppertal Germany Internet: <a href="http://www.schmersal.com">www.schmersal.com</a>						
<b>Declaration:</b>	We hereby certify that the hereafter described components both in their basic design and construction conform to the applicable European Directives.						
<b>Name of the component:</b>	PSC1						
<b>Type:</b>	See ordering code						
<b>Description of the component:</b>	Safety compact controller, with or without drive monitoring; IO expansion module, with or without relay expansion						
<b>Relevant Directives:</b>	<table><tbody><tr><td>Machinery Directive</td><td>2006/42/EC</td></tr><tr><td>EMC-Directive</td><td>2014/30/EU</td></tr><tr><td>RoHS-Directive</td><td>2011/65/EU</td></tr></tbody></table>	Machinery Directive	2006/42/EC	EMC-Directive	2014/30/EU	RoHS-Directive	2011/65/EU
Machinery Directive	2006/42/EC						
EMC-Directive	2014/30/EU						
RoHS-Directive	2011/65/EU						
<b>Applied standards:</b>	EN 61800-5-2:2017 EN ISO 13849-1:2015 EN 61508 parts 1-7:2010 EN 62061:2005 + AC:2010 + A1:2013 + A2:2015						
<b>Notified body for the prototype test:</b>	TÜV Rheinland Industrie Service GmbH Am Grauen Stein, 51105 Köln ID n°: 0035						
<b>EC-prototype test certificate:</b>	01/205/5526.01/21						
<b>Person authorised for the compilation of the technical documentation:</b>	Oliver Wacker Möddinghofe 30 42279 Wuppertal						
<b>Ort und Datum der Ausstellung:</b>	Wuppertal, August 25, 2023						

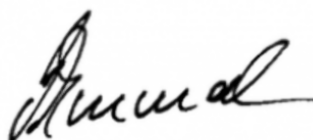

Authorised signature  
**Philip Schmersal**  
Managing Director