prosense®

AUTOMATIONDIRECT.com

SCU-1600

Universal
Transmitter

User Manual

UNIVERSAL TRANSMITTER

SCU-1600

CONTENTS

WARNING

This device is designed for connection to hazardous electric voltages.

Ignoring this warning can result in severe personal injury or mechanical damage.

To avoid the risk of electric shock and fire, the safety instructions of this manual must be observed and the guidelines followed.

The specifications must not be exceeded, and the device must only be applied as described in the following.

Prior to the commissioning of the device, this manual must be examined carefully.

Only qualified personnel (technicians) should install this device.

If the equipment is used in a manner not specified by the manufacturer, the protection provided by the equipment may be impaired.

GENERAL

WARNING

Until the device is fixed, do not connect hazardous voltages to the device.

The following operations should only be carried out on a disconnected device and under ESD safe conditions:

General mounting, connection and disconnection of wires.

Troubleshooting the device.

HAZARDOUS VOLTAGE

WARNING

The SCU-PDM2 is NOT approved for use in Hazardous Locations.

WARNING

To keep the safety distances, the relay contacts on the device must not be connected to both hazardous and non-hazardous voltages at the same time.

SCU-1600 must be mounted on a DIN rail according to DIN 46277.

INSTALLATION

WARNING

Do not open the front plate of the device as this will cause damage to the connector for the display / programming front SCU-PDM1 or SCU-PDM2. This device contains no DIP-switches or jumpers.

SYMBOL IDENTIFICATION

⚠ **Triangle with an exclamation mark:** Warning / demand. Potentially lethal situations.

$C\mathcal{E}$ **The CE mark** proves the compliance of the device with the essential requirements of the directives.

▣ **The double insulation symbol** shows that the device is protected by double or reinforced insulation.

SAFETY INSTRUCTIONS

DEFINITIONS
Hazardous voltages have been defined as the ranges: 75 to 1500 Volt DC, and 50 to 1000 Volt AC.
Technicians are qualified persons educated or trained to mount, operate, and also troubleshoot technically correct and in accordance with safety regulations.
Operators, being familiar with the contents of this manual, adjust and operate the knobs or potentiometers during normal operation.

RECEIPT AND UNPACKING
Unpack the device without damaging it. The packing should always follow the device until this has been permanently mounted.
Check at the receipt of the device whether the type corresponds to the one ordered.

ENVIRONMENT
Avoid direct sunlight, dust, high temperatures, mechanical vibrations and shock, as well as rain and heavy moisture. If necessary, heating in excess of the stated limits for ambient temperatures should be avoided by way of ventilation.
All devices fall under Installation Category II, Pollution Degree 1, and Insulation Class II.

MOUNTING
Only technicians who are familiar with the technical terms, warnings, and instructions in the manual and who are able to follow these should connect the device. Should there be any doubt as to the correct handling of the device, please contact:

www.automationdirect.com

Mounting and connection of the device should comply with national legislation for mounting of electric materials, i.e. wire cross section, protective fuse, and location. Descriptions of input / output and supply connections are shown in the block diagram and side label.

The following apply to fixed hazardous voltages-connected devices:
The max. size of the protective fuse is 10 A and, together with a power switch, it should be easily accessible and close to the device. The power switch should be marked with a label indicating that it will switch off the voltage to the device.

Year of manufacture can be taken from the first two digits in the serial number.

UL INSTALLATION REQUIREMENTS
Use 60/75°C copper conducters only
For use only in pollution degree 2 or better
Max. ambient temperature .... 60°C
Max. wire size... AWG 26-14
UL file number E191072

CALIBRATION AND ADJUSTMENT
During calibration and adjustment, the measuring and connection of external voltages must be carried out according to the specifications of this manual. The technician must use tools and instruments that are safe to use.

NORMAL OPERATION
Operators are only allowed to adjust and operate devices that are safely fixed in panels, etc., thus avoiding the danger of personal injury and damage. This means there is no electrical shock hazard, and the device is easily accessible.

CLEANING
When disconnected, the device may be cleaned with a cloth moistened with distilled water.

HOW TO DETACH SCU-1600

First, remember to detach the connectors with hazardous voltages.
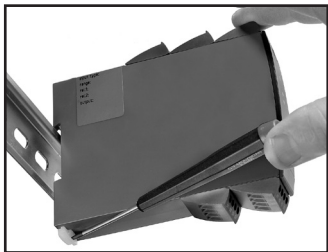
Picture 1:
Detach the device from the DIN rail by lifting the bottom lock.

When front LED lights red / display shows AO.ER

SCU-1600 is designed as a SIL 2 device with a high safety level. Therefore, a continuous measurement of the outgoing current is carried out on a 4...20 mA and 20...4 mA output signal. If the current output signal is different from the internal calculated output value or the current output is 0 (due to e.g. an open circuit breakage), an error mode switches on the red front LED and disables the relays. This function is not a default option but must be actively selected via the programming menu (S4-20 & S20-4).

The error mode can only be reset by switching off and then switching on the supply voltage to the device.

UNIVERSAL TRANSMITTER
SCU-1600

- *Input for RTD, TC, Ohm, potentiometer, mA and V*
- *2-wire supply > 16 V*
- *FM-approved for installation in Div. 2*
- *Output for current, voltage and 2 relays*
- *Universal AC or DC supply*

Advanced features

- Programmable via detachable display front (SCU-PDM1 or SCU-PDM2), process calibration, signal and relay simulation, password protection, error diagnostics and selection of help text in several languages.

Application

- Linearised, electronic temperature measurement with RTD or TC sensor.
- Conversion of linear resistance variation to a standard analogue current / voltage signal, i.e. from solenoids and butterfly valves or linear movements with attached potentiometer.
- Power supply and signal isolator for 2-wire transmitters.
- Process control with 2 pairs of potential-free relay contacts and analogue output.
- Galvanic separation of analogue signals and measurement of floating signals.
- The SCU-1600 is designed according to strict safety requirements and is thus suitable for application in SIL 2 installations.

Technical characteristics

- When SCU-1600 is used in combination with the SCU-PDM1 or SCU-PDM2 display / programming front, all operational parameters can be modified to suit any application. As the SCU-1600 is designed with electronic hardware switches, it is not necessary to open the device for setting of DIP switches.
- A green / red front LED indicates normal operation and malfunction. A yellow LED is ON for each active output relay.
- Continuous check of vital stored data for safety reasons.
- 4-port 2.3 kVAC galvanic isolation.

SCU-PDM1 OR SCU-PDM2 DISPLAY / PROGRAMMING FRONT

SCU-PDM1   SCU-PDM2

Functionality

The simple and easily understandable menu structure and the explanatory help texts guide you effortlessly and automatically through the configuration steps, thus making the product very easy to use. Functions and configuration options are described in the section "Configuration / operating the function keys". SCU-PDM2 may vary slightly in appearance.

Application
- Communications interface for modification of operational parameters in SCU-1600.
- Can be moved from one SCU-1600 device to another and download the configuration of the first transmitter to subsequent transmitters.
- Fixed display for readout of process data and status.

Technical characteristics
- SCU-PDM1 LCD display with 4 lines; Line 1 (H=5.57 mm) shows input signal, line 2 (H=3.33 mm) shows units, line 3 (H=3.33 mm) shows analogue output or tag no. and line 4 shows communication status.
- SCU-PDM2 LCD display with 4 lines; Line 1 (H=5mm) shows input signal, line 2 (H=3.5 mm) shows units, line 3 (H=3.35 mm) shows analogue output or tag no. and line 4 shows communication status.
- Programming access can be blocked by assigning a password. The password is saved in the transmitter in order to ensure a high degree of protection against unauthorised modifications to the configuration.

Mounting / installation
- Click SCU-PDM1 or SCU-PDM2 onto the front of SCU-1600.

MOUNTING / DEMOUNTING THE SCU-PDM1 OR SCU-PDM2

1: Insert the taps of SCU-PDM1 or SCU-PDM2 into the holes at the top of the device.

2: Swing SCU-PDM1 or SCU-PDM2 into place.

Demounting of SCU-PDM1 or SCU-PDM2

3: Push the release button on the bottom of SCU-PDM1 or SCU-PDM2 and swing SCU-PDM1 or SCU-PDM2 up.

Note: Can be installed or removed whether the signal conditioner is powered or not.

WARNING

The SCU-PDM2 is NOT approved for use in Hazardous Locations.
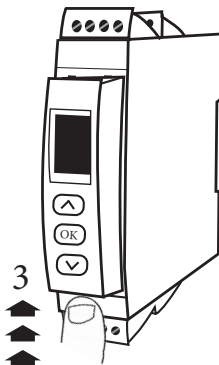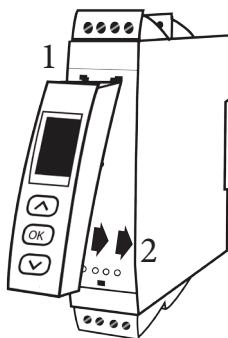
APPLICATIONS

Input signals:

Current | Volt-age | Potentio-meter | RTD and lin.R | TC

44
43
42
41
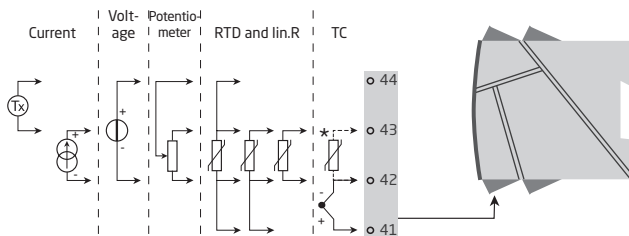
*Order separately: SCU-CJC1 Optional External CJC connector. See the connection drawing on page 16.

Output signals:

Relays

12
14
13
11

mA
10 V
10 V
1 V
1 V

24
23
22
21

Analogue, 0/4...20 mA and voltage

Supply:

21.6...253 VAC
or
19.2...300 VDC

33
32
31
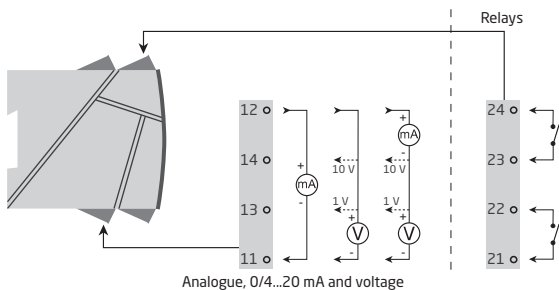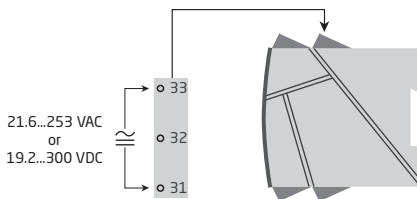
Part Numbers

SCU-1600 = Universal transmitter
SCU-PDM1 or SCU-PDM2 = Display / programming front
SCU-CJC1 = Optional External CJC connector

Electrical specifications

Environmental conditions

Specifications range	-20°C...60°C (-4°F...140°F)
Calibration temperature	20...28°C (68°F...82.4°F)
Relative humidity	< 95% RH (non-cond.)
Protection degree	IP20

Mechanical specifications

Dimensions (HxWxD)	109 x 23.5 x 104 mm
	(4.3 x 0.9 x 4.1 in)

Dimensions, with SCU-PDM1 or SCU-PDM2 (HxWxD)
109 x 23.5 x 116 / 131 mm (SCU-PDM1) or 144 mm (SCU-PDM2)
[4.3 x 0.9 x 4.6 / 5.2 in (SCU-PDM1) or 5.67 in (SCU-PDM2)]

Weight	170 g
Weight with SCU-PDM1 or SCU-PDM2	185 g / 270 g
Max. wire size	1 x 2.5 mm^2 (14 AWG) stranded wire
Screw terminal torque	0.5 Nm (0.37 ft lb)
Vibration	IEC 60068-2-6 : 2007
2...13.2 Hz	±1 mm
13.2...100 Hz	±0.7 g

Common specifications

Supply voltage, universal	21.6...253 VAC, 50...60 Hz
	or 19.2...300 VDC
Max. consumption	≤ 2.5 W
Fuse	400 mA SB / 250 VAC
Isolation voltage, test / operation	2.3 kVAC / 250 VAC
Communications interface	Programming /display module, SCU-

PDM2 (sold separately) or SCU-PDM1 (discontinued and replaced by SCU-PDM2)

Signal / noise ratio	Min. 60 dB (0...100 kHz)

Response time (0...90%, 100...10%):

Temperature input	≤ 1 s
mA / V input	≤ 400 ms

Accuracy, the greater of the general and basic values:

General values		
Input type	Absolute accuracy	Temperature coefficient
All	≤ ±0.1% of span	≤ ±0.01% of span / °C

Basic values		
Input type	Basic accuracy	Temperature coefficient
mA	$\leq \pm4$ µA	$\leq \pm0.4$ µA / °C
Volt	$\leq \pm20$ µV	$\leq \pm2$ µV / °C
Pt100	$\leq \pm0.2$°C	$\leq \pm0.01$°C / °C
Linear resistance	$\leq \pm0.1$ Ω	$\leq \pm0.01$ Ω / °C
Potentiometer	$\leq \pm0.1$ Ω	$\leq \pm0.01$ Ω / °C
TC type: E, J, K, L, N, T, U	$\leq \pm1$°C	$\leq \pm0.05$°C / °C
TC type: R, S, W3, W5, LR	$\leq \pm2$°C	$\leq \pm0.2$°C / °C
TC type: B 85...200°C	$\leq \pm4$°C	$\leq \pm0.4$°C / °C
TC type: B 200...1820°C	$\leq \pm2$°C	$\leq \pm0.2$°C / °C

EMC immunity influence	< ±0.5% of span
Extended EMC immunity:	
NAMUR NE 21, A criterion, burst	< ±1% of span

Auxiliary supplies:
2-wire supply (terminal 44...43)........................ 25...16 VDC / 0...20 mA

RTD, linear resistance and potentiometer input

Input for RTD types:
Pt10, Pt20, Pt50, Pt100, Pt200, PT250, Pt300, Pt400, Pt500, Pt1000
Ni50, Ni100, Ni120, Ni1000, Cu10, Cu20, Cu50, Cu100

Input type	Min. value	Max. value	Standard
Pt10...Pt1000	-200°C	+850°C	IEC 60751
Ni50...Ni1000	-60°C	+250°C	DIN 43760
Cu10...Cu100	-200°C	+260°C	α = 0.00427
Lin. R	0 Ω	10000 Ω	-
Potentiometer	10 Ω	100 kΩ	-

Cable resistance per wire (max.), RTD............ 50 Ω
Sensor current, RTD... Nom. 0.2 mA
Effect of sensor cable resistance
(3- / 4-wire), RTD.. < 0.002 Ω / Ω
Sensor error detection, RTD................................ Yes
Short circuit detection, RTD .... < 15 Ω

TC input

Type	Min. value	Max. value	Standard
B	0°C	+1820°C	IEC 60584-1
E	-100°C	+1000°C	IEC 60584-1
J	-100°C	+1200°C	IEC 60584-1
K	-180°C	+1372°C	IEC 60584-1
L	-200°C	+900°C	DIN 43710
N	-180°C	+1300°C	IEC 60584-1
R	-50°C	+1760°C	IEC 60584-1
S	-50°C	+1760°C	IEC 60584-1
T	-200°C	+400°C	IEC 60584-1
U	-200°C	+600°C	DIN 43710
W3	0°C	+2300°C	ASTM E988-90
W5	0°C	+2300°C	ASTM E988-90
LR	-200°C	+800°C	GOST 3044-84

Cold junction compensation (CJC):
  via external sensor in connector SCU-CJC1   20...28°C ≤ ±1°C
                                            -20...20°C / 28...70°C ≤±2°C
  via internal CJC sensor .... ±(2.0°C + 0.4°C * Δt)
  Δt = internal temperature - ambient temperature
Sensor error detection, all TC types................ Yes
Sensor error current:
  when detecting .... Nom. 2 µA
  else .... 0 µA

Current input

Measurement range... 0...20 mA
Programmable measurement ranges............... 0...20 and 4...20 mA
Input resistance.. Nom. 20 Ω + PTC 50 Ω
Sensor error detection:
  Loop break 4...20 mA.. Yes

Voltage input

Measurement range... 0...12 VDC
Programmable measurement ranges............... 0...1 / 0.2...1 / 0...5 / 1...5 /
                                               0...10 and 2...10 VDC
Input resistance.. Nom. 10 MΩ

Current output

Signal range (span)	0...20 mA
Programmable signal ranges	0...20 / 4...20 / 20...0 and 20...4 mA
Load (max.)	20 mA / 800 Ω / 16 VDC
Load stability	$\leq 0.01\%$ of span / 100 Ω
Sensor error detection	0 / 3.5 / 23 mA / none
NAMUR NE 43 Upscale / Downscale	23 mA / 3.5 mA

Output limitation:

on 4...20 and 20...4 mA signals	3.8...20.5 mA
on 0...20 and 20...0 mA signals	0...20.5 mA
Current limit	≤ 28 mA

Voltage output

Signal range	0...10 VDC
Programmable signal ranges	0...1 / 0.2...1 / 0...10 / 0...5 / 1...5 / 2...10 / 1...0 / 1...0.2 / 5...0 / 5...1 / 10...0 og 10...2 V
Load (min.)	500 kΩ

Relay outputs

Relay functions	Setpoint, Window, Sensor error, Latch, Power and Off
Hysteresis	0...100%
On and Off delay	0...3600 s
Sensor error detection	Break / Make / Hold
Max. voltage	250 VRMS
Max. current	2 A / AC or 1 A / DC
Max. AC power	500 VA

I.S. approval

FM, applicable in	Class I, Div. 2, Group A, B, C, D Class I, Div. 2, Group IIC Zone 2 (when SCU-PDM2 is not

attached). The SCU-PDM2 is NOT approved for use in Hazardous Locations.

Max. ambient temperature for T5	60°C

Observed authority requirements	**Standard**
EMC 2004/108/EC	EN 61326-1
LVD 2006/95/EC	EN 61010-1
FM	3600, 3611, 3810 and ISA 61010-1
UL, Standard for Safety	UL 508

of span = of the currently selected measurement range

Visualization in the SCU-PDM1 or SCU-PDM2 of sensor error detection and input signal outside range

Sensor error check:		
Device:	Configuration	Sensor error detection:
SCU-1600	R1, ERR.ACT=NONE - R2, ERR.ACT=NONE, OUT.ERR=NONE.	OFF
	Else:	ON

Outside range readout (IN.LO, IN.HI): If the valid range of the A/D converter or the polynomial is exceeded			
Input	Range	Readout	Limit
VOLT	0...1 V / 0.2...1 V	IN.LO	< -25 mV
		IN.HI	> 1.2 V
	0...10 V / 2...10 V	IN.LO	< -25 mV
		IN.HI	> 12 V
CURR	0...20 mA / 4...20 mA	IN.LO	< -1.05 mA
		IN.HI	> 25.05 mA
LIN.R	0...800 Ω	IN.LO	< 0 Ω
		IN.HI	> 1075 Ω
	0...10 kΩ	IN.LO	< 0 Ω
		IN.HI	< 110 kΩ
POTM	-	IN.LO	< -0.5 %
		IN.HI	> 100.5 %
TEMP	TC / RTD	IN.LO	< temperature range -2℃
		IN.HI	> temperature range +2℃

Display readout below min.- / above max. (-1999, 9999):			
Input	Range	Readout	Limit
All	All	-1999	Display readout <-1999
		9999	Display readout >9999

Sensor error detection limits

Sensor error detection (SE.BR, SE.SH):			
Input	Range	Readout	Limit
CURR	Loop break (4..20 mA)	SE.BR	<= 3.6 mA; > = 21 mA
POTM	All, SE.BR on all 3-wire	SE.BR	> ca. 126 kΩ
LIN.R	0...800 Ω	SE.BR	> ca. 875 Ω
	0...10 kΩ	SE.BR	> ca. 11 kΩ
TEMP	TC	SE.BR	> ca. 750 kΩ / (1.25 V)
	RTD, 2-, 3-, and 4-wire No SE.SH for Cuxx, Pt10, Pt20 and Pt50	SE.BR	> ca. 15 kΩ
		SE.SH	< ca. 15 Ω

## Error indications

Readout at hardware error		
Error search	Readout	Error cause
Test of internal CJC sensor	CJ.ER	CJC sensor defect or temperature outside range
Checksum test of the configuration in FLASH	FL.ER	Error in FLASH
Check measurement of analog output current	AO.ER	1) No load on the current output (only S4...20/S20...4 mA)
Communications test SCU-PDM1 or SCU-PDM2 / SCU-1600	NO.CO	Connection error
Internal communication error	NO.OU	Output controller error
Check that input signal matches input configuration	IN.ER	1) Error levels on input
Check that saved configuration in SCU-PDM1 or SCU-PDM2 matches device	TY.ER	Configuration is not SCU-1600

! Error indications in the display flash once per second. The help text explains the error.
1) The error is reset by switching off and then switching on the supply voltage to the device.

CONNECTIONS

Supply:

Inputs:

RTD, 2-wire

RTD, 3- / 4-wire

TC, internal CJC sensor

Resistance, 2-wire

Resistance, 3- / 4-wire

Potentiometer

2-wire transmitter

Current

Voltage

*TC, CJC connector

* Order separately:
  Optional External CJC connector
  SCU-CJC1

Outputs:

Current

Voltage, 1 V

Voltage, 10 V
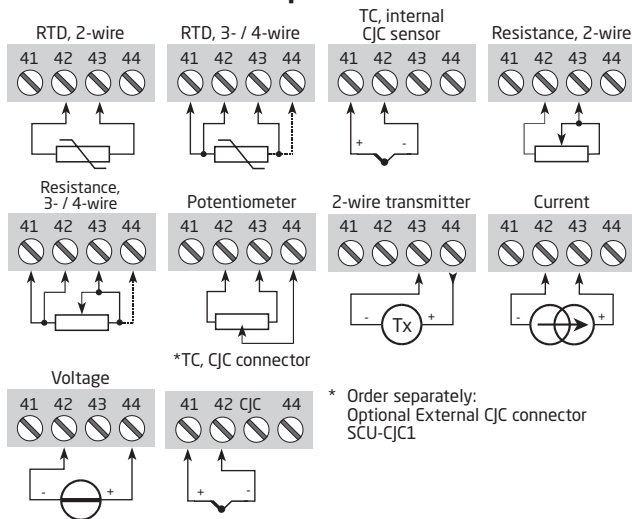
Relays

BLOCK DIAGRAM

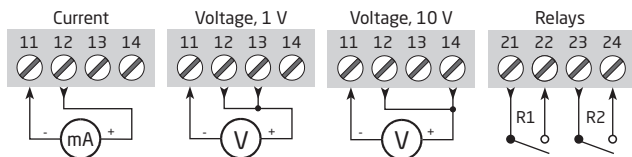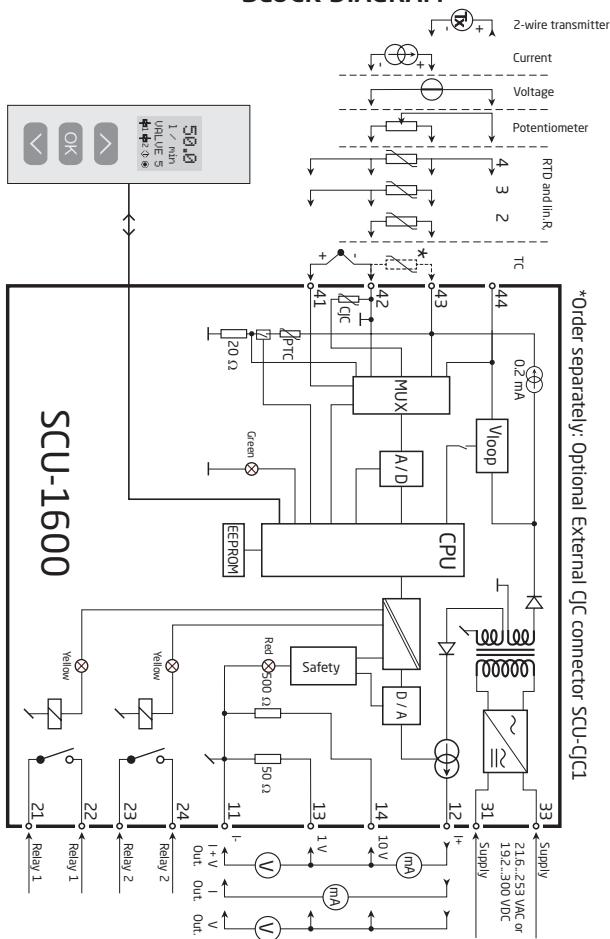# CONFIGURATION /
OPERATING THE FUNCTION KEYS

Documentation for routing diagram.

In general

When configuring the SCU-1600, you will be guided through all parameters and you can choose the settings which fit the application. For each menu there is a scrolling help text which is automatically shown in line 3 on the display.

Configuration is carried out by use of the 3 function keys:

- $\wedge$ will increase the numerical value or choose the next parameter
- $\vee$ will decrease the numerical value or choose the previous parameter
- ⓞⓚ   will accept the chosen value and proceed to the next menu

When configuration is completed, the display will return to the default state 1.0.

Pressing and holding ⓞⓚ will return to the previous menu or return to the default state (1.0) without saving the changed values or parameters.

If no key is activated for 1 minute, the display will return to the default state (1.0) without saving the changed values or parameters.

Further explanations

Fast setpoint adjustment and relay test: These menus allow you to make a quick setpoint change and relay test when the FastSet menu is activated. This function can only be activated when the relays are set for setpoint function and are controlled by a setpoint.

Pressing $\wedge$ and $\vee$ simultaneously will activate a relay test and change the state of the relay.

Pressing ⓞⓚ will save the setpoint change.

Holding down ⓞⓚ for more than 1 second will return the unit to the default state without saving the setpoint change.

Password protection: Programming access can be blocked by assigning a password. The password is saved in the transmitter in order to ensure a high degree of protection against unauthorized modifications to the configuration.

Signal and sensor error info via display front SCU-PDM1 or SCU-PDM2

Sensor error (see limits in the table) is displayed as SE.BR (sensor break) or SE.SH
 (sensor short). Signals outside the selected range (not sensor error, see table
 for limits) are displayed as IN.LO indicating low input signal or IN.HI indicating
 high input signal. The error indication is displayed in line 3 as text and at the
 same time the backlight flashes. Line 4 of the display is a status line which
 displays status of relay 1 and relay 2, COM (flashing bullet) indicating correct
 functioning of SCU-PDM1 or SCU-PDM2 and arrow up/down which indicates
 tendency readout of the input signal. If the figure 1 or figure 2 flashes, the unit
 has detected that the setpoint has been exceeded and that the relay is in "delay"
 mode. When the delay time has passed and the relay makes/breaks, the relay
 sign either displays or disappears.

Signal and sensor error indication without display front

Status of the unit can also be read from the red/green LED in the front of the device.
 Green flashing LED 13 Hz indicates normal operation.
 Green flashing LED 1 Hz indicates sensor error.
 Steady red LED indicates internal error.

Relay functions

6 different settings of relay function can be selected.

Setpoint:	The unit works as a single limit switch
Window:	The relay has a window that is defined by a low and a high setpoint. On both sides of the window the relay has the same status.
Error function:	The relay is activated by sensor error.
Power:	The relay is activated as long as the power is on.
Off:	The relay is deactivated.
Latch:	The relay is latched. Only valid for setpoint and window function.

Increasing/decreasing: The relays can be set to activate at increasing or
 decreasing input signal.

Delay: An ON and an OFF delay can be set on both relays in the range
 0...3600 s.

Hysteresis: 0.0...100.0%.

Latch

When the setpoint is exceeded the relay outputs enters an alarm state. The latch function of the SCU-1600 will hold the relays in this state until the function is deactivated manually. The latch function can be applied when the relay function setpoint or window is selected.

The latch function can be selected separately for each relay output. If the configuration is copied from one device to another by way of the SCU-PDM1 or SCU-PDM2, the latch function must be reconfigured.

The latch function activates and holds the relays when the input signal rises above or falls below the selected setpoints and the relay action has been selected as increasing or decreasing.

The window function is selected by choosing "window" in the menu and defining a high and a low setpoint.

It can be selected for each relay contact whether the contact is open or closed inside the window. This selection is made in the menu R1.cont and R2.cont.

The setpoint function is selected by choosing "setpoint" in the menu and entering the desired limit. The device then works as a single limit switch.

An activated relay means that the contact is closed if the contact function "normally open" is selected, and the contact is open if the contact function "normally closed" is selected.

The delay time for activation and deactivation can be set independently of each other in the menus ON.DEL and OFF DEL respectively.

If the relay function "Error" is active, the relay will latch when a sensor error occurs and will not be deactivated automatically when the sensor error is rectified.

The relay can only be deactivated by an operator and only when the normal conditions for deactivation are met. If the input signal still has a value that will activate the relay, the relay will latch again.

See the graphic depiction of the setpoint and window functions on pages 32 and 33.

Manual deactivation of the latch function

If the relay outputs are activated and thereby latched, it will be indicated in the display. The backlight flashes and the scrolling help text tells you how to deactivate the output. Manual deactivation is carried out by way of the front buttons on the SCU-PDM1 or SCU-PDM2. Use ⌃ and ⌄ to navigate in the menu and ⓞⓚ to validate your selection. If the password protection has been activated, the password must be entered in order to access the deactivation menu. See the menu structure on page 29.

Advanced functions

The device gives access to a number of advanced functions which can be reached by answering "Yes" to the point "adv.set".

Display setup: Here you can adjust the brightness contrast and the backlight. Setup of TAG numbers with 6 alphanumerics. Selection of functional readout in line 3 of the display - choose between readout of analogue output or tag no.

Two-point process calibration: The device can be process-calibrated in 2 points to fit a given input signal . A low input signal (not necessarily 0%) is applied and the actual value is entered via SCU-PDM1 or SCU-PDM2. Then a high signal (not necessarily 100%) is applied and the actual value is entered via SCU-PDM1 or SCU-PDM2. If you accept to use the calibration, the device will work according to this new adjustment. If you later reject this menu point or choose another type of input signal the device will return to factory calibration.

Process simulation function: If you agree to the point "EN.SIM" it is possible to simulate an input signal by means of the arrow keys and thus control the output signal up or down. When you finalize the point with ⓞⓚ, the device returns to normal mode. The following point allows you to activate relay 1 and relay 2 by means of the arrow-keys up/down. You must exit the menu by pressing ⓞⓚ (no time-out).

Password: Here you can choose a password between 0000 and 9999 in order to protect the device against unauthorized modifications to the configuration. The device is delivered default without password.

Language: In the menu "lang.setup" you can choose between 7 different language versions of help texts that will appear in the menu. You can choose between UK, DE, FR, IT, ES, SE and DK.

Auto diagnosis

The device performs an advanced auto diagnosis of the internal circuits.

The following possible errors can by displayed in the front unit SCU-PDM1 or SCU-PDM2.

CJ.ER -   CJC sensor defect or CJC temperature outside range

FL.ER -   Flash error

AO.ER -   No load on the current output (only for S4...20 mA / S20...4 mA)

NO.CO -   Connection error

IN.ER -   Error levels on input

TY.ER -   Configuration in SCU-PDM1 or SCU-PDM2 does not match this product type

Selection of units

After choosing the input signal type you can choose which process units should be displayed in text line 2 (see table). By selection of temperature input the process value is always displayed in Celsius or Fahrenheit. This is selected in the menu point after selection of temperature input.

Safety readback

When the device is delivered with default configuration, the SIL function is disabled. The safety readback function (loop surveillance) can be selected in the menu O.RANGE, thus enabling the device to run in SIL mode. In order to enable the SIL functionality, the menu item S4...20 mA must be selected. Please note, however, that when safety readback is enabled, a sensor error will be indicated as an error on the analog output signal.

CJC

In the CJC menu you can choose between CJC connector and internal cold junction compensation. The CJC connecter (SCU-CJC1) must be ordered separately.

Memory

In the memory menu you can save the configuration of the device in the SCU-PDM1 or SCU-PDM2, and then move the SCU-PDM1 or SCU-PDM2 onto another device of the same type and download the configuration in the new device.

Power up

Fast setpoint adjustment and relay test
- ⊙ Increase setpoint
- ⊙ Decrease setpoint
- ⊙ Save and exit the menu
- ⊙ and ⊙ simultaneously = change relay state

1.2

50.0
RELAY1
Txt 57

75.0
RELAY2
Txt 57

50.0
%
12.0
1.0

1.1

0000
9999
0000
PASSW.
Txt 1

NO
YES
NO
ADV.SET
Txt 2

VOLT
CURR
POTM
LIN.R
TEMP
VOLT
IN TYPE
Txt 3

2-10
0-10
1-5
0-5
0.2-1
0-1
2-10
V.RANGE
Txt 4

°C
mA
rpm
(69 units)
UNIT
%
Txt 11

1111
111.1
11.11
1.111
111.1
DEC.P
Txt 12

999.9
-199.9
0.0
DISP.LO
Txt 13

CURR
IN TYPE
Txt 3

0-20 4-20
4-20
I.RANGE
Txt 5

POTM
IN TYPE
Txt 3

LIN.R
IN TYPE
Txt 3

2W 3W 4W
3W
CONNEC.
Txt 6

0...9999
0
R 0%
Txt 7

0...9999
2500
R 100%
Txt 8

TEMP
IN TYPE
Txt 3

Cu Pt Ni TC
Pt
SENSOR
Txt 10

10...1000
100
Pt TYPE
Txt 16

2W 3W 4W
3W
CONNEC.
Txt 6

50...1000
Ni
SENSOR
Txt 10

100
Ni TYPE
Txt 17

2W 3W 4W
3W
CONNEC.
Txt 6

TC.B TC.E TC.J TC.K TC.L
TC.N TC.R TC.S TC.T TC.U
TC.W3 TC.W5 TC.Lr
TC
SENSOR
Txt 10

TC.K
TC.TYPE
Txt 18

INT
CJC
Txt 63

10...100
Cu
SENSOR
Txt 10

10
Cu TYPE
Txt 69

2W 3W 4W
3W
CONNEC.
Txt 6

YES
ADV.SET
Txt 2

Continued on the page Routing diagram ADV.SET

1.0 = Default state Line 1 shows input signal. Line 2 shows UNIT. By pressing ⊙ and ⊙ simultaneously line 3 alternates between A.Out and TAG. Line 4 shows relay and communication status.
1.1 = Only if password-protected.
1.2 = Only if FastSet is activated and the relay function is setpoint.
1.3 = Not valid for these input signals: 0...20 mA and voltage.
1.4 = Only if input signal is temperaure.
1.5 = The relay can only be deactivated by an operator and only if the normal conditions for deactivation are met. If the input signal still has a value that will activate the relay, the relay will latch again.
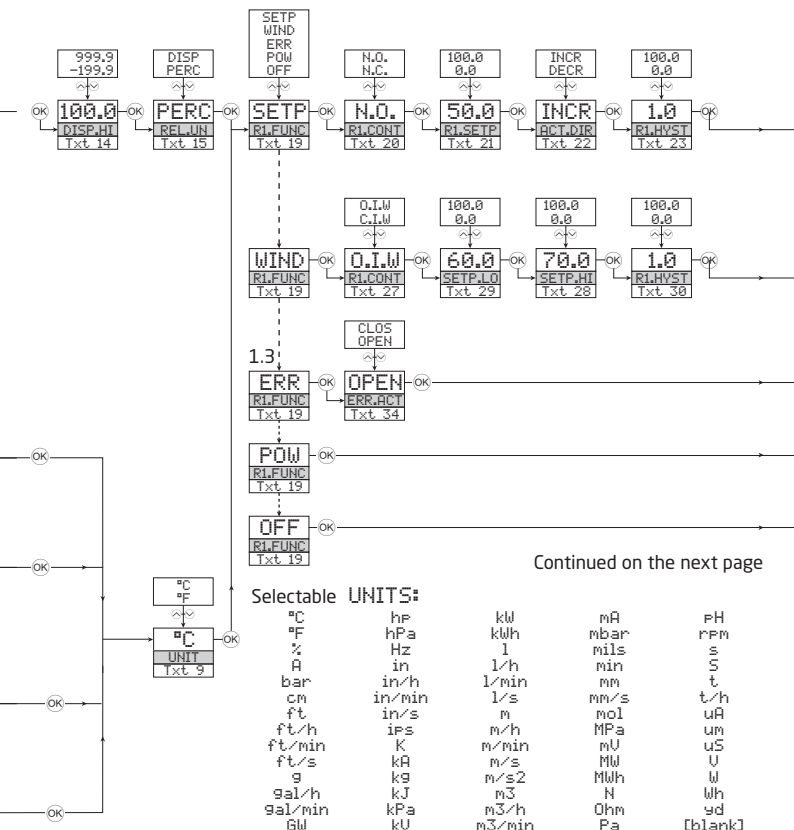
ROUTING DIAGRAM

If no key is activated for 1 minute, the display will return to the default state 1.0 without saving configuration changes.
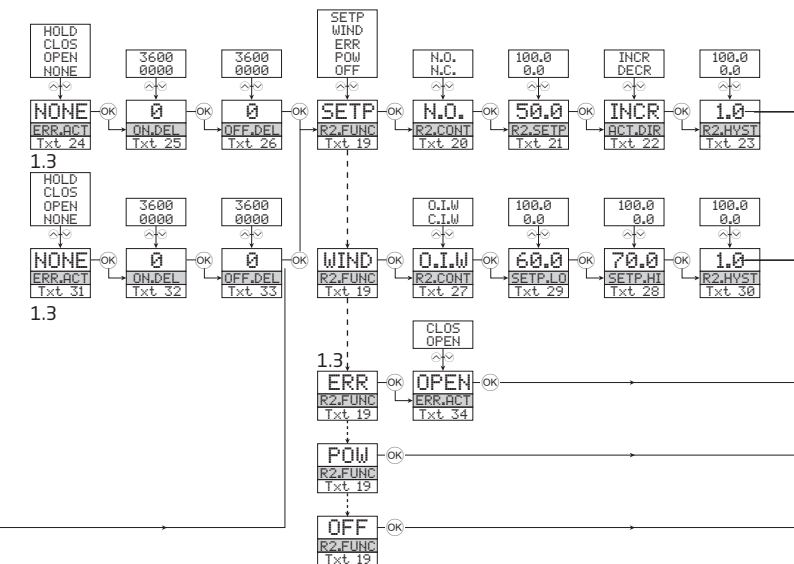
⌃ Increase value / choose next parameter
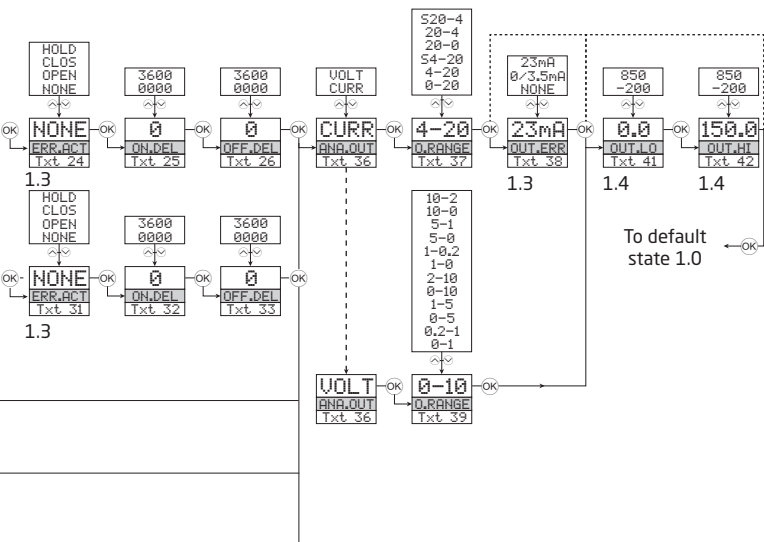⌄ Decrease value / choose previous parameter
⊛ Accept the chosen value and proceed to the next menu
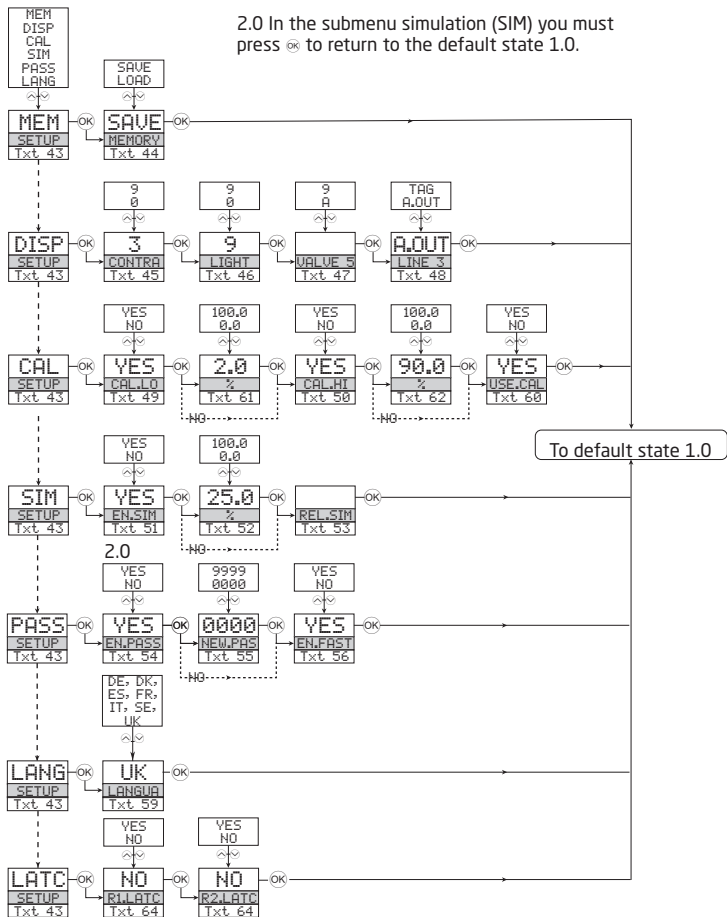Hold ⊛ Back to previous menu / return to menu 1.0 without saving

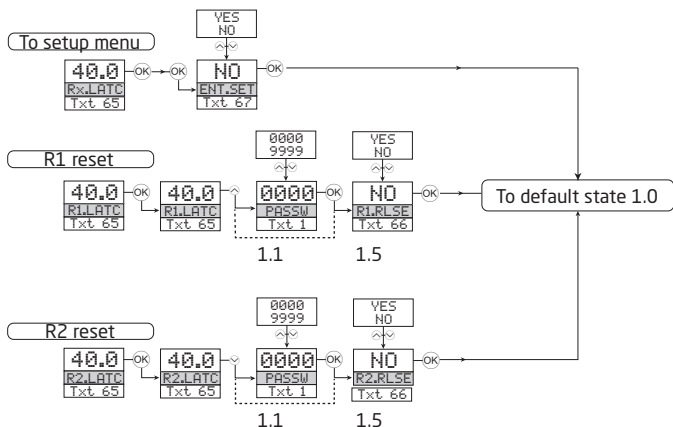| 999.9 / -199.9	DISP / PERC	SETP WIND ERR POW OFF	N.O. / N.C.	100.0 / 0.0	INCR / DECR	100.0 / 0.0
100.0	PERC	SETP	N.O.	50.0	INCR	1.0
DISP.HI / Txt 14	REL.UN / Txt 15	R1.FUNC / Txt 19	R1.CONT / Txt 20	R1.SETP / Txt 21	ACT.DIR / Txt 22	R1.HYST / Txt 23

O.I.W / C.I.W	100.0 / 0.0	100.0 / 0.0	100.0 / 0.0
WIND	O.I.W	60.0	70.0	1.0
R1.FUNC / Txt 19	R1.CONT / Txt 27	SETP.LO / Txt 29	SETP.HI / Txt 28	R1.HYST / Txt 30

1.3

CLOS / OPEN
ERR → OPEN
R1.FUNC / Txt 19	ERR.ACT / Txt 34

POW
R1.FUNC / Txt 19

OFF
R1.FUNC / Txt 19

°C / °F

°C
UNIT
Txt 9

Selectable UNITS:

°C	hp	kW	mA	pH
°F	hPa	kWh	mbar	rpm
%	Hz	l	mils	s
A	in	l/h	min	S
bar	in/h	l/min	mm	t
cm	in/min	l/s	mm/s	t/h
ft	in/s	m	mol	uA
ft/h	ips	m/h	MPa	um
ft/min	K	m/min	mV	uS
ft/s	kA	m/s	MW	V
g	kg	m/s2	MWh	W
gal/h	kJ	m3	N	Wh
gal/min	kPa	m3/h	Ohm	yd
GW	kV	m3/min	Pa	[blank]

Top branch:

HOLD / CLOS / OPEN / NONE → **NONE** / ERR.ACT / Txt 24 — 1.3

3600 / 0000 → **0** / ON.DEL / Txt 25

3600 / 0000 → **0** / OFF.DEL / Txt 26

VOLT / CURR → **CURR** / ANA.OUT / Txt 36

S20-4 / 20-4 / 20-0 / S4-20 / 4-20 / 0-20 → **4-20** / O.RANGE / Txt 37

23mA / 0/3.5mA / NONE → **23mA** / OUT.ERR / Txt 38 — 1.3

850 / -200 → **0.0** / OUT.LO / Txt 41 — 1.4

850 / -200 → **150.0** / OUT.HI / Txt 42 — 1.4

To default state 1.0

Second branch:

HOLD / CLOS / OPEN / NONE → **NONE** / ERR.ACT / Txt 31 — 1.3

3600 / 0000 → **0** / ON.DEL / Txt 32

3600 / 0000 → **0** / OFF.DEL / Txt 33

Voltage branch:

VOLT / CURR → **VOLT** / ANA.OUT / Txt 36

10-2 / 10-0 / 5-1 / 5-0 / 1-0.2 / 1-0 / 2-10 / 0-10 / 1-5 / 0-5 / 0.2-1 / 0-1 → **0-10** / O.RANGE / Txt 39

ROUTING DIAGRAM

Advanced settings (ADV.SET)

2.0 In the submenu simulation (SIM) you must press ⊛ to return to the default state 1.0.

MEM DISP CAL SIM PASS LANG ∧∨				
MEM SETUP Txt 43	SAVE LOAD ∧∨			
	SAVE MEMORY Txt 44			

DISP SETUP Txt 43 →
- 9 / 0 / ∧∨ → **3** CONTRA Txt 45 →
- 9 / 0 / ∧∨ → **9** LIGHT Txt 46 →
- 9 / A / ∧∨ → **VALVE 5** Txt 47 →
- TAG / A.OUT / ∧∨ → **A.OUT** LINE 3 Txt 48 →

CAL SETUP Txt 43 →
- YES / NO / ∧∨ → **YES** CAL.LO Txt 49 →
- 100.0 / 0.0 / ∧∨ → **2.0** % Txt 61 →
- YES / NO / ∧∨ → **YES** CAL.HI Txt 50 →
- 100.0 / 0.0 / ∧∨ → **90.0** % Txt 62 →
- YES / NO / ∧∨ → **YES** USE.CAL Txt 60 →

To default state 1.0

SIM SETUP Txt 43 →
- YES / NO / ∧∨ → **YES** EN.SIM Txt 51 →
- 100.0 / 0.0 / ∧∨ → **25.0** % Txt 52 →
- **REL.SIM** Txt 53 →

2.0

PASS SETUP Txt 43 →
- YES / NO / ∧∨ → **YES** EN.PASS Txt 54 →
- 9999 / 0000 / ∧∨ → **0000** NEW.PAS Txt 55 →
- YES / NO / ∧∨ → **YES** EN.FAST Txt 56 →

LANG SETUP Txt 43 →
- DE, DK, ES, FR, IT, SE, UK / ∧∨ → **UK** LANGUA Txt 59 →

LATC SETUP Txt 43 →
- YES / NO / ∧∨ → **NO** R1.LATC Txt 64 →
- YES / NO / ∧∨ → **NO** R2.LATC Txt 64 →

SCU-1600
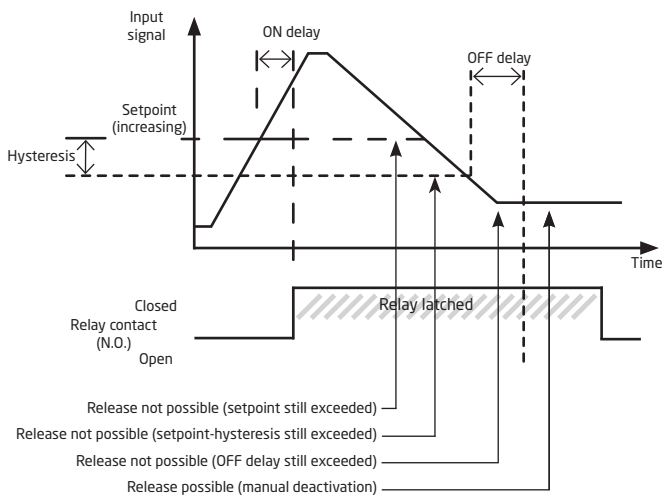
ROUTING DIAGRAM
Manual deactivation of the latch function
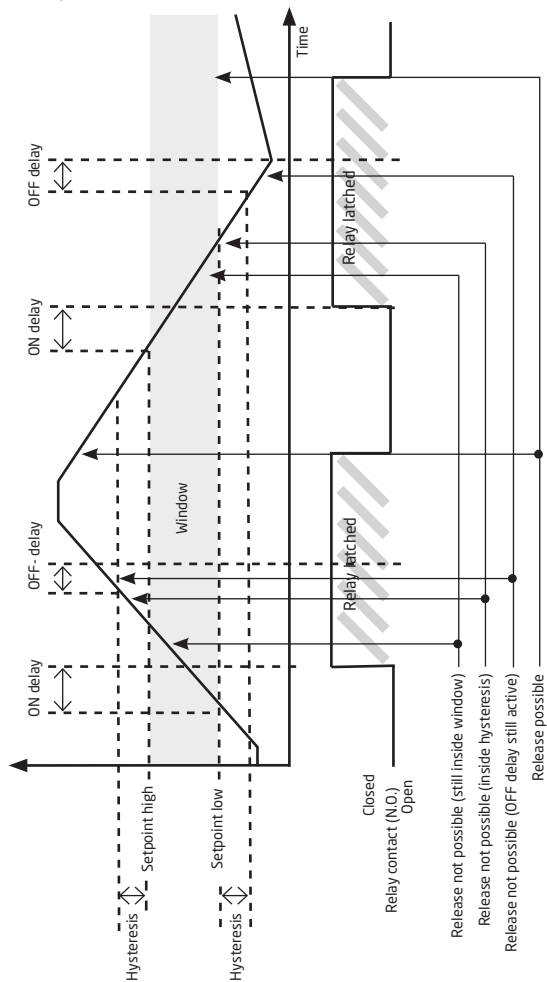
SCROLLING HELP TEXT IN DISPLAY LINE 3

[01] Set correct password
[02] Enter advanced setup menu?
[03] Select temperature input
Select potentiometer input
Select linear resistance input
Select current input
Select voltage input
[04] Select 0.0-1 V input range
Select 0.2-1 V input range
Select 0-5 V input range
Select 1-5 V input range
Select 0-10 V input range
Select 2-10 V input range
[05] Select 0-20 mA input range
Select 4-20 mA input range
[06] Select 2-wire sensor connection
Select 3-wire sensor connection
Select 4-wire sensor connection
[07] Set resistance value low
[08] Set resistance value high
[09] Select Celsius as temperature unit
Select Fahrenheit as temperature unit
[10] Select TC sensor type
Select Ni sensor type
Select Pt sensor type
Select Cu sensor type
[11] Select display unit
[12] Select decimal point position
[13] Set display range low
[14] Set display range high
[15] Set relays in % of input range
Set relays in display units
[16] Select Pt10 as sensor type
Select Pt20 as sensor type
Select Pt50 as sensor type
Select Pt100 as sensor type
Select Pt200 as sensor type
Select Pt250 as sensor type
Select Pt300 as sensor type
Select Pt400 as sensor type
Select Pt500 as sensor type
Select Pt1000 as sensor type
[17] Select Ni50 as sensor type
Select Ni100 as sensor type
Select Ni120 as sensor type
Select Ni1000 as sensor type
[69] Select Cu10 as sensor type
Select Cu20 as sensor type
Select Cu50 as sensor type
Select Cu100 as sensor type
[18] Select TC-B as sensor type
Select TC-E as sensor type
Select TC-J as sensor type
Select TC-K as sensor type
Select TC-L as sensor type
Select TC-N as sensor type
Select TC-R as sensor type
Select TC-S as sensor type
Select TC-T as sensor type
Select TC-U as sensor type
Select TC-W3 as sensor type
Select TC-W5 as sensor type
Select TC-Lr as sensor type

[19] Select OFF function - relay is permanently off
Select POWER function - relay indicates power status OK
Select ERROR function - relay indicates sensor error only
Select WINDOW function - relay controlled by 2 setpoints
Select SETPOINT function - relay controlled by 1 setpoint
[20] Select Normally Closed contact
Select Normally Open contact
[21] Set relay setpoint
[22] Activate relay on decreasing signal
Activate relay on increasing signal
[23] Set relay hysteresis
[24] No error action - undefined status at error
Open relay contact at error
Close relay contact at error
Hold relay status at error
[25] Set relay ON delay in seconds
[26] Set relay OFF delay in seconds
[27] Relay contact is Closed Inside Window
Relay contact is Open Inside Window
[28] Set relay window setpoint high
[29] Set relay window setpoint low
[30] Set relay window hysteresis
[31] No error action - undefined status at error
Open relay contact at error
Close relay contact at error
Hold relay status at error
[32] Set relay ON delay in seconds
[33] Set relay OFF delay in seconds
[34] Open relay contact at error
Close relay contact at error
[36] Select current as analogue output type
Select voltage as analogue output type
[37] Select 0-20 mA output range
Select 4-20 mA output range
Select S4-20 mA with safety readback
Select 20-0 mA output range
Select 20-4 mA output range
Select S20-4 mA with safety readback
[38] Select no error action - output undefined at error
Select downscale at error
Select NAMUR NE43 downscale at error
Select NAMUR NE43 upscale at error
[39] Select 0.0-1 V output range
Select 0.2-1 V output range
Select 0-5 V output range
Select 1-5 V output range
Select 0-10 V output range
Select 2-10 V output range
Select 1-0.0 V output range
Select 1-0.2 V output range
Select 5-0 V output range
Select 5-1 V output range
Select 10-0 V output range
Select 10-2 V output range
[41] Set temperature for analogue output low
[42] Set temperature for analogue output high

[43] Enter password setup
Enter simulation mode
Perform process calibration
Enter display setup
Perform memory operations
Enter relay latch setup
[44] Load saved configuration into SCU-1600
Save SCU-1600 configuration in SCU-PDM1 or SCU-PDM2
[45] Adjust LCD contrast
[46] Adjust LCD backlight
[47] Write a 6-character device TAG
[48] Analogue output value is shown in display line 3
Device TAG is shown in display line 3
[49] Calibrate input low to process value?
[50] Calibrate input high to process value?
[51] Enable simulation mode?
[52] Set the input simulation value
[53] Relay simulation - use ∧ and ∨ to toggle relay 1 and 2
[54] Enable password protection?
[55] Set new password
[56] Enable Fastset functionality?
[57] Relay setpoint - press ⊠ to save
[58] Relay setpoint - Read only
[59] Select language
[60] Use process calibration values?
[61] Set value for low calibration point
[62] Set value for high calibration point
[63] Select CJC connector (accessory)
Select internal temperature sensor
[64] Enable relay latch function?
[65] Relay is latched - press ⊠ to acknowledge
Relay 1 is latched - press ∧ to release
Relay 2 is latched - press ∨ to release
Relays are latched - press ∧ or ∨ tor release relay 1 or relay 2
[66] Release relay? (if conditions allow)
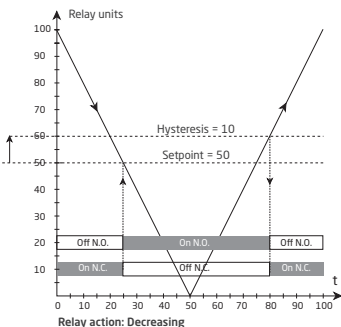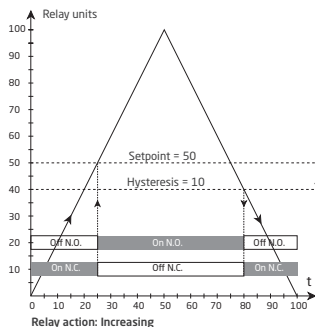[67] Enter setup menu? (latched relays may release!)

Graphic depiction of latch function setpoint

Input signal

ON delay

OFF delay

Setpoint (increasing)

Hysteresis

Time

Closed

Relay contact (N.O.)

Open

Relay latched

Release not possible (setpoint still exceeded)

Release not possible (setpoint-hysteresis still exceeded)

Release not possible (OFF delay still exceeded)

Release possible (manual deactivation)

Graphic depiction of latch function window

Graphic depiction of relay action setpoint

Relay action: Increasing

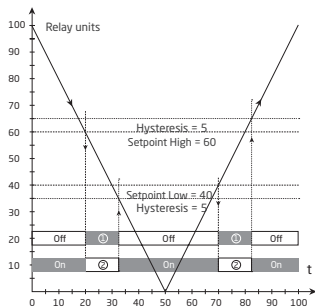

Relay action: Decreasing

Graphic depiction of relay action window
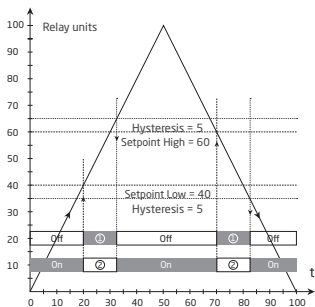
Relay function: Window (shown for increasing signal)
Contact: Closed inside window = ①
Contact: Open inside window = ②

Relay function: Window (shown for decreasing signal)
Contact: Closed inside window = ①
Contact: Open inside window = ②