DC Output Modules

P2-32TD2P $148.00

Sourcing Output
The P2-32TD2P DC Output Module provides thirty-two 24 VDC sourcing outputs with short circuit and overload protection.

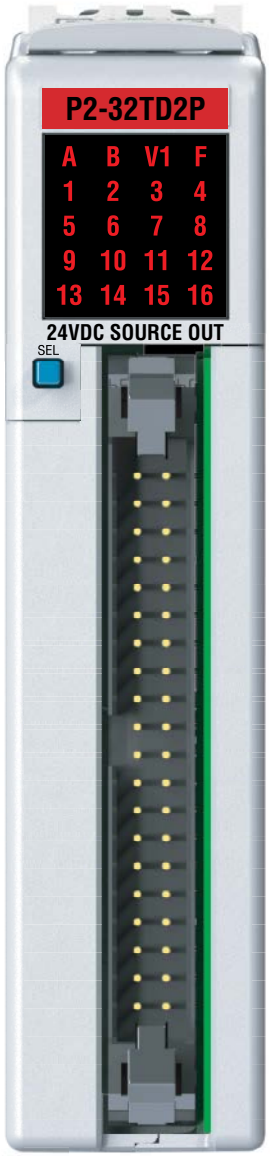

Output Specifications	
Outputs per Module	32 sourcing
Voltage Rating	24 VDC
Operating Voltage Range	20.4–28.8 VDC
Maximum Output Current	0.2A / pt, 1.6A common @ 60 °C, 0.5A / pt, 2A common @ 40 °C
Maximum Inrush Current	Self-limited
On Voltage Drop	0.5 VDC @ 0.1 A
OFF to ON Response	≤0.5 ms
ON to OFF Response	≤0.5 ms
Overcurrent Trip	0.6A min., 1.2A max., >50 ms duration
Minimum Load Current to Avoid Open Load Fault Detection	113 µA
Maximum Leakage Current	160 µA @ 21.6–26.4 VDC
Over-temperature Shutdown	Independent to each output
Load Resistance to Avoid Open Load Fault Detection	<58 kΩ
Status Indicators	Logic Side (16 points x 2)
External 24V Error Indicator	Logic Side (1 point)
Fault Condition Indicator	Logic Side (16 points x 2)
Commons	4 (non-isolated)
Fuses	None
External DC Power Required	24 VDC (-15% / +20%) @ 80 mA

General Specifications	
Operating Temperature	0 to 60 °C [32 to 140 °F],
Storage Temperature	-20 to +70 °C [-4 to +158 °F]
Humidity	5 to 95% (non-condensing)
Environmental Air	No corrosive gases permitted
Vibration	IEC60068-2-6 (Test Fc)
Shock	IEC60068-2-27 (Test Ea)
Field to Logic Side Isolation	1800 VAC applied for 1 second
Insulation Resistance	>10 MΩ @ 500 VDC
Heat Dissipation	4.0W
Enclosure Type	Open equipment
Module Keying to Backplane	Electronic
Module Location	Any I/O slot in any local or remote base in a Productivity2000 system.
Field Wiring	Use ZIPLink wiring system ONLY. See Wiring Solutions.
Weight	105g [3.7 oz]
Agency Approvals*	UL61010-2-201 file E139594, Canada & USA CE (EN61131-2*, SAFETY EN61010-2-201)

**Meets EMC and Safety requirements. See the Declaration of Conformity for details.*
***To obtain the most current agency approval information, see the Agency Approval Checklist section on the specific component part number web page.*

NOTE: The most recent Productivity Suite software and firmware versions may be required to support new modules and new features.

Connector Specifications	
Connector Type	IDC style header with latch, Omron XG4A-4034
Number of Pins	40 point
Pitch	0.1in [2.54mm]

See Wiring Solutions for part numbers of ZIPLink cables and connection modules required with this I/O module.

DC Output Modules

P2-32TD2P (cont'd)

LED Status		
Fault Condition	***Fault Status Indication***	***Operation to Reset Fault***
Missing External 24 VDC	V1 LED is ON	Apply external 24 VDC
Open Load (Note 1)	"F" LED is ON (Note 2)	Connect the load
Over Temperature or Over Load Current		Turn the output OFF or cycle power
LED Page Shifting		
The "A" LED is ON when the LED states correspond to outputs/ faults 1–16. The "B" LED is ON for outputs / faults 17–32.		

Note 1: Open Load Fault is always enabled, but is only valid when output is OFF. If Open Load Fault happens while output is ON, fault will not appear until output turns OFF.

Note 2: The SEL button cycles between the output status and fault status. If the "F" LED is OFF the numbered LEDs are showing output status. If the "F" LED is ON the numbered LEDs are showing fault status of each output. The "V1" LED is independent of fault or output display.

Wiring Diagrams

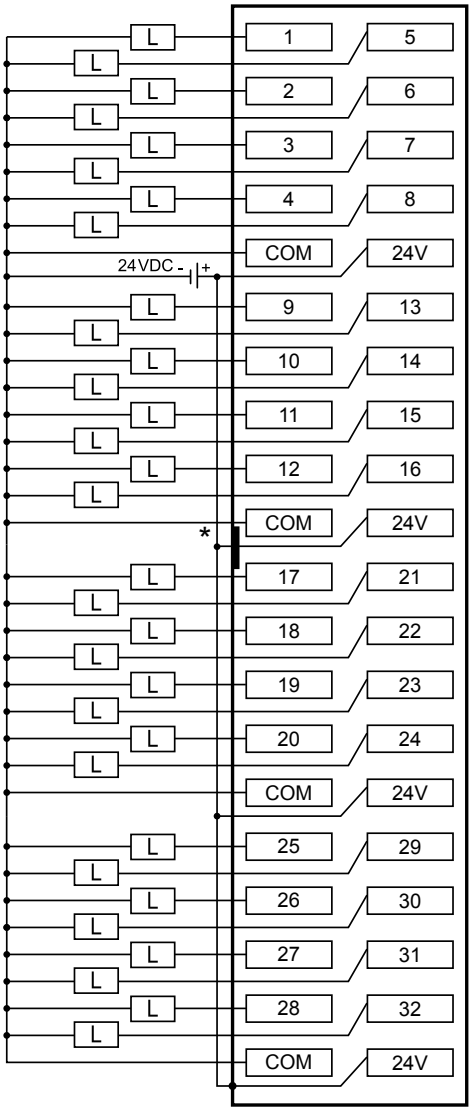

** Denotes key location of all associated ZIPLink cables.*

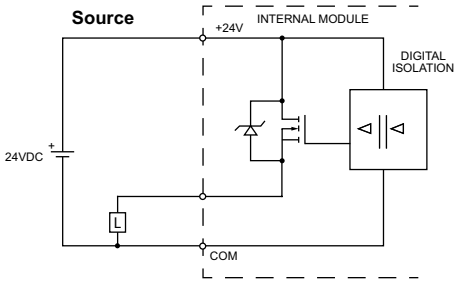

Wiring I/O Modules

Wiring Methods

There are two available methods for wiring most I/O modules: The ZIPLink wiring system (See page following), or hand wiring to the optional Removable Terminal Blocks.

Removable Terminal Blocks

For most I/O modules you can purchase a removable terminal block (p/n shown below).

Note: Thermocouple and RTD modules are not compatible with the ZIPLink system and are shipped with the optional terminal blocks included.



Removable Terminal Block: p/n P2-RTB



Removable Terminal Block: p/n P2-RTB-1

Removable Terminal Block Specifications		
Part Number	***P2-RTB***	***P2-RTB-1***
Price	$10.00	$10.00
Number of positions	18 screw terminals	18 push release terminals
Wire Range	30–16 AWG [0.051–1.31 mm²] Solid/stranded conductor 3/64in [1.2mm] insulation max. 1/4in [6–7mm] strip length	28–16 AWG [0.081–1.31 mm²] Solid/stranded conductor 3/64in [1.2mm] insulation max. 19/64in [7–8mm] strip length
Conductors	USE COPPER CONDUCTORS, 75 ºC or equivalent.	
Screw Driver Width	0.1 in. [2.5mm] maximum	N/A
Screw Size	M2	N/A
Screw Torque	2.5 lb·in [0.28 N·m]	N/A

** Recommended screw driver: P/N TW-SD-MSL-1.*



Removable Terminal Block: p/n P2-RTB13



Removable Terminal Block: p/n P2-RTB13-1

Removable Terminal Block Specifications		
Part Number	***P2-RTB13***	***P2-RTB13-1***
Price	$11.50	$11.50
Number of positions	13 screw terminals	13 push release terminals
Wire Range	24–12 AWG [0.25–4 mm²] Solid/stranded conductor 3/64in [1.2mm] insulation max. 3/8in [9–10mm] strip length	
Conductors	USE COPPER CONDUCTORS, 75 ºC or equivalent.	
Screw Driver Width	0.13in [3.5mm] maximum	N/A
Screw Size	M2.5	N/A
Screw Torque	4.4 lb·in [0.5 N·m]	N/A

** Recommended screw driver: P/N TW-SD-MSL-1.*

Terminal Block Removal

Removable Terminal Blocks fit firmly into the I/O module terminal recess. To remove, firmly grasp the removable terminal block and wiggle side to side while pulling away from the module.

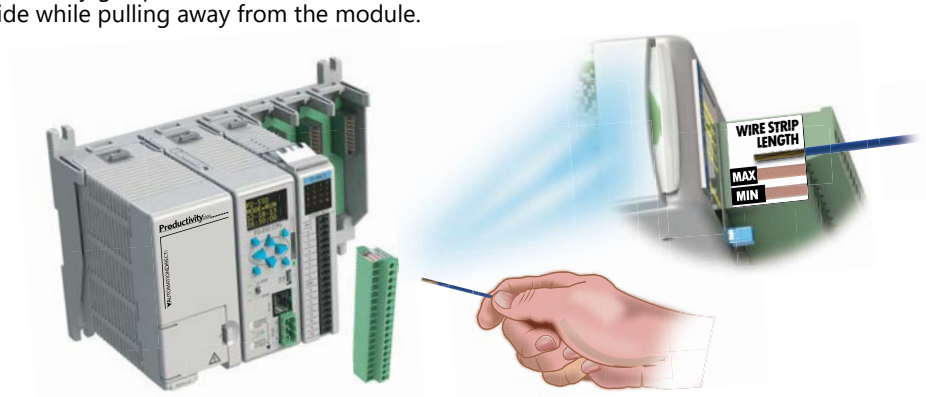

ZIPLink Wiring Solutions

Wiring Solutions using the ZIPLink wiring system

ZIPLinks eliminate the normally tedious process of wiring between devices by utilizing prewired cables and DIN rail mount connector modules. It's as simple as plugging in a cable connector at either end and terminating wires at only one end. Prewired cables keep installation clean and efficient, using half the space at a fraction of the cost of standard terminal blocks. There are several wiring solutions available when using the ZIPLink System ranging from CPU I/O-to-ZIPLink Connector Modules that are ready for field termination, options for connecting to third party devices, GS Series, DuraPulse and SureServo Drives, and specialty relay, transorb and communications modules. Pre-printed I/O-specific adhesive label strips for quick marking of ZIPLink modules are provided with ZIPLink cables. See the following solutions to help determine the best ZIPLink system for your application.

Solution 1: DirectLOGIC, CLICK, Productivity® 1000, Productivity® 2000 and Productivity3000® I/O Modules to ZIPLink Connector Modules

When looking for quick and easy I/O-to-field termination, a ZIPLink connector module used in conjunction with a prewired ZIPLink cable, consisting of an I/O terminal block at one end and a multi-pin connector at the other end, is the best solution.

Use the CPU I/O Modules to ZIPLink Connector Modules selector tables located in the ZIPLink Wiring Solutions section to:

1. Locate your I/O module/CPU,
2. Select a ZIPLink Module, and
3. Select a corresponding ZIPLink Cable.

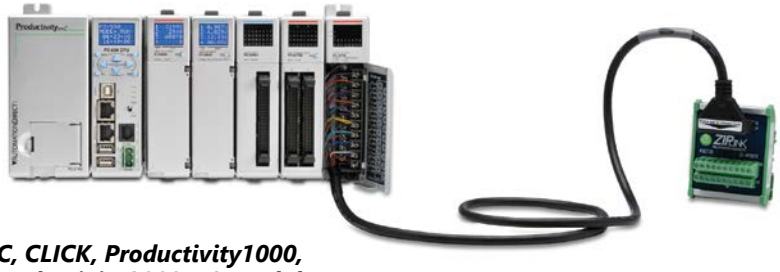

Solution 2: DirectLOGIC, CLICK, Productivity1000, Productivity2000 and Productivity3000 I/O Modules to 3rd Party Devices

When wanting to connect I/O to another device within close proximity of the I/O modules, no extra terminal blocks are necessary when using the ZIPLink Pigtail Cables. ZIPLink Pigtail Cables are prewired to an I/O terminal block with color-coded pigtail with soldered-tip wires on the other end.

Use the I/O Modules to 3rd Party Devices selector tables located in the ZIPLink Wiring Solutions section to:

1. Locate your CPU I/O module, and
2. Select a ZIPLink Pigtail Cable that is compatible with your 3rd party device.

Solution 3: GS Series and DuraPulse Drives Communication Cables

Need to communicate via Modbus RTU to a drive or a network of drives?

ZIPLink cables are available in a wide range of configurations for connecting to CPUs, SureServo, SureStep, Stellar Soft Starter and AC drives. Add a ZIPLink communications module to quickly and easily set up a multi-device network.

Use the Drives Communication selector tables located in the ZIPLink Wiring Solutions section to:

1. Locate your Drive and type of communications, and
2. Select a ZIPLink cable and other associated hardware.

ZIPLink Wiring Solutions

Solution 4: Serial Communications Cables

ZIPLink offers communications cables for use with DirectLOGIC, CLICK, Productivity1000, Productivity2000 and Productivity3000 CPUs, that can also be used with other communications devices. Connections include a 6-pin RJ12 or 9-pin, 15-pin and 25-pin D-Sub connectors which can be used in conjunction with the RJ12 or D-Sub Feedthrough modules.

Using the Serial Communications Cables selector table located in the ZIPLink Wiring Solutions section,

1. Locate your connector type
2. Select a cable.

Solution 5: Specialty ZIPLink Modules

For additional application solutions, ZIPLink Specialty Modules are available in a variety of configurations including stand-alone relays, 24 VDC and 120 VAC transorb modules, D-Sub, RJ12 and RJ45 feedthrough modules, communication port adapter and distribution modules, and SureServo 50-pin I/O interface connection.

Using the ZIPLink Specialty Modules selector table located in the ZIPLink Wiring Solutions section:

1. Locate the type of application.
2. Select a ZIPLink module.

Solution 6: ZIPLink Connector Modules to 3rd Party Devices

If you need a way to connect your device to terminal blocks without all that wiring time, then our pigtail cables with color-coded soldered-tip wires are a good solution. Used in conjunction with any compatible ZIPLink Connector Modules, a pigtail cable keeps wiring clean and easy and reduces troubleshooting time.

Use the Universal Connector Modules and Pigtail Cables table located in the ZIPLink Wiring Solutions section to:

1. Select module type,
2. Select the number of pins
3. Select cable.

I/O Modules to ZIPLink Connector Modules - Productivity2000

Discrete Input Modules

Productivity2000 Input Module ZIPLink Selector				
I/O Input Module	ZIPLink Parameters			
	# of Terms	Component	Part No.	Cable Part No.
P2-08ND3-1	18	Feedthrough	ZL-RTB20 (-1)	ZL-P2-CBL18 *
P2-16ND3-1	18	Sensor/LED	ZL-LTB16-24-1	
P2-16ND-TTL	18	Feedthrough	ZL-RTB20 (-1)	
P2-08NE3				
P2-16NE3				
P2-32ND3-1	40	Feedthrough	ZL-RTB40 (-1)	ZL-CBL40 *
		Sensor/LED	ZL-LTB32-24-1	
P2-32NE3	40	Feedthrough	ZL-RTB40 (-1)	
P2-08NAS	18	Feedthrough	ZL-RTB20 (-1)	ZL-P2-CBL18 *
P2-16NA	18			

Specialty Modules

Productivity2000 Specialty & Motion Modules ZIPLink Selector				
I/O Module	ZIPLink Parameters			
	# of Terms	Component	Part No.	Cable Part No.
P2-HSI	40	Feedthrough	ZL-RTB40 (-1)	ZL-CBL40-S ZL-CBL40-1S ZL-CBL40-2S
P2-HSO				
P2-02HSC	See Note 1			
P2-04PWM	18	Feedthrough	ZL-RTB20 (-1)	ZL-P2-CBL18 *
P2-08SIM	See Note 1			
P2-SCM	See Note 1			

Table Notes

** Select the cable length by replacing the * with: Blank = 0.5m, -1 = 1.0m, or -2 = 2.0m.*

1. These modules are not supported by the ZIPLink wiring system

2. Note: Fuses (5 x 20mm) are not included. See Edison Electronic Fuse section for (5 x 20mm) fuse. S500 and GMA electronic circuit protection for fast-acting maximum protection. S506 and GMC electronic circuit protection for time-delay performance. Ideal for inductive circuits.
To ensure proper operation, do not exceed the voltage and current rating of ZIPLink module. ZL-RFU20 = 2A per circuit; ZL-RFU40 = 400 mA per circuit.

Discrete Output Modules

Productivity2000 Output Module ZIPLink Selector				
I/O Output Module	ZIPLink Parameters			
	# of Terms	Component	Part No.	Cable Part No.
P2-08TD1S	18	Feedthrough	ZL-RTB20 (-1)	ZL-P2-CBL18 *
P2-08TD2S	18			
P2-15TD1	18			
P2-15TD2	18			
P2-08TD1P	18			
P2-16TD-TTL	18			
P2-08TD2P	18			
P2-08TRS	18			
P2-08TEPS	18			
P2-16TEP	18			
P2-08TAS	18			
P2-16TA	18	Feedthrough	ZL-RTB20 (-1)	
		Fuse	ZL-RFU20 [2]	
P2-16TD1P	18	Feedthrough	ZL-RTB20 (-1)	
		Relay (Sinking)	ZL-RRL16-24-1 ZL-RRL16W-24-1 ZL-RRL16F-24-1	
P2-16TD2P	18	Feedthrough	ZL-RTB20 (-1)	
		Relay (Sourcing)	ZL-RRL16-24-2 ZL-RRL16W-24-2 ZL-RRL16F-24-2	
P2-32TD1P	40	Feedthrough	ZL-RTB40 (-1)	ZL-CBL40 *
P2-32TD2P	40			
P2-16TR	18	Feedthrough	ZL-RTB20 (-1)	ZL-P2-CBL18 *
		Fuse	ZL-RFU20 [2]	

Discrete Combo Modules

Productivity2000 Discrete Combo Modules				
I/O Output Module	ZIPLink Parameters			
	# of Terms	Component	Part No.	Cable Part No.
P2-15CDD1	18	Feedthrough	ZL-RTB20 (-1)	ZL-P2-CBL18 *
P2-15CDD2	18			
P2-16CDR	18			

I/O Module Installation Procedure

WARNING: ***DO NOT APPLY FIELD POWER UNTIL THE FOLLOWING STEPS ARE COMPLETED. SEE HOT-SWAP PROCEDURE FOR EXCEPTIONS.***

Step One: Align module catch with base slot and module into connector.

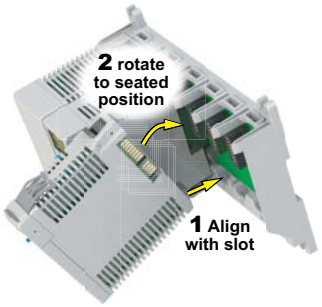

Step Two: Pull top locking tab toward module face. Click indicates lock is en- gaged.

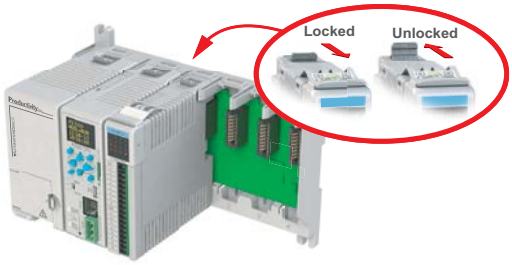

Step Three: Attach field wiring using removable terminal block or ZIPLink wiring system.

WARNING: ***EXPLOSION HAZARD – DO NOT CONNECT OR DISCONNECT CONNECTORS OR OPERATE SWITCHES WHILE CIRCUIT IS LIVE UNLESS THE AREA IS KNOWN TO BE NON-HAZARDOUS. DO NOT HOT-SWAP MODULES UNLESS THE AREA IS KNOWN TO BE NON-HAZARDOUS.***