
Discrete Output Terminals

PX-244-1

\$72.00

Four-point, 0.5 A, 24VDC Discrete Output Terminal

The PX-244-1 (type 1) DC Output Terminal provides four 24VDC 0.5 A short-circuit protected sourcing outputs with LED status. For use with 3-wire and 2-wire devices.



General S	Specifications
Operating Temp	32 to 131 °F (0 to 55 °C)
Storage Temp	-13 to 185 °F (-25 to 85 °C)
Relative Humidity	5% to 95%, non-condensing
Environment Air	No corrosive gases permitted
Mounting/ Orientation Restrictions	35mm DIN rail/None
Vibration	Conforms to EN 60068-2-6
Shock	Conforms to EN 60068-2-27/ EN 60068-2-29
Noise Immunity	Conforms to EN 61000-6-2/ EN61000-6-4
Protection Class	IP20
Weight	60g (2.1 oz)
Dimensions (WxHxD)	12 x 100 x 68.8 mm (0.47 x 3.94 x 2.71 in)
Adjacent Mounting on Bus Terminals with Power Contact	Yes, DC only
Adjacent Mounting on Bus Terminals without Power Contact	No
Passes Terminal Bus Power	Yes
Passes PE Bus	No
Agency Approvals*	UL/cUL File No. E157382, CE

^{*}To obtain the most current agency approval information, see the Agency Approval Checklist section on the specific part number's web page.


Terminal Speci	fications
Outputs Per Terminal	4
Commons Per Terminal	2
Output Type	Sourcing
Output Data Bytes Used	1/2 byte (4 bits)
Output Power Source	24VDC provided via terminal power bus
Current Consumption (from Load Voltage)	30mA typical
Operating Voltage	24VDC (-15%/+20%)
Maximum Load Current	0.5 A per channel (Short-Circuit Protected)
On Voltage Drop	0.4 VDC @ 0.5 A
Maximum Leakage Current	300mA
Maximum Inrush Current	1.5 A
Maximum Short-Circuit Voltage	35V
Load Type	Resistive, inductive, lamp
Current Consumption (from I/O Bus)	9mA typical
Reverse Voltage Protection	No
Electrical Isolation	500Vms (I/O bus/field potential)
Heat Dissipation	1W max
OFF to ON Response	100ms max
ON to OFF Response	20ms max
Status Indicators	4, indicates output is ON

PX-244-2

\$88.00

Four-point, 2A, 24VDC Discrete Output Terminal

The PX-244-2 (type 1) DC Output Terminal provides four 24VDC 2A shortcircuit protected sourcing outputs with LED status.



General Specifications	
Operating Temp	32 to 131 °F (0 to 55 °C)
Storage Temp	-13 to 185 °F (-25 to 85 °C)
Relative Humidity	5% to 95%, non-condensing
Environment Air	No corrosive gases permitted
Mounting/ Orientation Restrictions	35mm DIN rail/None
Vibration	Conforms to EN 60068-2-6
Shock	Conforms to EN 60068-2-27/ EN 60068-2-29
Noise Immunity	Conforms to EN 61000-6-2/ EN61000-6-4
Protection Class	IP20
Weight	60g (2.1 oz)
Dimensions (WxHxD)	12 x 100 x 68.8 mm (0.47 x 3.94 x 2.71 in)
Adjacent Mounting on Bus Terminals with Power Contact	Yes, DC only
Adjacent Mounting on Bus Terminals without Power Contact	No
Passes Terminal Bus Power	Yes
Passes PE Bus	No
Agency Approvals*	UL/cUL File No. E157382, CE

^{*}To obtain the most current agency approval information, see the Agency Approval Checklist section on the specific part number's web page.

Terminal Specifications		
Outputs Per Terminal	4	
Commons Per Terminal	4	
Output Type	Sourcing	
Output Data Bytes Used	1/2 byte (4 bits)	
Output Power Source	24VDC provided via terminal power bus	
Current Consumption (from Load Voltage)	30mA typical	
Operating Voltage	24VDC (-15%/+20%)	
Maximum Load Current	2A per channel (Short-Circuit Protected)	
On Voltage Drop	0.14 VDC @ 2A	
Maximum Leakage Current	60mA	
Maximum Inrush Current	35A	
Maximum Short-Circuit Voltage	52V	
Load Type	Resistive, inductive, lamp	
Current Consumption (from I/O Bus)	9mA typical	
Reverse Voltage Protection	Yes	
Electrical Isolation	500Vms (I/O bus/field potential)	
Heat Dissipation	1W max	
OFF to ON Response	160ms typ, 300ms max	
ON to OFF Response	10ms min, 80ms max	
Status Indicators	4, indicates output is ON	

System Installation and Removal


Bus Coupler and Bus Terminal Installation

Bus Coupler Installation:

 Attach a Bus Coupler by snapping it onto 35mm DIN rail and securing it into position using the DIN rail locking wheel (where applicable) located on the left side of the coupler.


Bus Terminal Installation:

- To add a bus terminal, insert unit onto right side of Bus Coupler using the tongue and groove at the top and bottom of the unit, pressing gently until it snaps onto the DIN rail.
- A proper connection cannot be made by sliding the units together on the DIN rail.
 When correctly installed, no significant gap can be seen between the attached units. Bus connection is made through the six slide contacts located on the upper right side of the units. Add up to 64 bus terminals per Bus Coupler, including a bus end terminal.

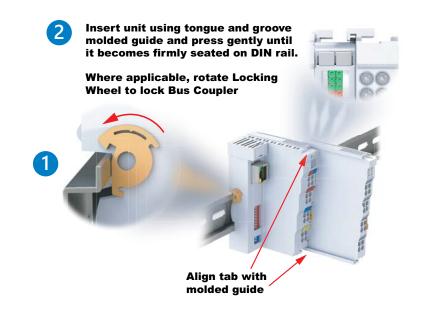

Wiring Connections

 Wire connection is made through a spring clamp style terminal. This terminal is designed for a single-conductor solid or stranded wire. Wire connection is made by firmly pushing the screwdriver into the screwdriver slot, inserting the wire into the wire slot and removing the screwdriver, locking the wire into position.





Wiring Specifications		
Connection Type	Spring Clamp Terminals	
Wire Gauge	28-14 AWG (0.08-2.5 mm2)	
Screwdriver Width	2.5 mm (0.10 in) such as P/N TW-SD-MSL-2	
Wire Stripping Length	8mm	

^{*} For Thermocouple terminals, thermocouple extension wire is recommended

Removing Bus Coupler and Bus Terminals

 A locking mechanism prevents individual units from being pulled off. For bus terminal removal, pull the orange DIN rail release tab firmly to unlatch the unit from the rail. If attached to other terminal units, slide unit forward until released. For Bus Couplers with locking wheels, release the DIN rail locking wheel, then pull firmly on DIN rail release tab.

Where applicable, rotate Locking Wheel to unlock Bus Coupler



to unlatch unit from rail.


www.automationdirect.com Universal Field I/O tFED-24


Installation Considerations

Terminal Dimensions and Spacing Requirements

Use the following diagrams to make sure the Protos X system can be installed in your application. Protos X terminals require 35mm DIN rail for mounting; there are no orientation restrictions.

To ensure proper airflow for cooling purposes, units should be spaced, at a minimum, as shown. It is also important to check the Protos X dimensions against the conditions required for your application.

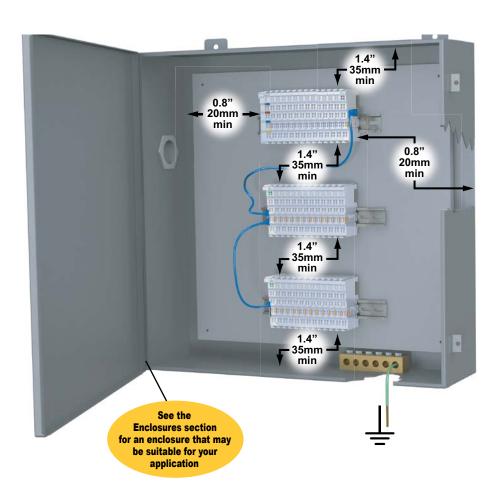


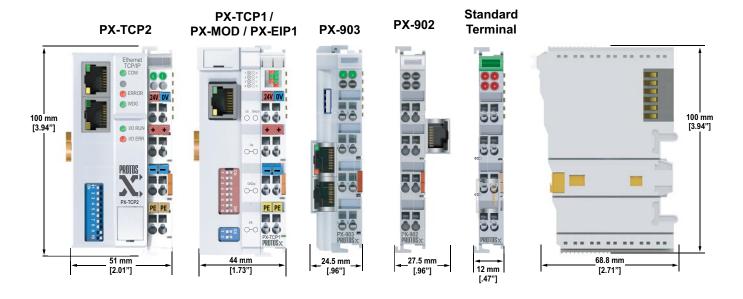


www.automationdirect.com Universal Field I/O tFED-25

Installation Considerations

Terminal Types

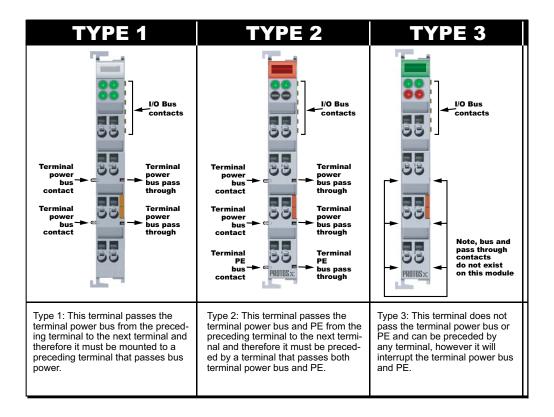

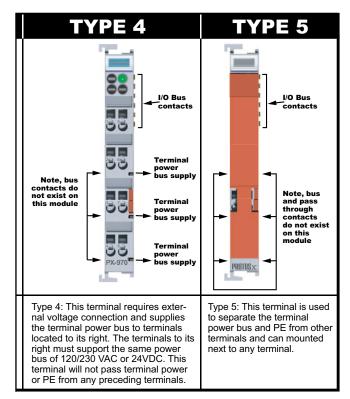

www.automationdirect.com Universal Field I/O tFED-26